


## SCHWINGGESCHWINDIGKEIT

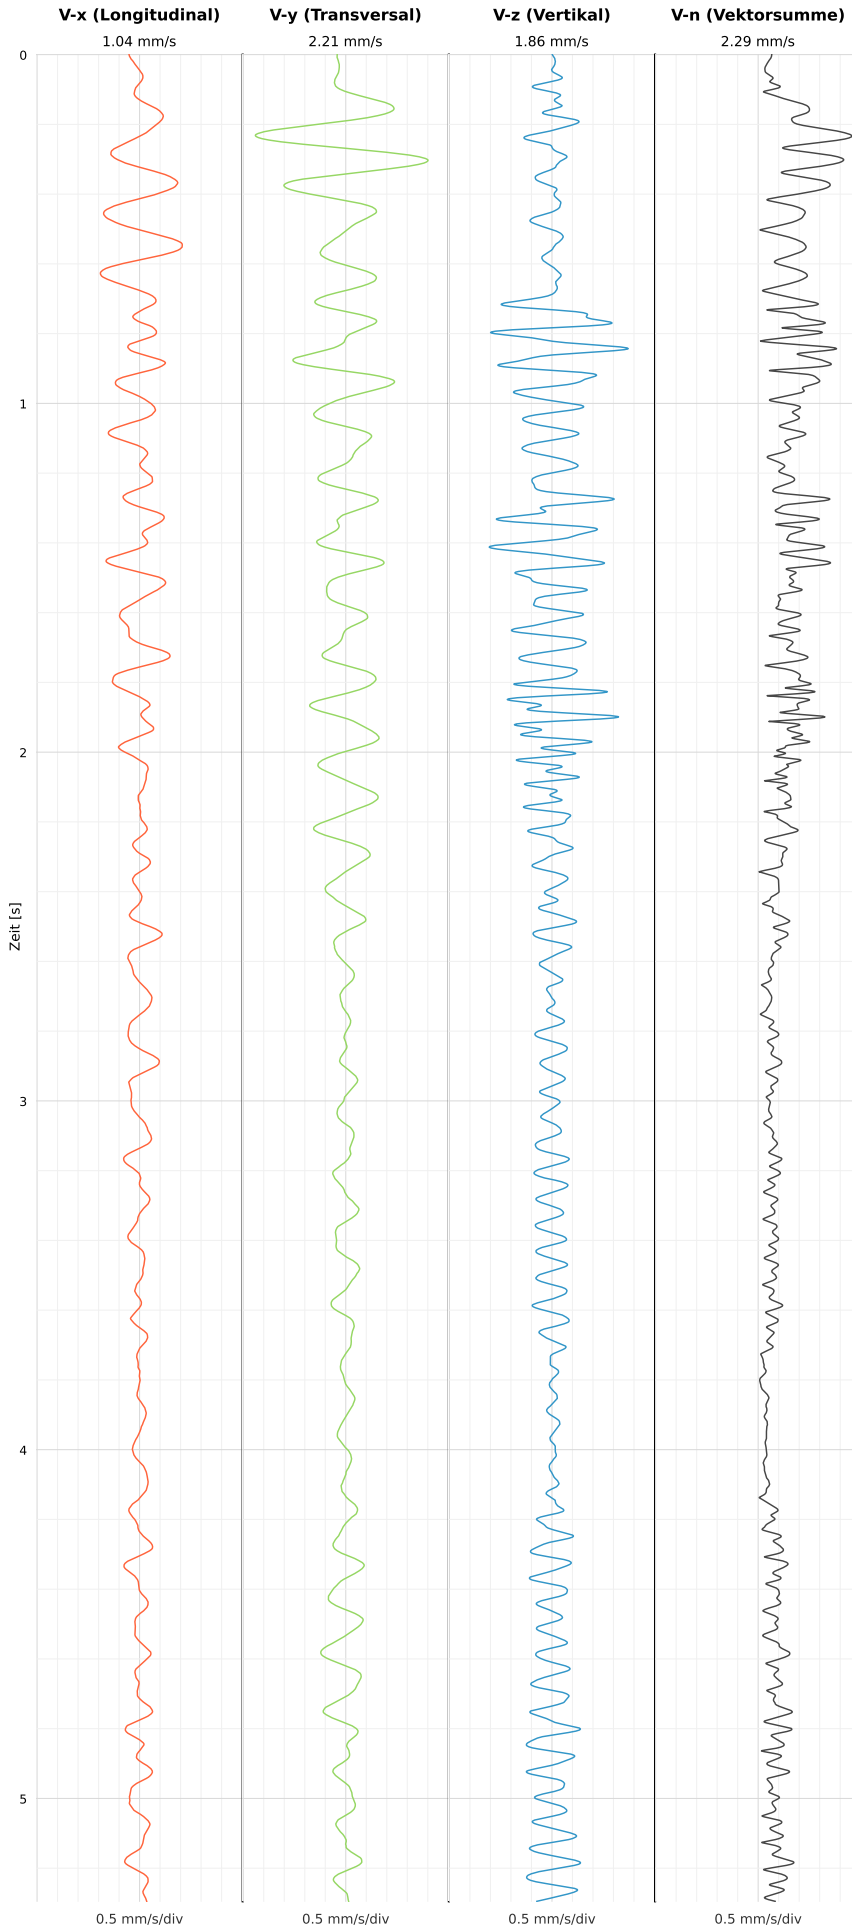


DATEI: 2492-PG-8-13052026-184958\_raw.csv

Aufzeichnungsdauer: 5.30 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	20:49:58
Event-ID	2492-PG-8-13052026-184958
Status	Ereignis
X	1.04 mm/s @ 5.1 Hz
Y	2.21 mm/s @ 5.8 Hz
Z	1.86 mm/s @ 13.4 Hz
Vn	2.29 mm/s @ 5.8 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

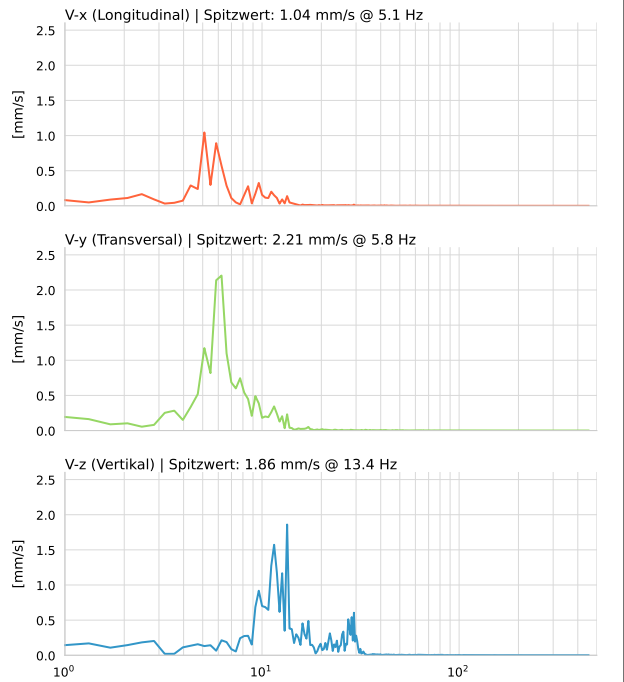

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.1 Hz	5.1 Hz	6.2 Hz	11.5 Hz
Y	5.8 Hz	5.5 Hz	6.6 Hz	9.3 Hz
Z	13.4 Hz	10.8 Hz	13.4 Hz	24.0 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

