


SCHWINGGESCHWINDIGKEIT

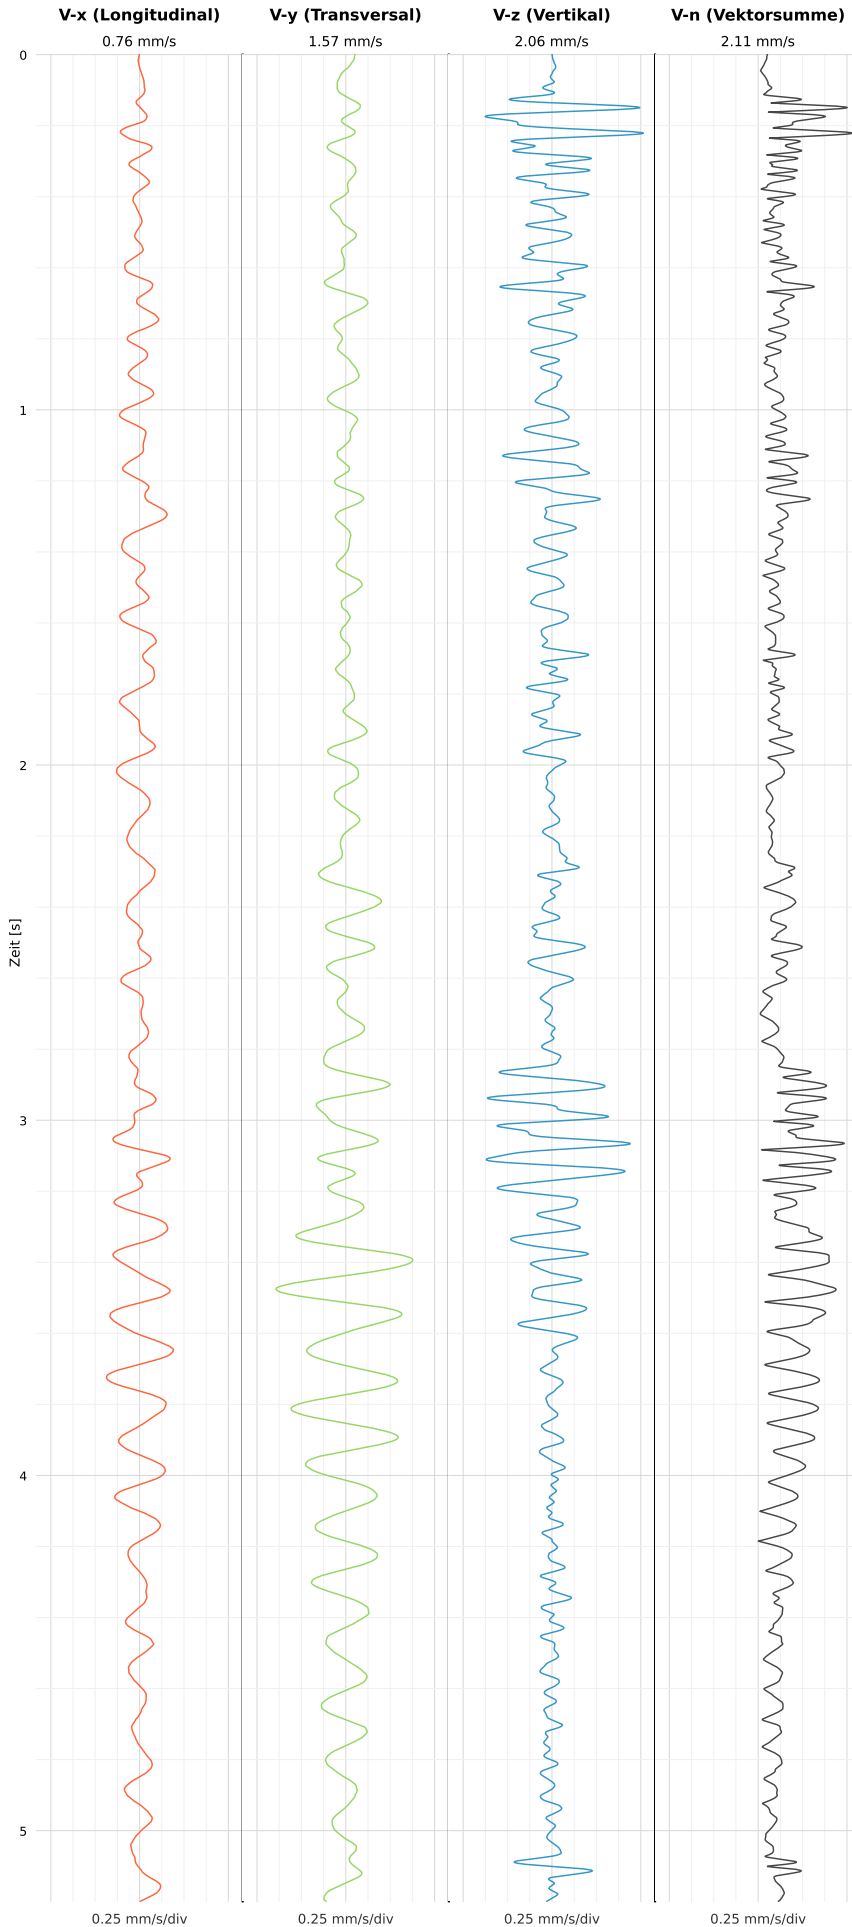


DATEI: 2492-PG-8-13052026-185304_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	20:53:04
Event-ID	2492-PG-8-13052026-185304
Status	Ereignis
X	0.76 mm/s @ 6.0 Hz
Y	1.57 mm/s @ 6.0 Hz
Z	2.06 mm/s @ 12.7 Hz
Vn	2.11 mm/s @ 12.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

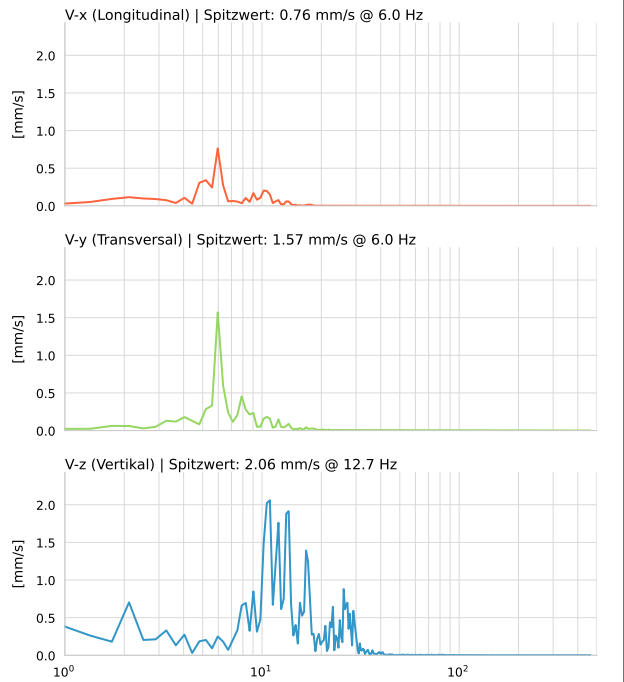

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	6.0 Hz	5.2 Hz	6.0 Hz	10.2 Hz
Y	6.0 Hz	6.0 Hz	7.5 Hz	12.1 Hz
Z	12.7 Hz	10.6 Hz	13.7 Hz	22.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

