


## SCHWINGGESCHWINDIGKEIT

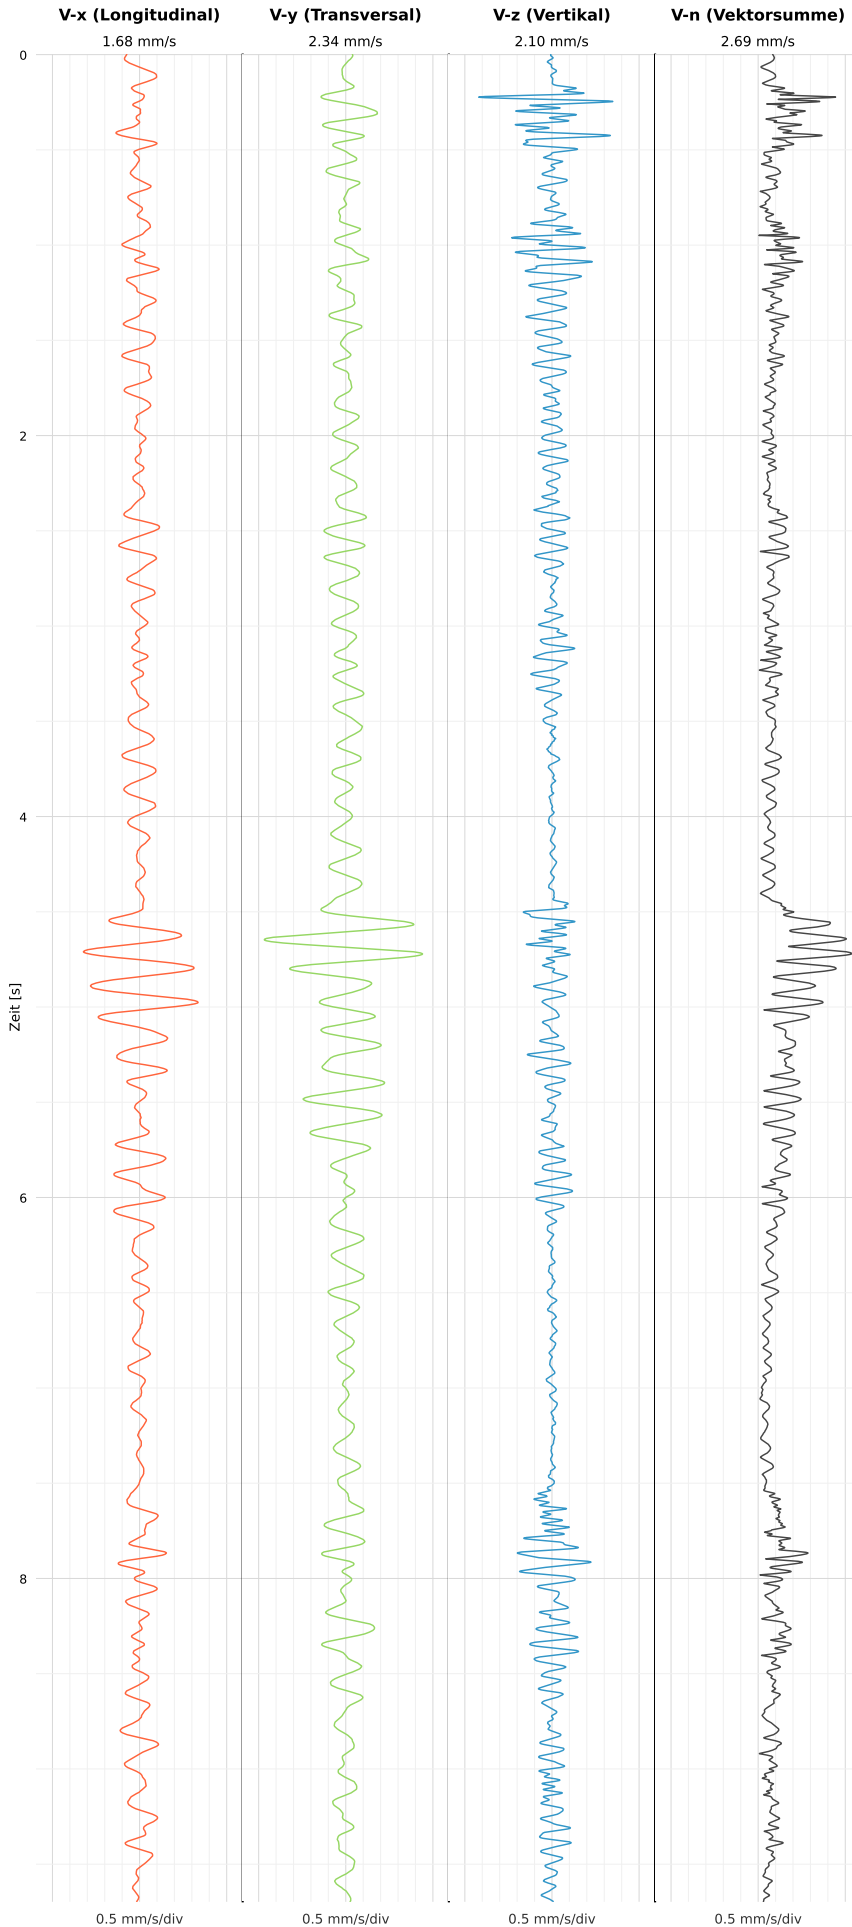


DATEI: 2492-PG-8-14052026-092705\_raw.csv

Aufzeichnungsdauer: 9.70 s | Abtastrate: 1000 Hz

Datum	14.05.2026
Zeit	11:27:05
Event-ID	2492-PG-8-14052026-092705
Status	Ereignis
X	1.68 mm/s @ 5.9 Hz
Y	2.34 mm/s @ 6.0 Hz
Z	2.10 mm/s @ 11.9 Hz
Vn	2.69 mm/s @ 6.0 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

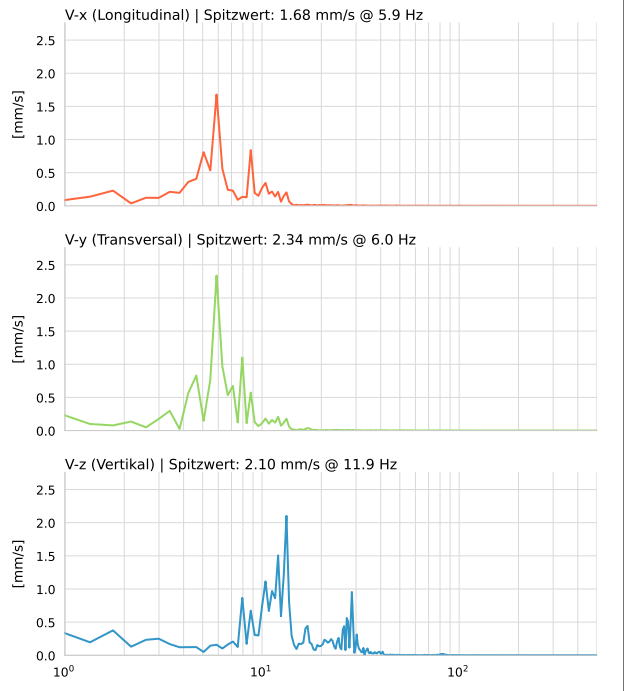

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.9 Hz	5.1 Hz	6.3 Hz	10.4 Hz
Y	6.0 Hz	5.5 Hz	6.3 Hz	7.9 Hz
Z	11.9 Hz	10.4 Hz	13.3 Hz	24.4 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

