


SCHWINGGESCHWINDIGKEIT

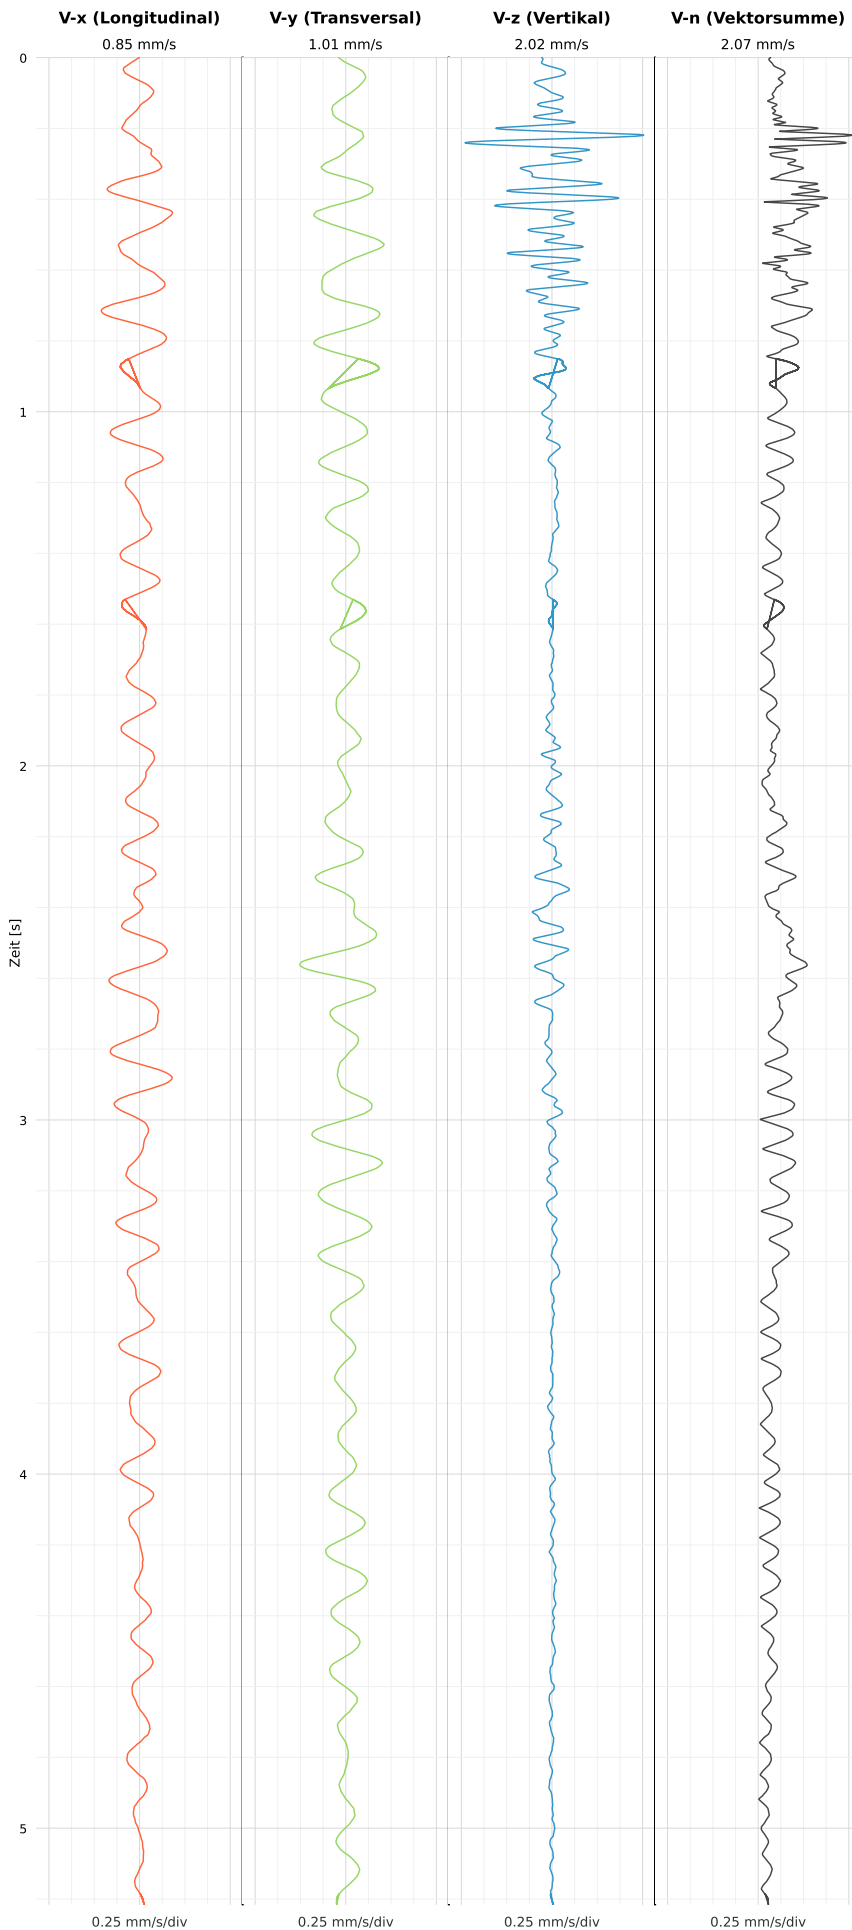


DATEI: 2492-PG-8-14052026-113456_raw.csv

Aufzeichnungsdauer: 5.22 s | Abtastrate: 1000 Hz

Datum	14.05.2026
Zeit	13:34:56
Event-ID	2492-PG-8-14052026-113456
Status	Ereignis
X	0.85 mm/s @ 5.8 Hz
Y	1.01 mm/s @ 5.8 Hz
Z	2.02 mm/s @ 12.0 Hz
Vn	2.07 mm/s @ 11.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

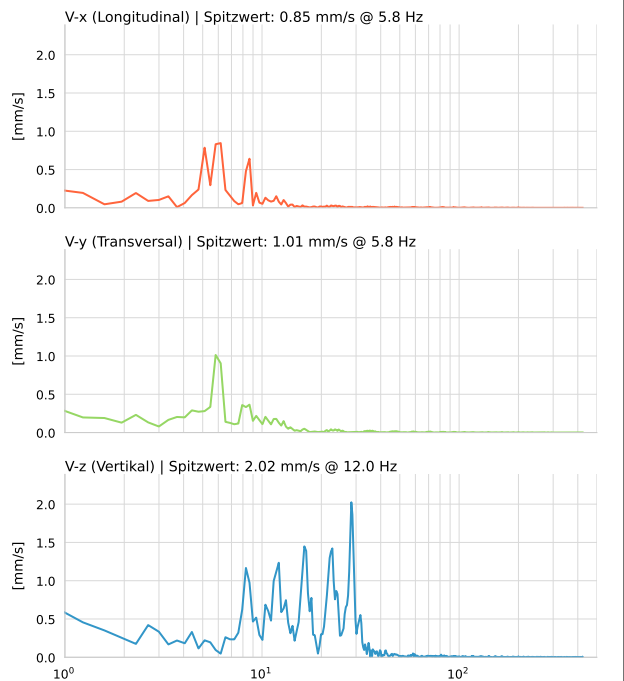

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.8 Hz	5.5 Hz	8.3 Hz	21.3 Hz
Y	5.8 Hz	5.5 Hz	8.3 Hz	23.4 Hz
Z	12.0 Hz	12.9 Hz	22.0 Hz	28.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

