


SCHWINGGESCHWINDIGKEIT



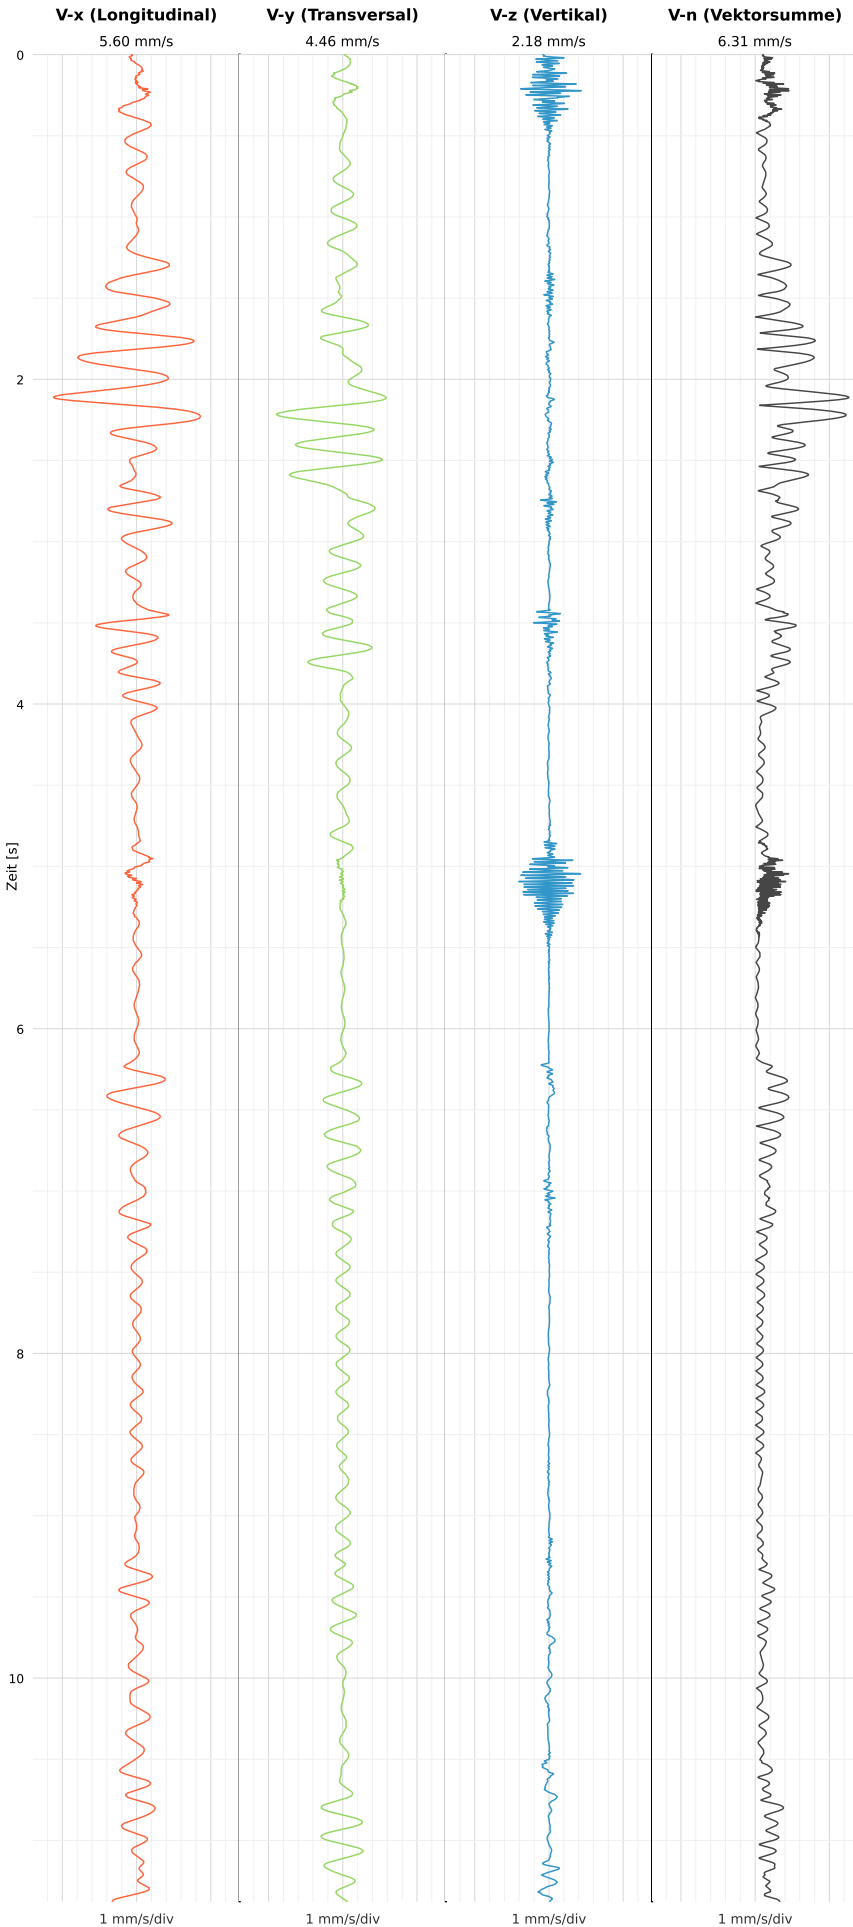


DATEI: 2492-PG8-18052026-122938_raw.csv

Aufzeichnungsdauer: 11.38 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	12:29:38
Event-ID	2492-PG8-18052026-122938
Status	Kritisch
X	5.60 mm/s @ 4.4 Hz
Y	4.46 mm/s @ 4.9 Hz
Z	2.18 mm/s @ 58.4 Hz
Vn	6.31 mm/s @ 4.4 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

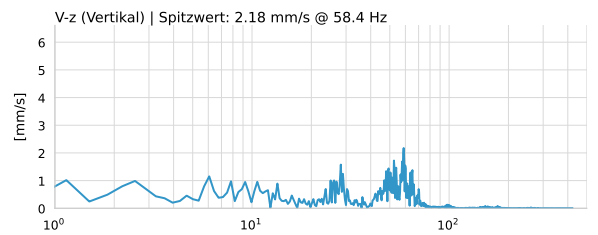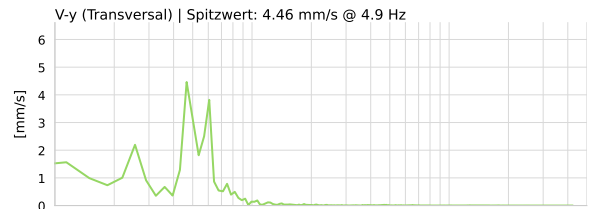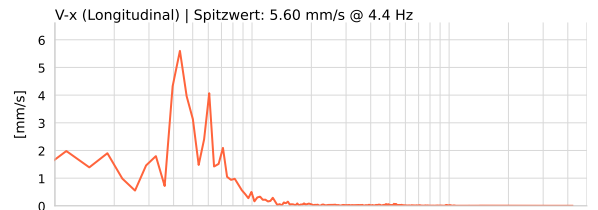

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	4.4 Hz	4.0 Hz	5.4 Hz	7.8 Hz
Y	4.9 Hz	2.9 Hz	5.0 Hz	6.1 Hz
Z	58.4 Hz	25.8 Hz	50.0 Hz	60.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

