


SCHWINGGESCHWINDIGKEIT

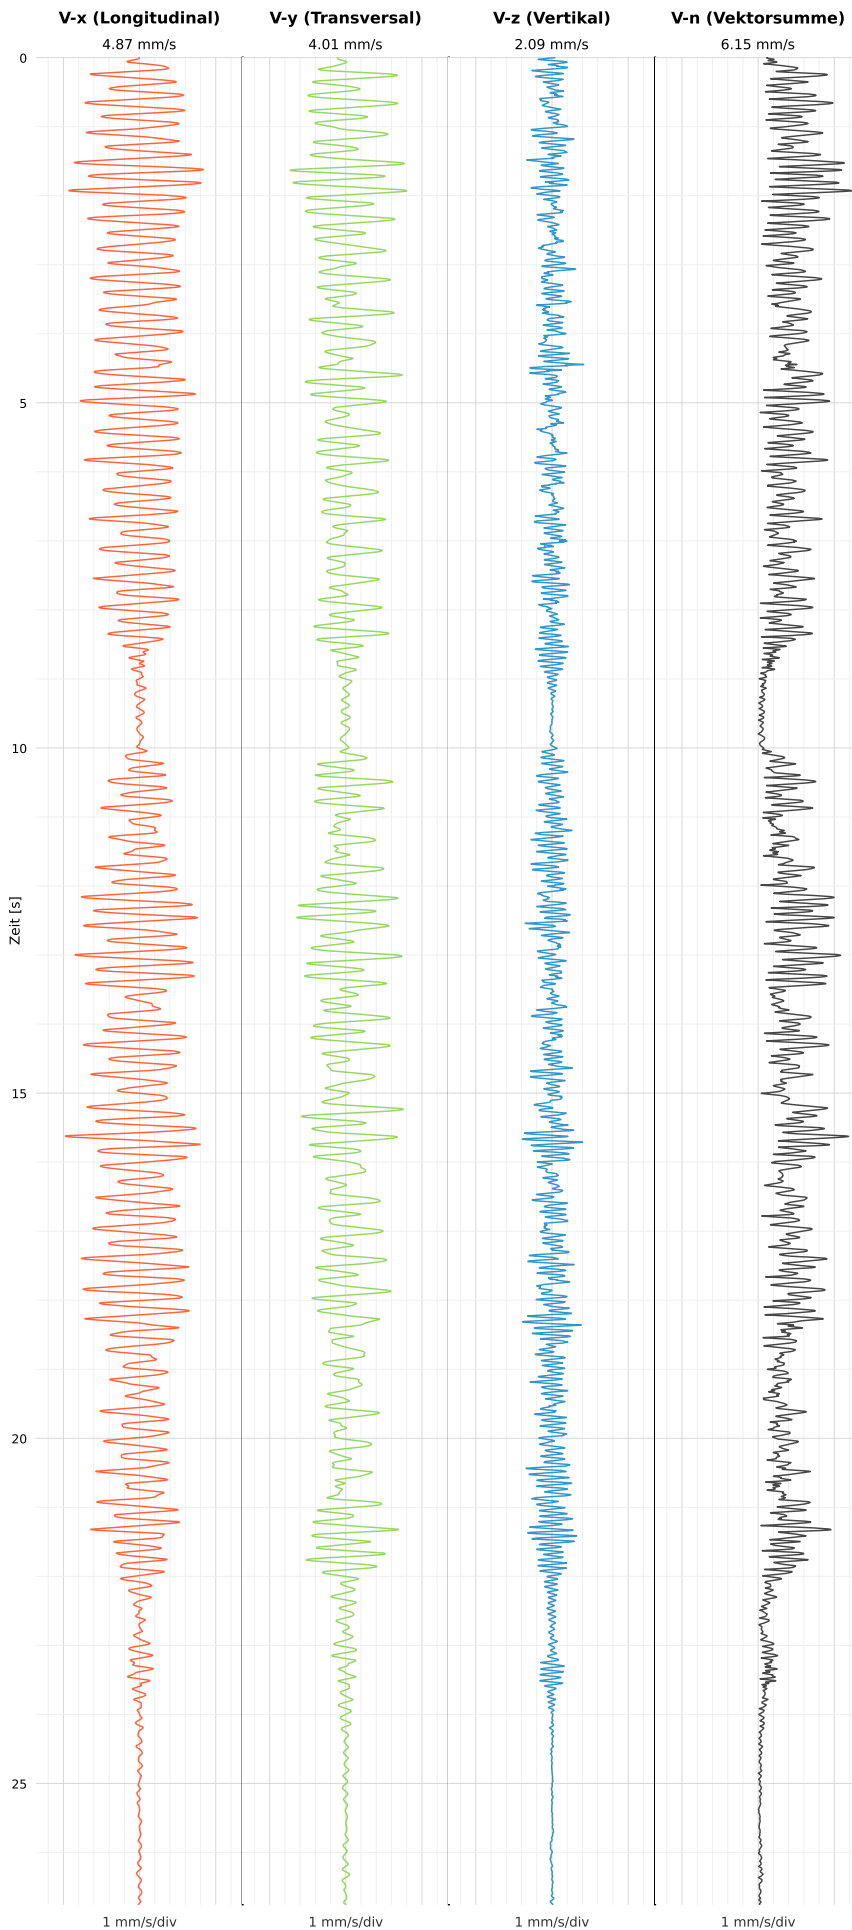


DATEI: 2492-PG8-18052026-145051_raw.csv

Aufzeichnungsdauer: 26.75 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	14:50:51
Event-ID	2492-PG8-18052026-145051
Status	Kritisch
X	4.87 mm/s @ 4.6 Hz
Y	4.01 mm/s @ 4.6 Hz
Z	2.09 mm/s @ 11.3 Hz
Vn	6.15 mm/s @ 4.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

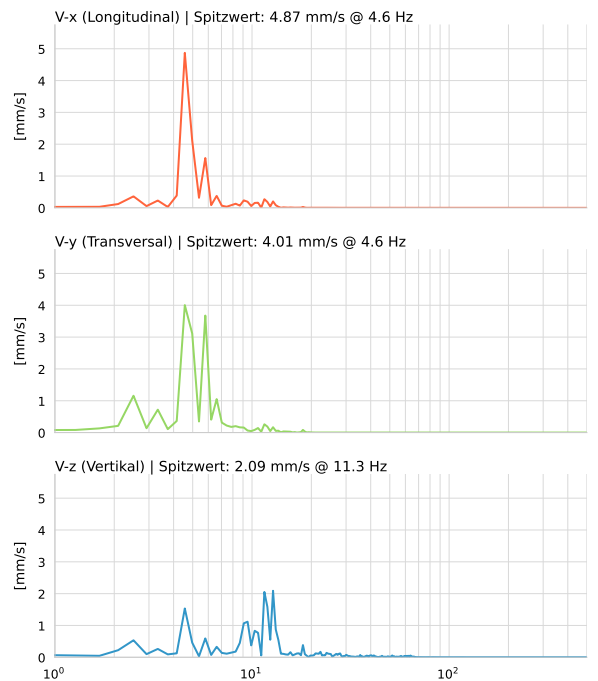

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	4.6 Hz	4.6 Hz	5.0 Hz	5.8 Hz
Y	4.6 Hz	4.6 Hz	5.0 Hz	6.2 Hz
Z	11.3 Hz	9.1 Hz	11.6 Hz	15.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

