


SCHWINGGESCHWINDIGKEIT

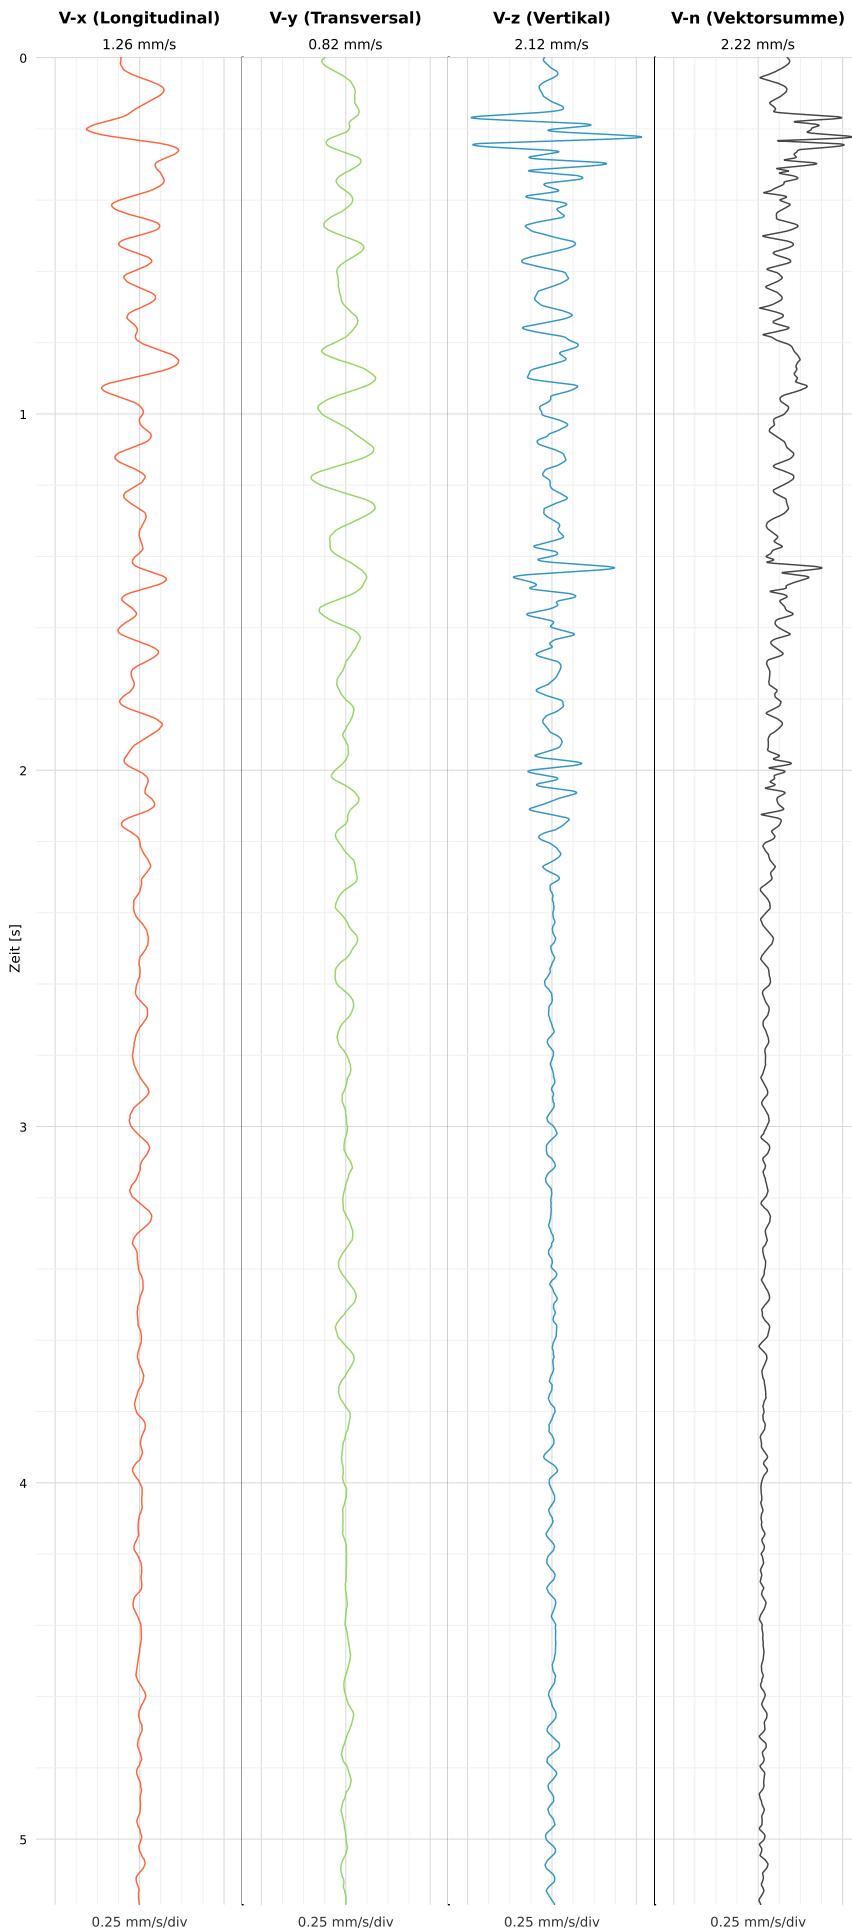


DATEI: 2492-PG8-18052026-163329_raw.csv

Aufzeichnungsdauer: 5.18 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	16:33:29
Event-ID	2492-PG8-18052026-163329
Status	Ereignis
X	1.26 mm/s @ 5.0 Hz
Y	0.82 mm/s @ 5.0 Hz
Z	2.12 mm/s @ 10.0 Hz
Vn	2.22 mm/s @ 10.0 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

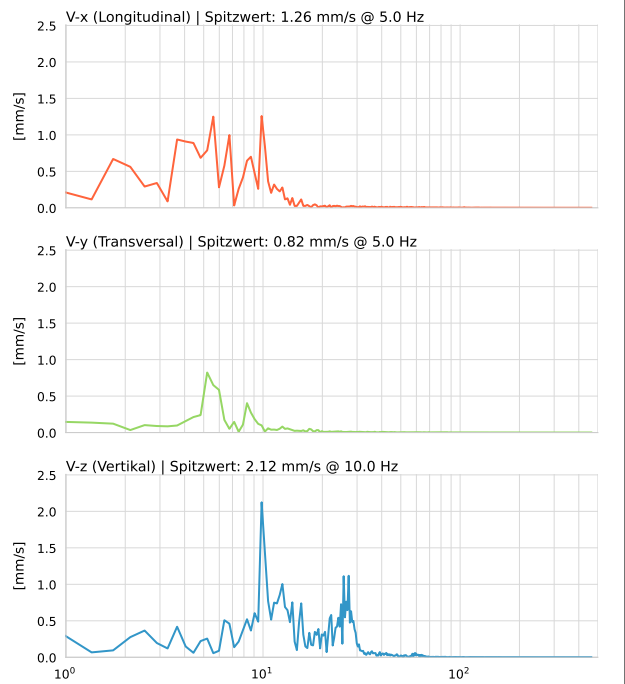

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.0 Hz	4.4 Hz	7.9 Hz	11.8 Hz
Y	5.0 Hz	5.2 Hz	7.9 Hz	19.1 Hz
Z	10.0 Hz	10.2 Hz	17.2 Hz	26.8 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

