


## SCHWINGGESCHWINDIGKEIT

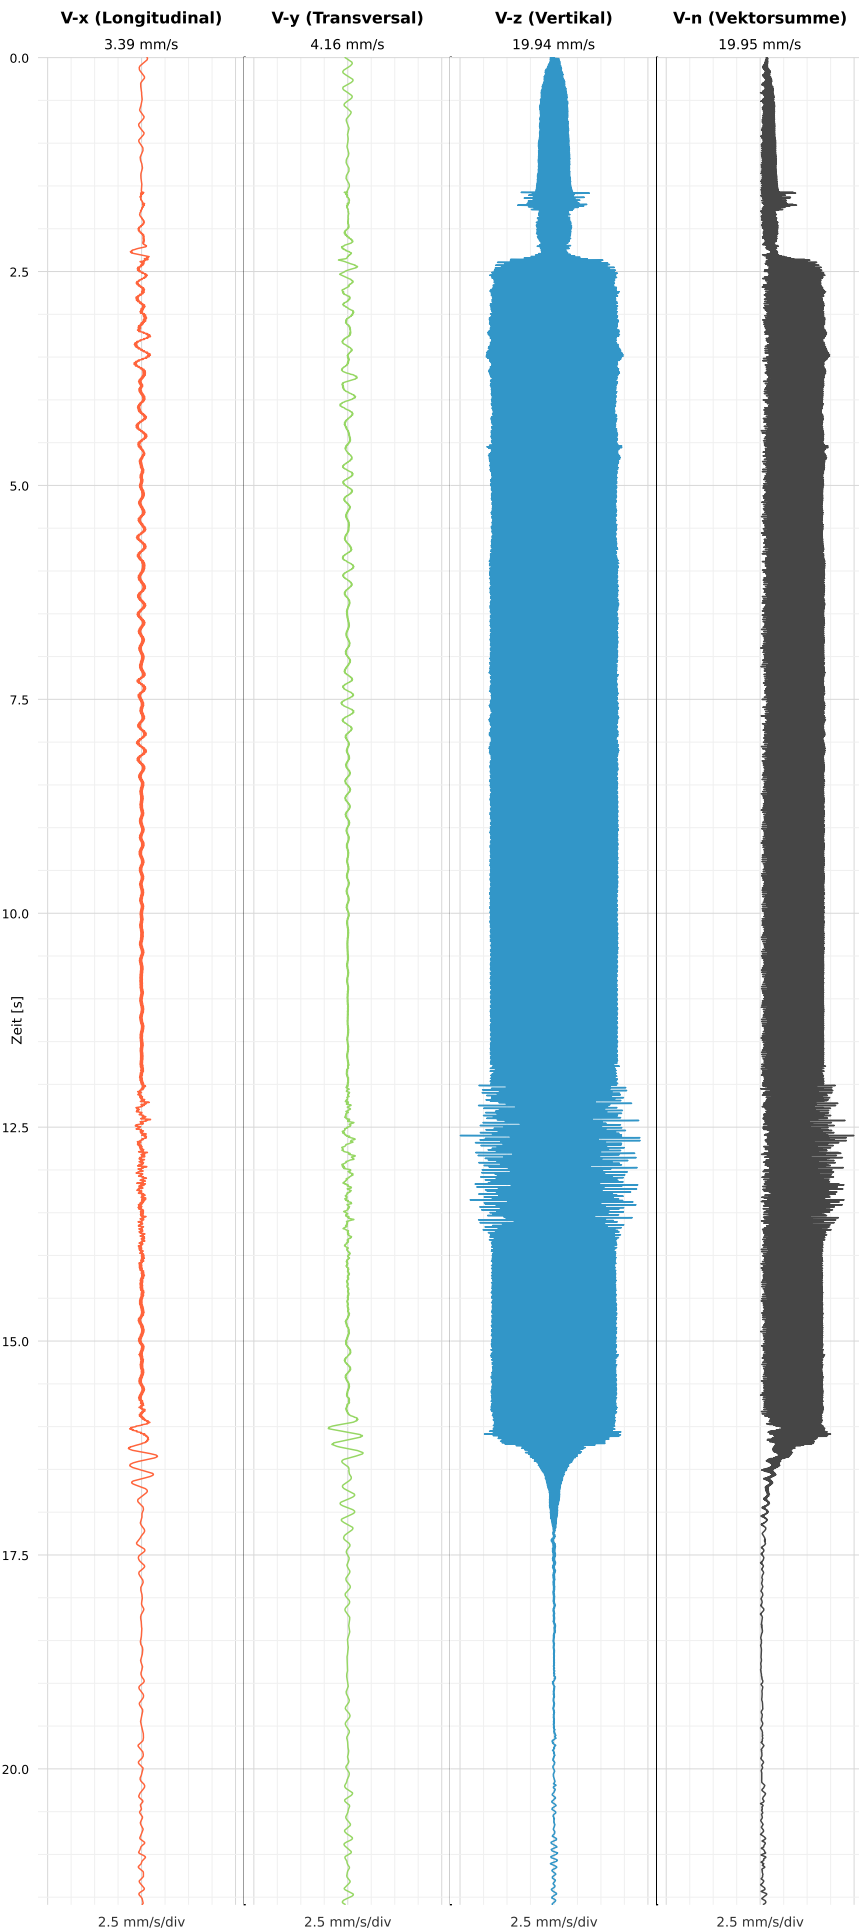


DATEI: 2492-PG8-18052026-185752\_raw.csv

Aufzeichnungsdauer: 21.58 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	18:57:52
Event-ID	2492-PG8-18052026-185752
Status	Kritisch
X	3.39 mm/s @ 59.9 Hz
Y	4.16 mm/s @ 4.6 Hz
Z	19.94 mm/s @ 59.9 Hz
Vn	19.95 mm/s @ 59.9 Hz

### SPEKTRALANALYSE - KOMPONENTEN FFT

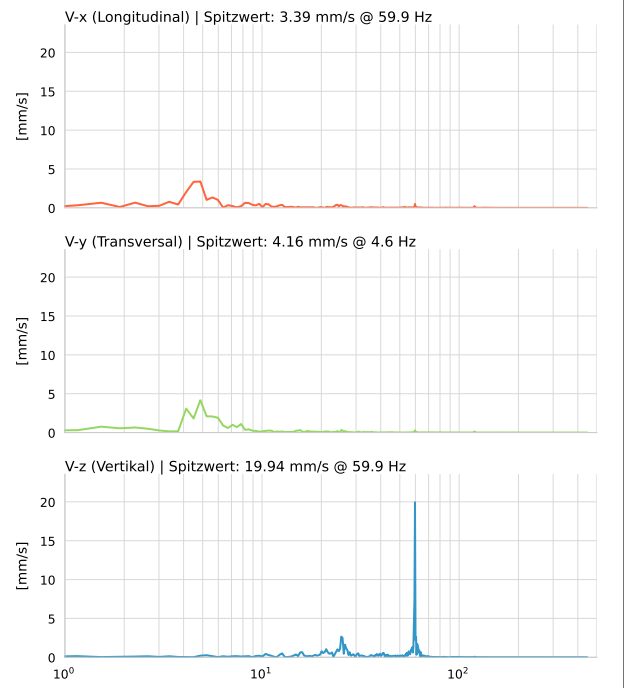

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	59.9 Hz	4.9 Hz	9.7 Hz	47.9 Hz
Y	4.6 Hz	4.9 Hz	6.3 Hz	21.2 Hz
Z	59.9 Hz	26.7 Hz	59.0 Hz	59.7 Hz

### SPEKTRALANALYSE - FFT (DIN 4150-3)

