


## SCHWINGGESCHWINDIGKEIT

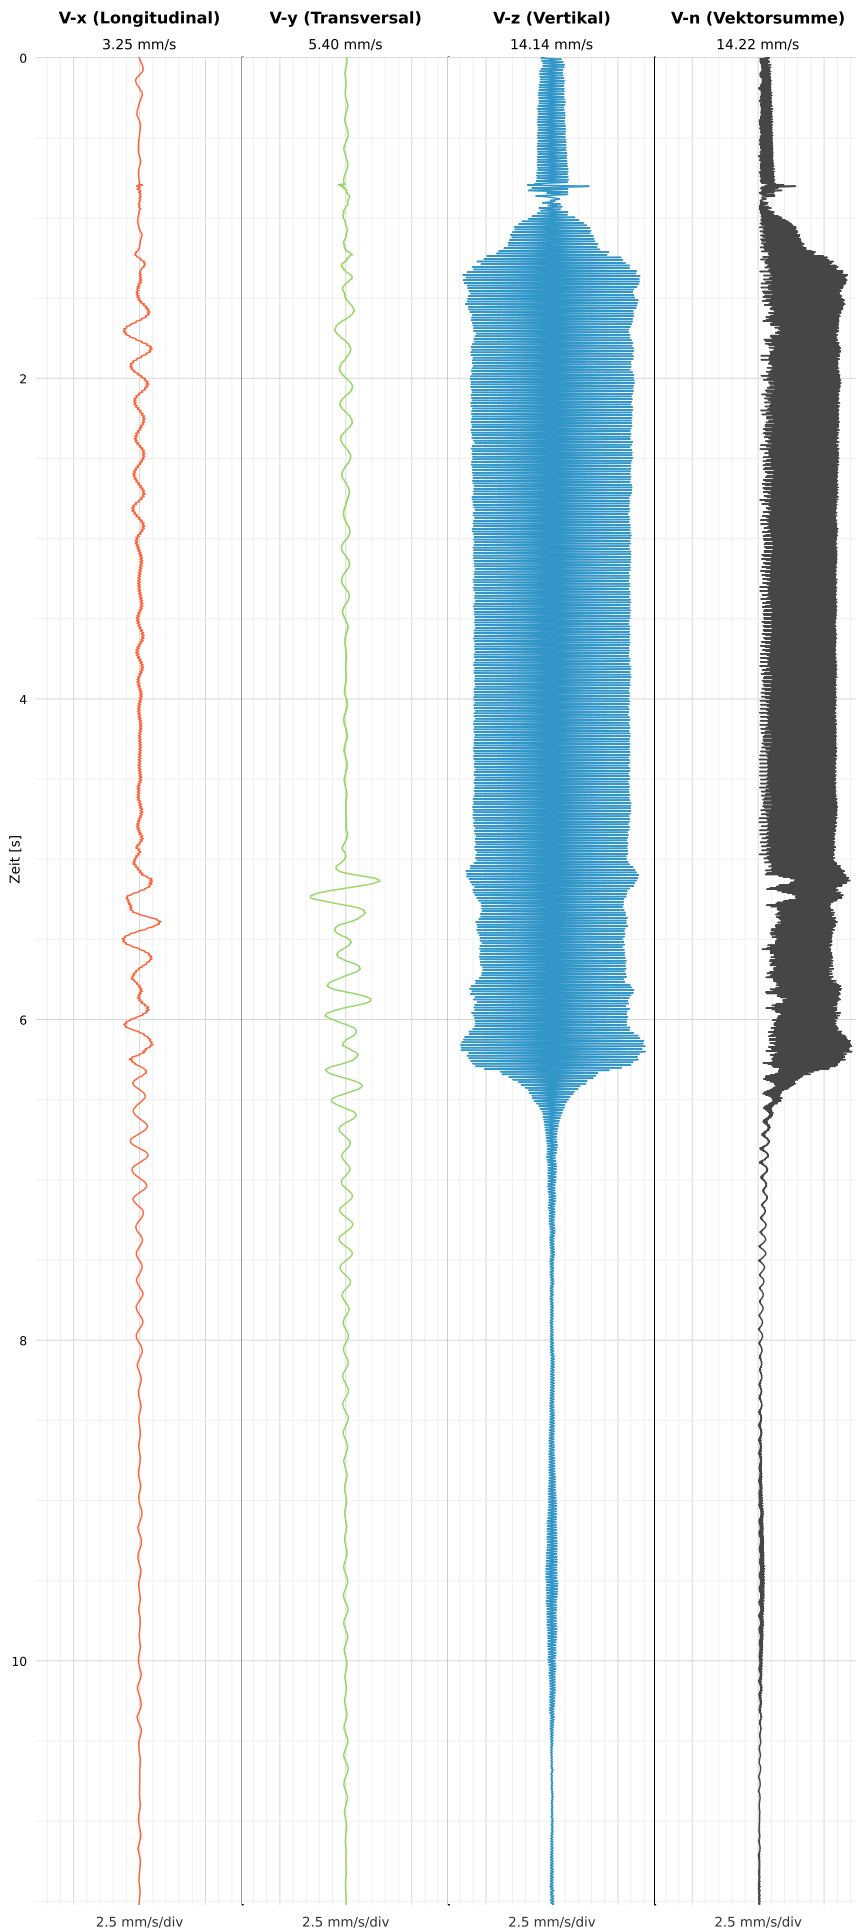


DATEI: 2492-PG8-18052026-191034\_raw.csv

Aufzeichnungsdauer: 11.52 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	19:10:34
Event-ID	2492-PG8-18052026-191034
Status	Kritisch
X	3.25 mm/s @ 5.6 Hz
Y	5.40 mm/s @ 5.6 Hz
Z	14.14 mm/s @ 60.0 Hz
Vn	14.22 mm/s @ 5.6 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

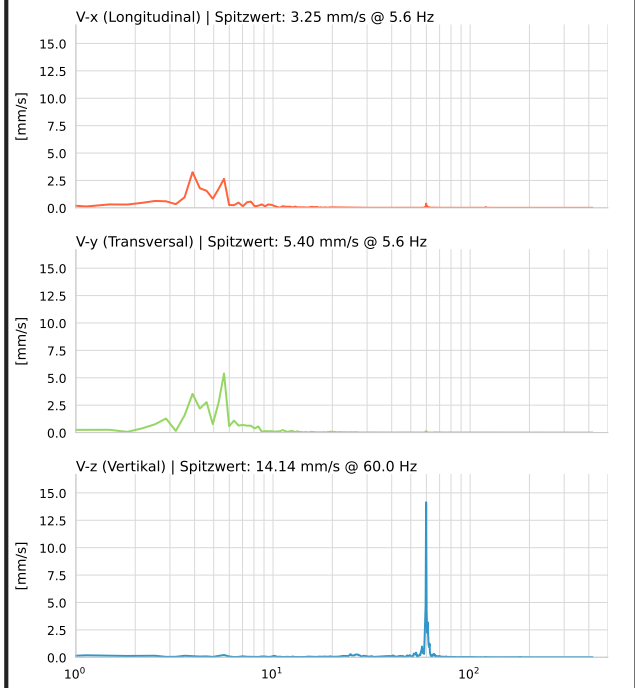

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.6 Hz	3.9 Hz	5.3 Hz	9.8 Hz
Y	5.6 Hz	3.9 Hz	5.6 Hz	7.4 Hz
Z	60.0 Hz	56.7 Hz	59.8 Hz	60.9 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

