


SCHWINGGESCHWINDIGKEIT

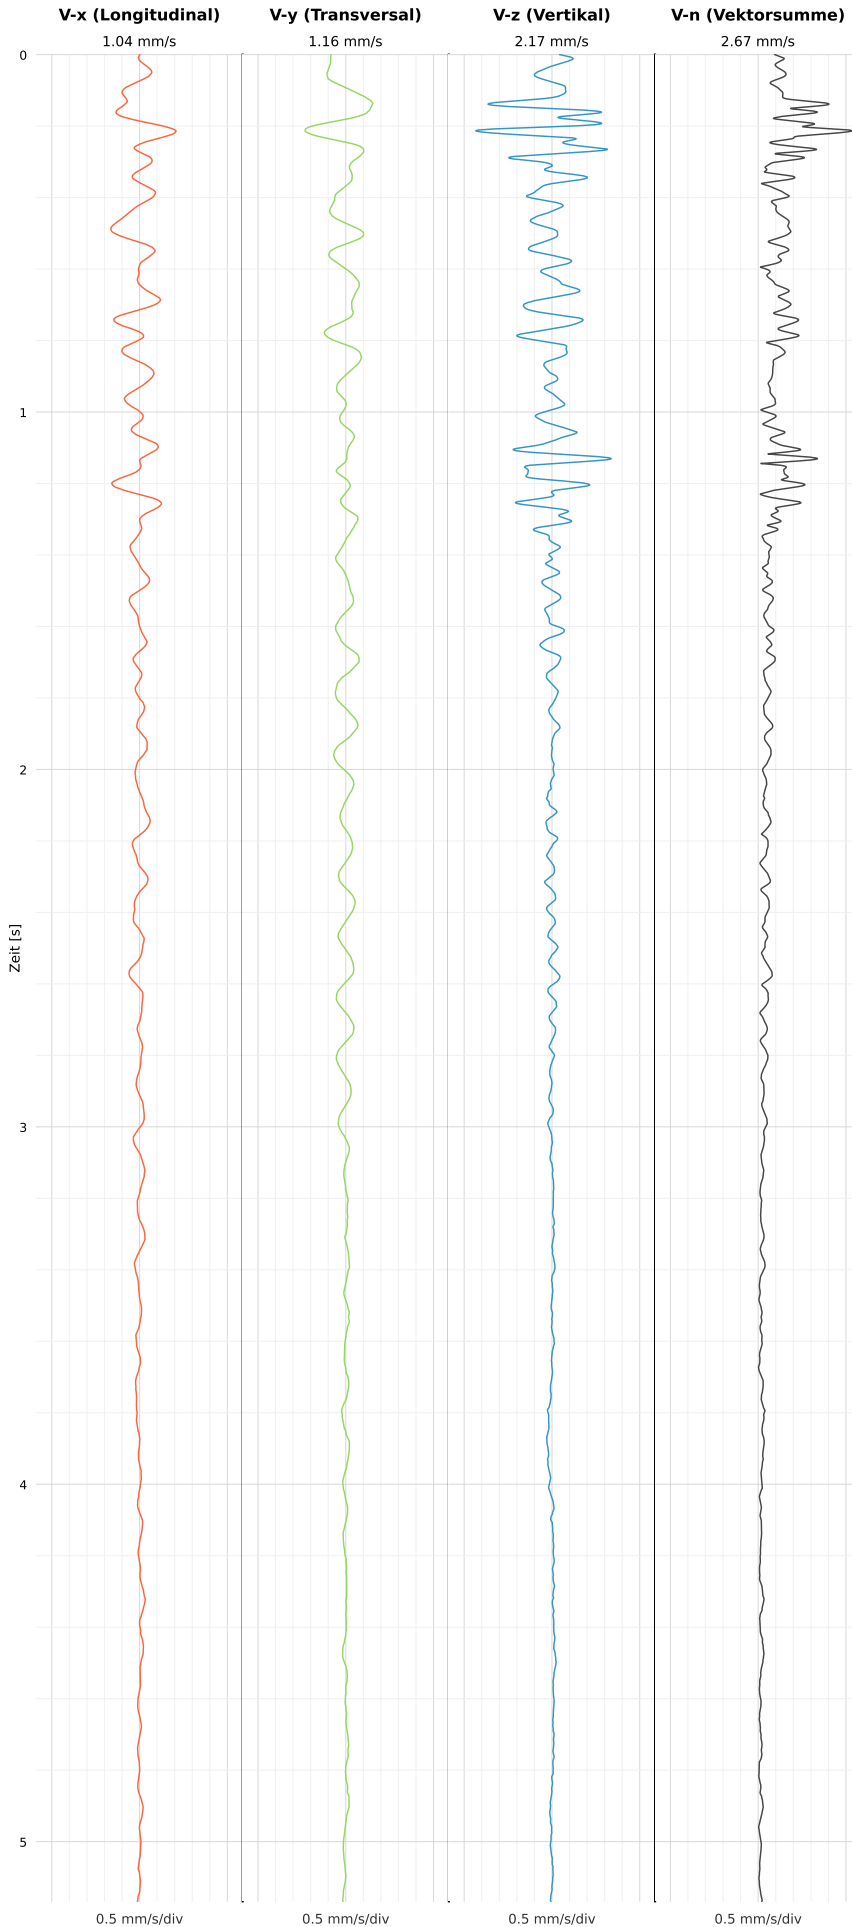


DATEI: 2492-PG8-18052026-191532_raw.csv

Aufzeichnungsdauer: 5.17 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	19:15:32
Event-ID	2492-PG8-18052026-191532
Status	Ereignis
X	1.04 mm/s @ 5.8 Hz
Y	1.16 mm/s @ 5.8 Hz
Z	2.17 mm/s @ 12.6 Hz
Vn	2.67 mm/s @ 12.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

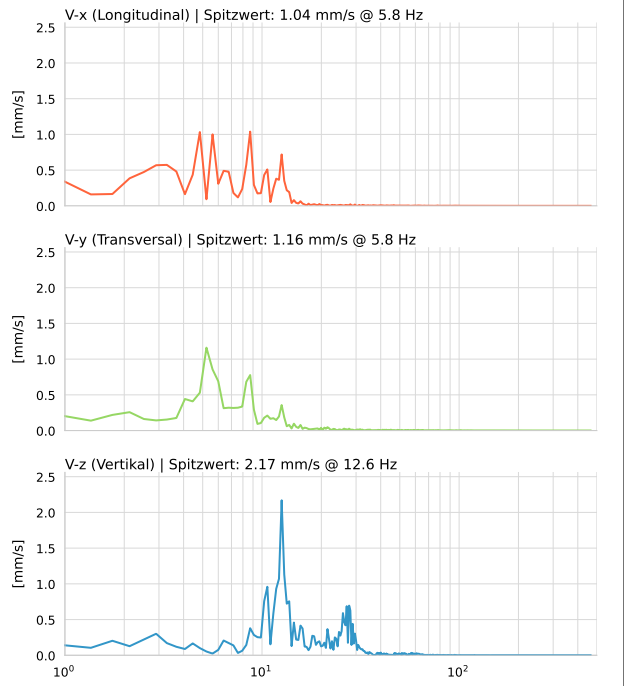

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.8 Hz	4.5 Hz	7.5 Hz	11.4 Hz
Y	5.8 Hz	5.2 Hz	7.9 Hz	12.6 Hz
Z	12.6 Hz	11.8 Hz	14.9 Hz	26.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

