


SCHWINGGESCHWINDIGKEIT

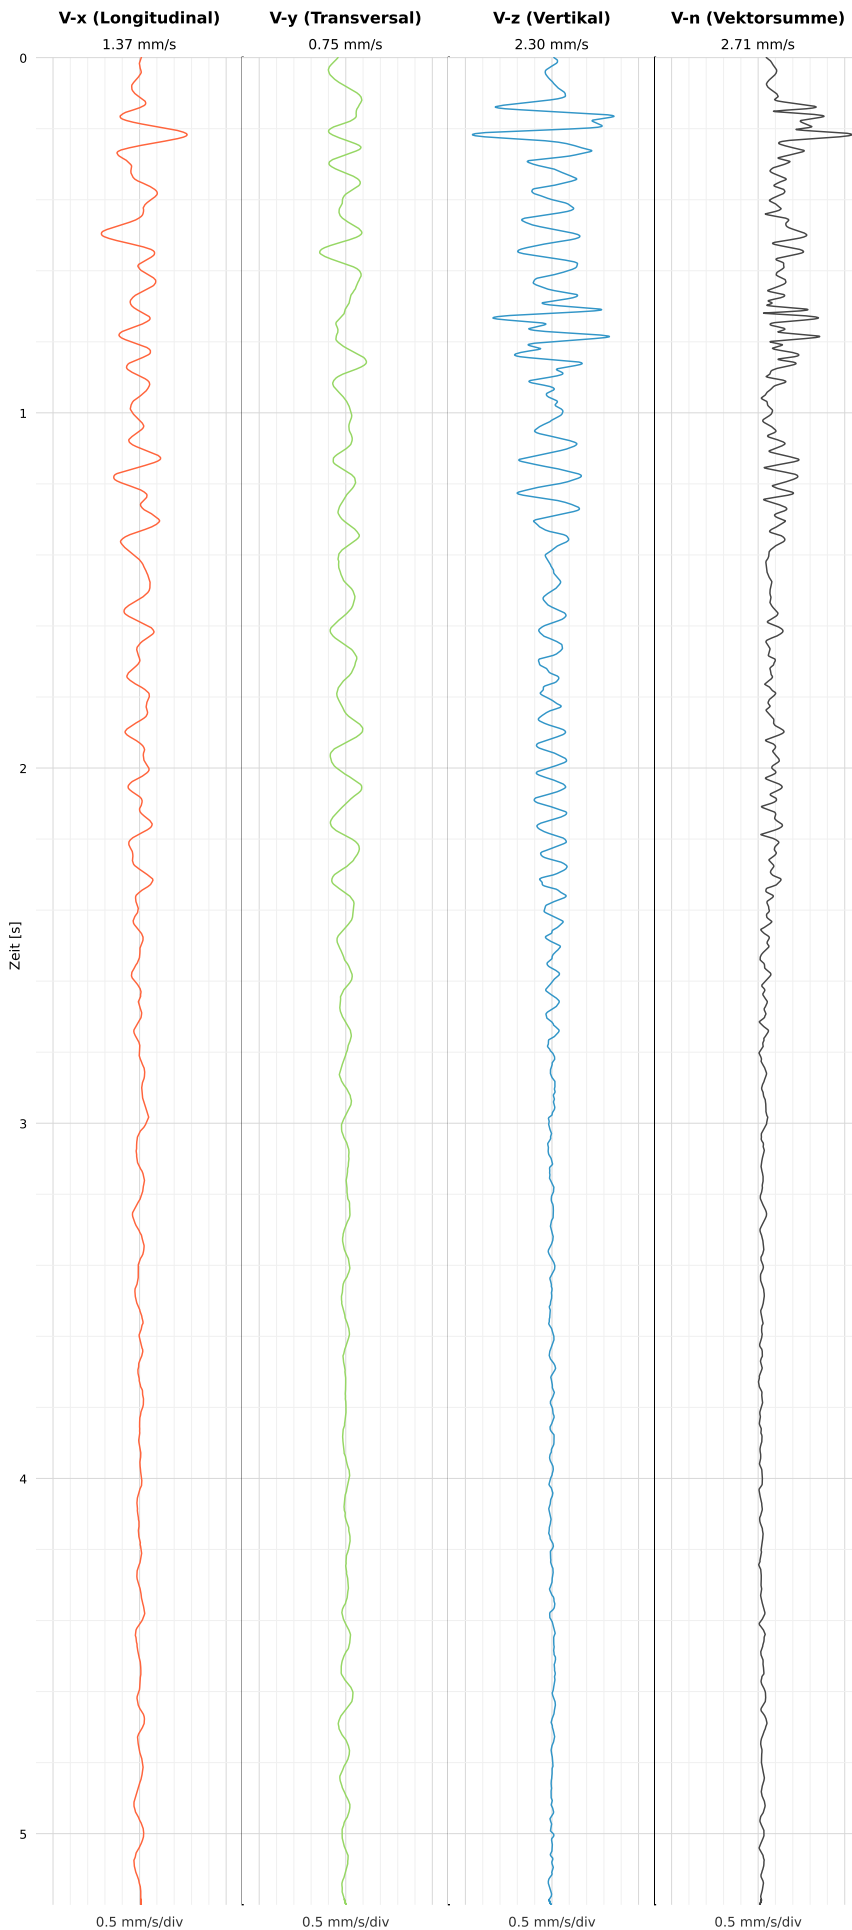


DATEI: 2492-PG8-18052026-191612_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	19:16:12
Event-ID	2492-PG8-18052026-191612
Status	Ereignis
X	1.37 mm/s @ 5.8 Hz
Y	0.75 mm/s @ 5.8 Hz
Z	2.30 mm/s @ 12.9 Hz
Vn	2.71 mm/s @ 12.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

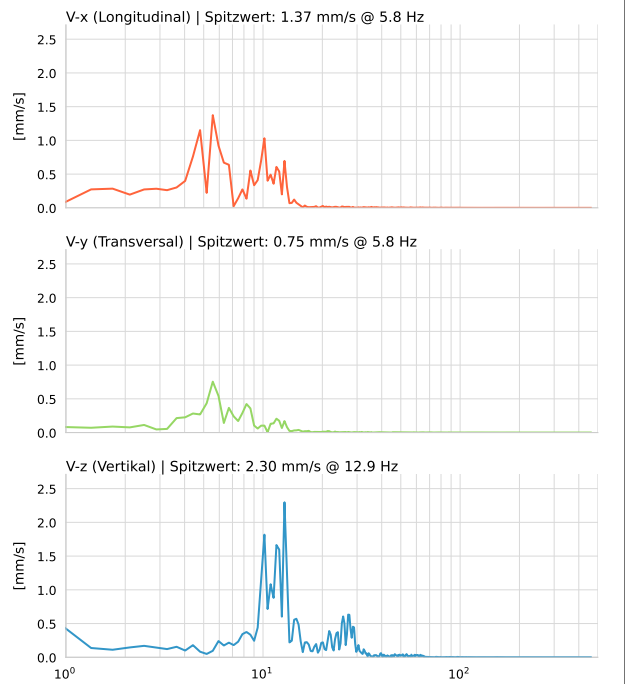

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.8 Hz	4.8 Hz	7.9 Hz	11.3 Hz
Y	5.8 Hz	5.2 Hz	7.1 Hz	11.7 Hz
Z	12.9 Hz	10.5 Hz	13.2 Hz	25.1 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

