


SCHWINGGESCHWINDIGKEIT

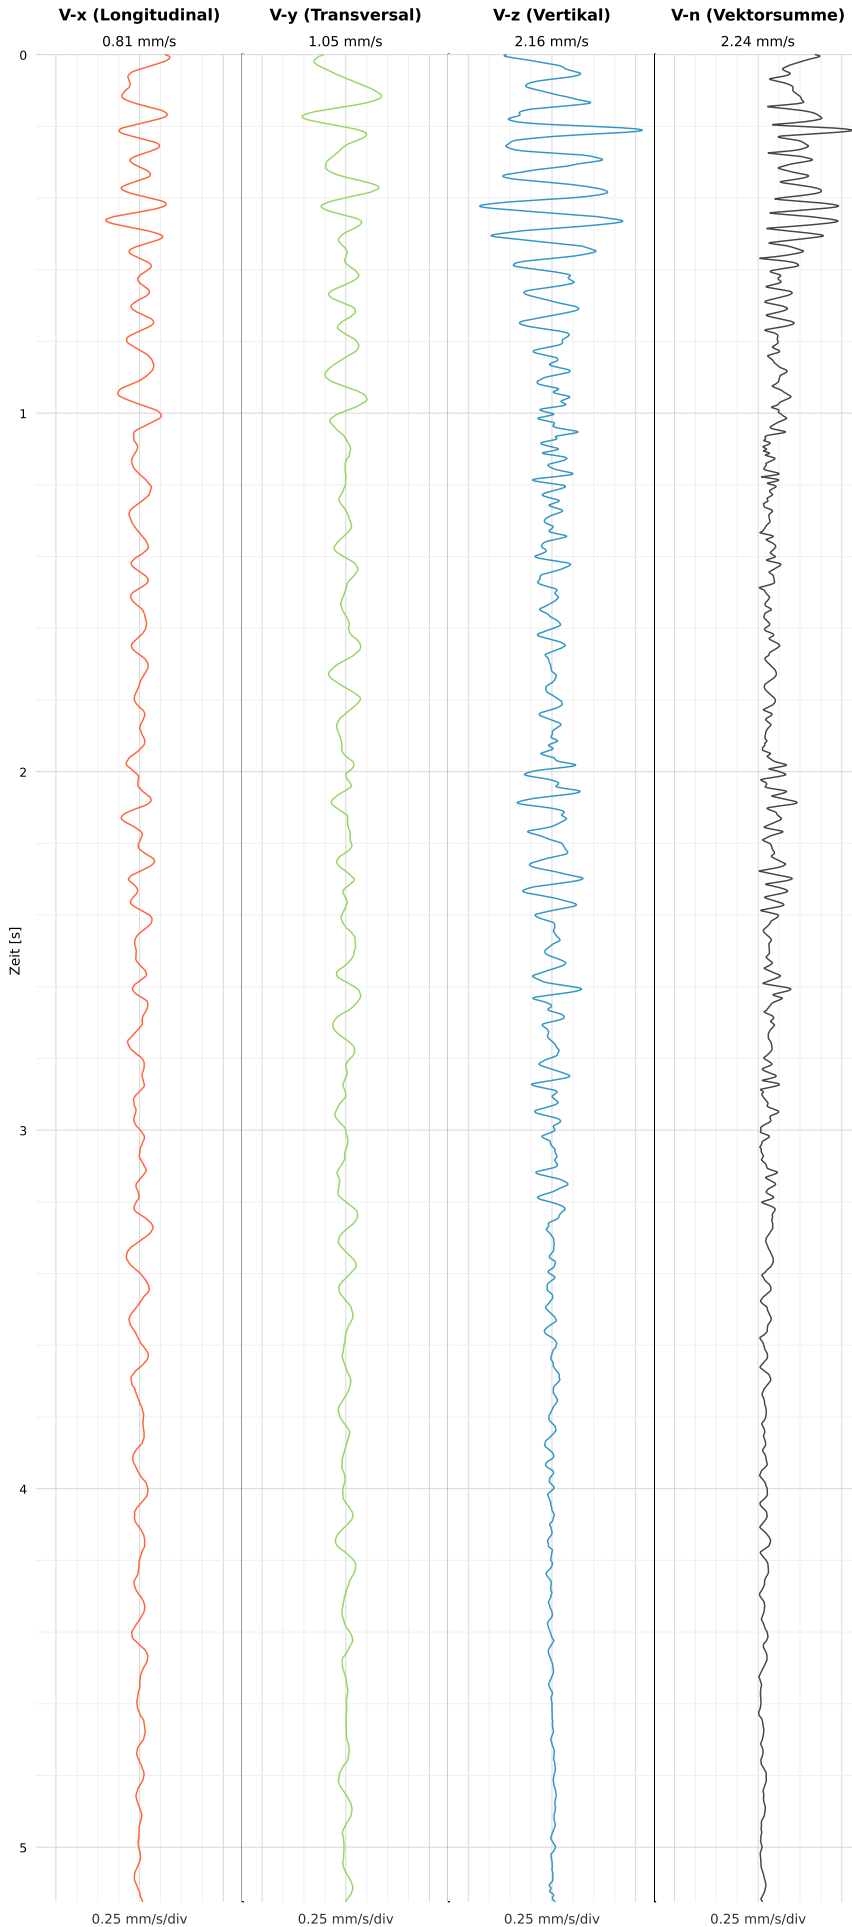


DATEI: 2492-PG8-18052026-211332_raw.csv

Aufzeichnungsdauer: 5.15 s | Abtastrate: 1000 Hz

Datum	18.05.2026
Zeit	21:13:32
Event-ID	2492-PG8-18052026-211332
Status	Ereignis
X	0.81 mm/s @ 5.8 Hz
Y	1.05 mm/s @ 5.8 Hz
Z	2.16 mm/s @ 12.6 Hz
Vn	2.24 mm/s @ 12.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

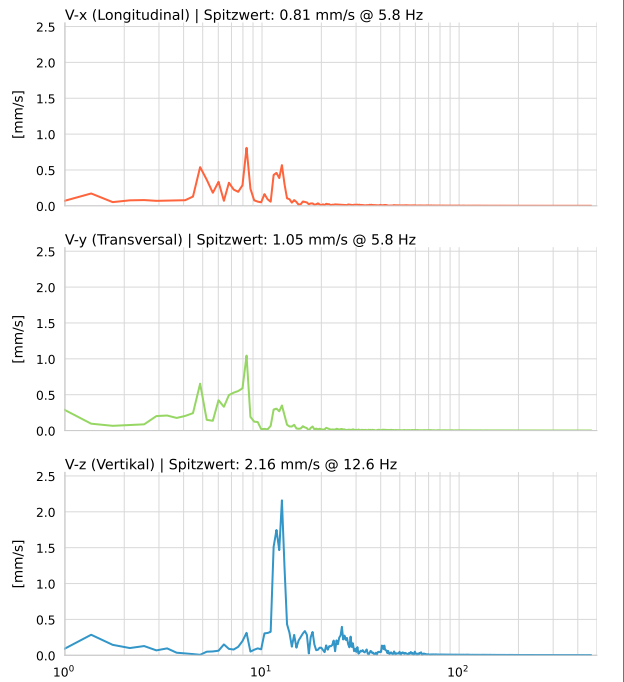

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.8 Hz	6.8 Hz	11.5 Hz	21.2 Hz
Y	5.8 Hz	6.0 Hz	8.3 Hz	15.7 Hz
Z	12.6 Hz	12.2 Hz	16.5 Hz	37.8 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

