


SCHWINGGESCHWINDIGKEIT

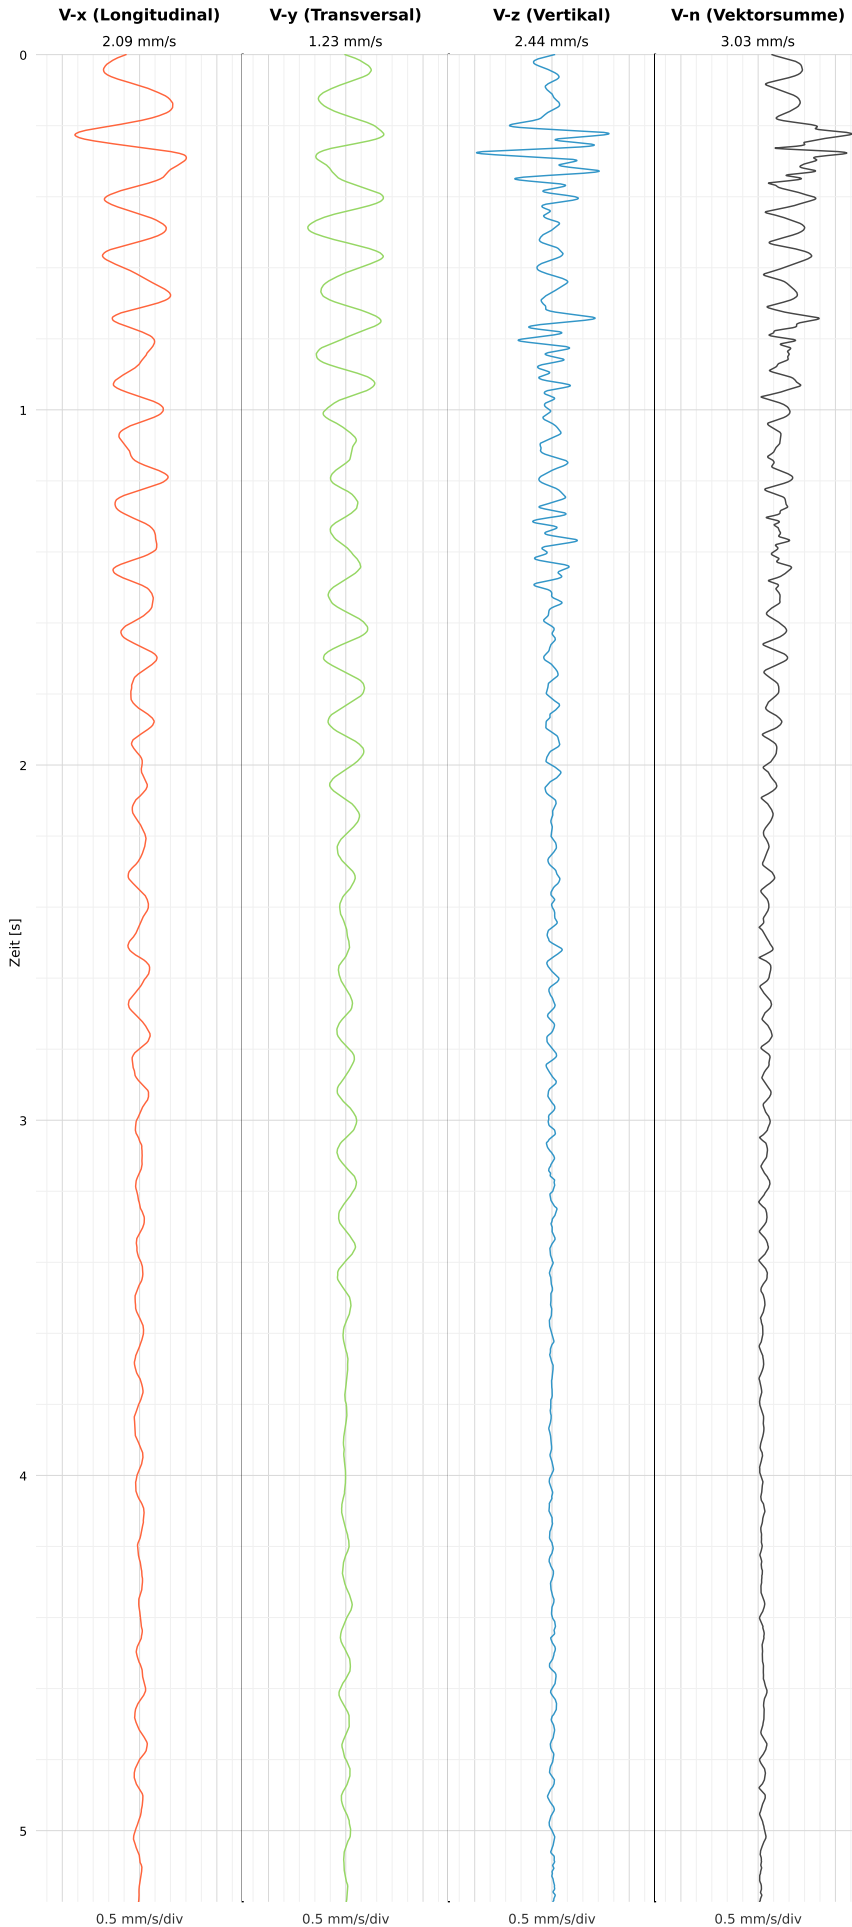


DATEI: 2492-PG8-19052026-104639_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	19.05.2026
Zeit	10:46:39
Event-ID	2492-PG8-19052026-104639
Status	Ereignis
X	2.09 mm/s @ 5.8 Hz
Y	1.23 mm/s @ 5.8 Hz
Z	2.44 mm/s @ 10.2 Hz
Vn	3.03 mm/s @ 10.2 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

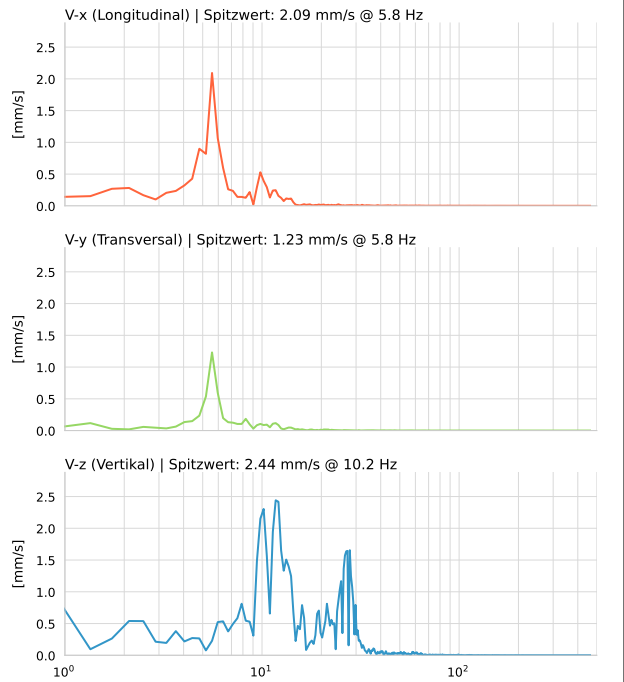

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.8 Hz	5.2 Hz	6.0 Hz	10.6 Hz
Y	5.8 Hz	5.2 Hz	6.0 Hz	9.8 Hz
Z	10.2 Hz	10.6 Hz	15.2 Hz	26.3 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

