


## SCHWINGGESCHWINDIGKEIT

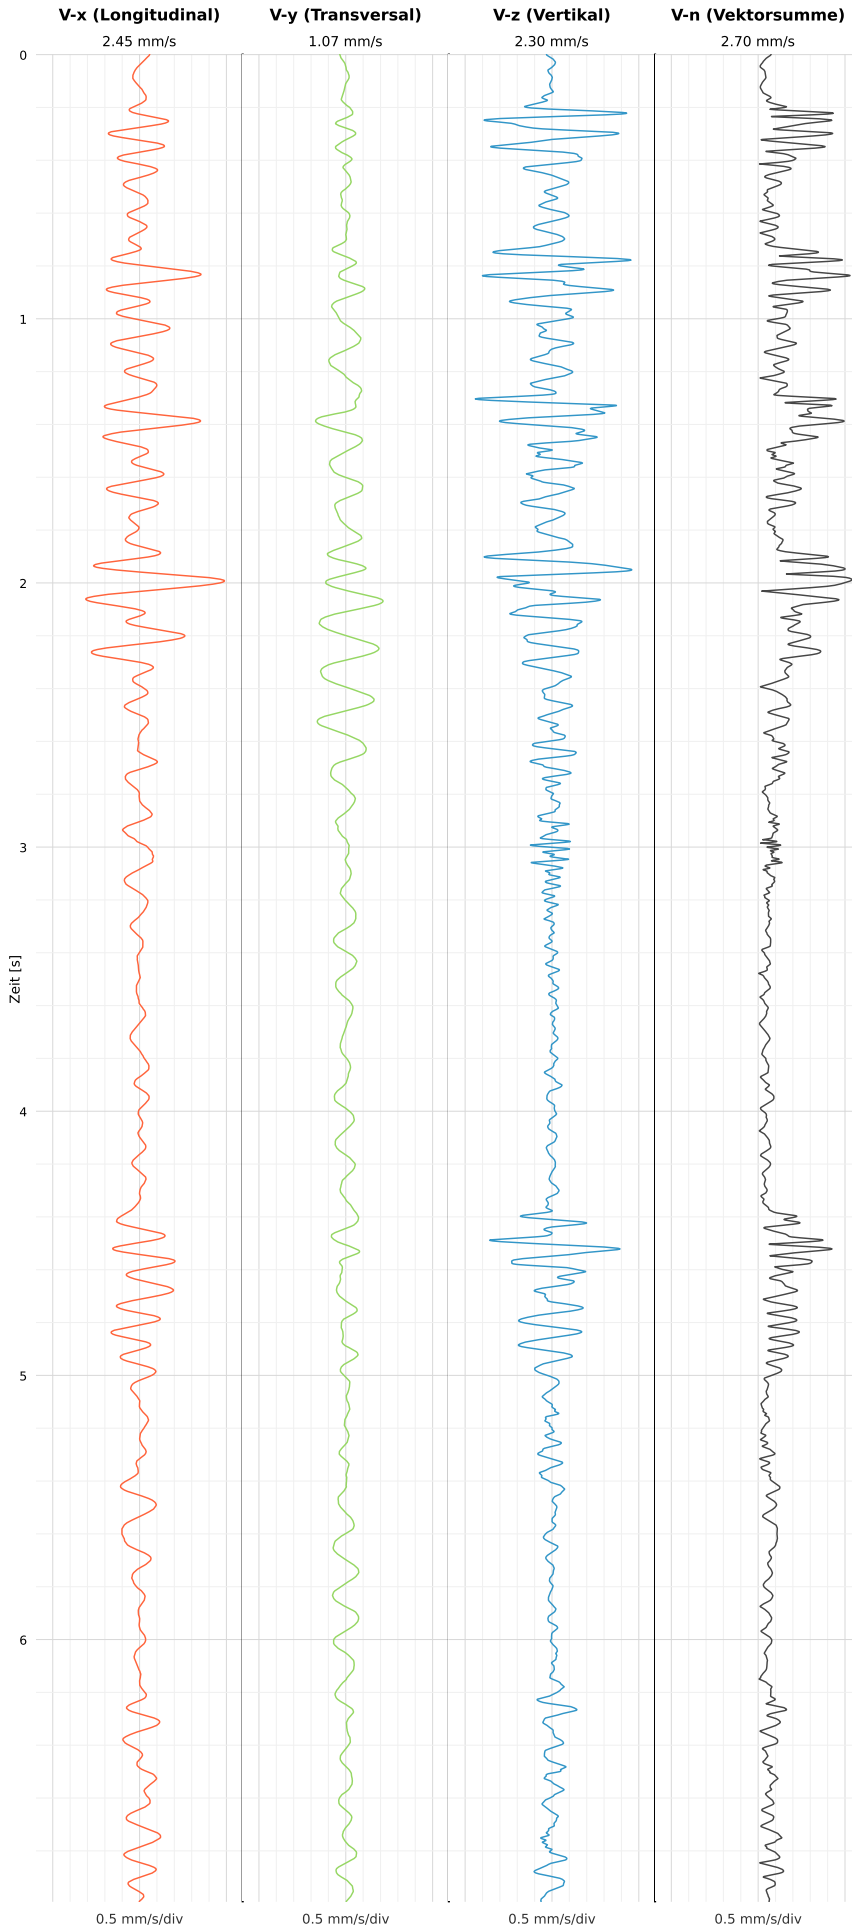


DATEI: 2492-PG8-19052026-121009\_raw.csv

Aufzeichnungsdauer: 6.99 s | Abtastrate: 1000 Hz

Datum	19.05.2026
Zeit	12:10:09
Event-ID	2492-PG8-19052026-121009
Status	Ereignis
X	2.45 mm/s @ 9.7 Hz
Y	1.07 mm/s @ 5.2 Hz
Z	2.30 mm/s @ 9.7 Hz
Vn	2.70 mm/s @ 9.7 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

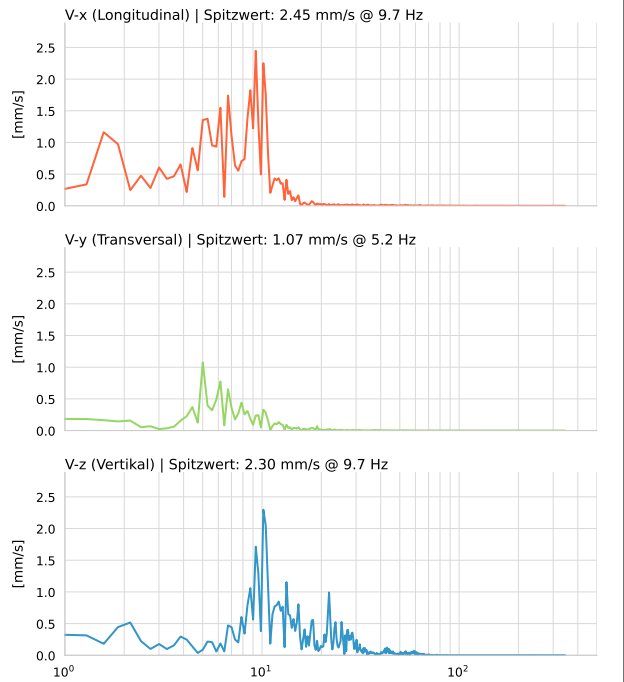

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.7 Hz	5.3 Hz	8.4 Hz	10.2 Hz
Y	5.2 Hz	5.0 Hz	6.7 Hz	10.4 Hz
Z	9.7 Hz	9.6 Hz	13.6 Hz	23.3 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

