


SCHWINGGESCHWINDIGKEIT

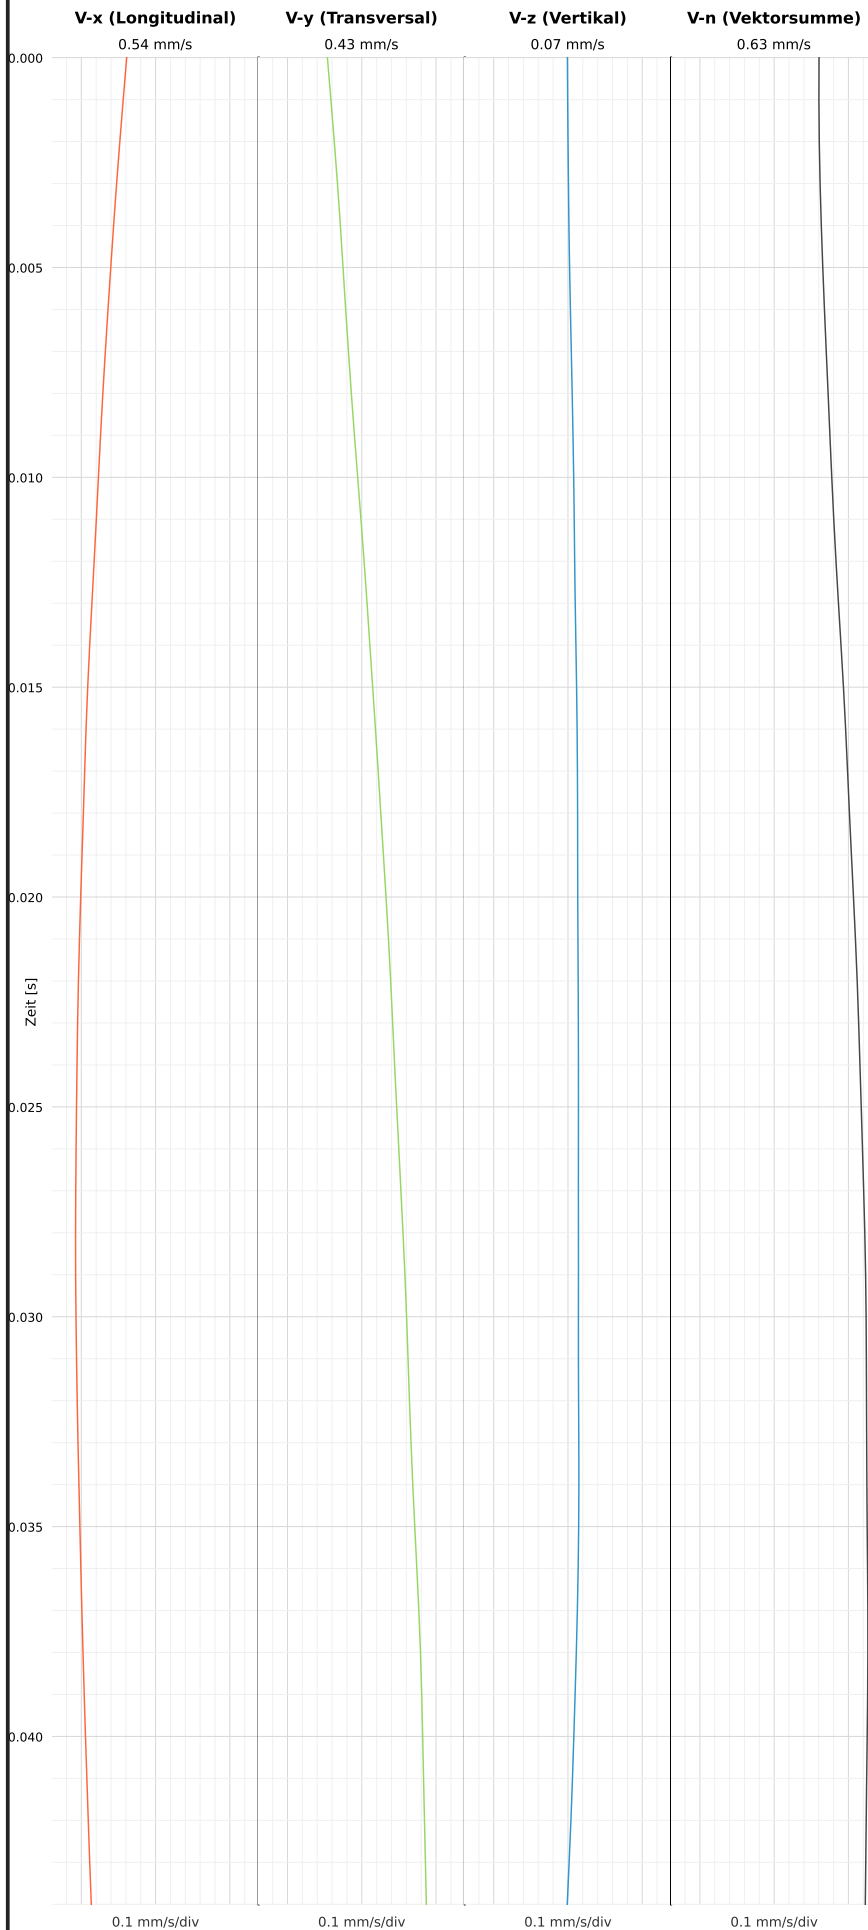


DATEI: 2492-RH6-14052026-202740_raw.csv

Aufzeichnungsdauer: 0.04 s | Abtastrate: 1000 Hz

Datum	14.05.2026
Zeit	20:27:49
Event-ID	2492-RH6-14052026-202740
Status	Normal
X	0.54 mm/s @ 22.2 Hz
Y	0.43 mm/s @ 22.2 Hz
Z	0.07 mm/s @ 22.2 Hz
Vn	0.63 mm/s @ 22.2 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

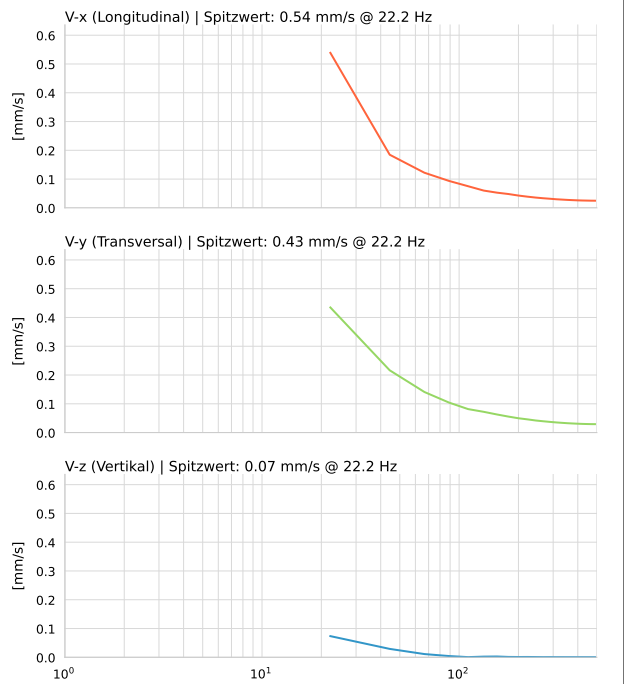

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	22.2 Hz	22.2 Hz	66.7 Hz	200.0 Hz
Y	22.2 Hz	22.2 Hz	88.9 Hz	222.2 Hz
Z	22.2 Hz	22.2 Hz	22.2 Hz	44.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

