


## SCHWINGGESCHWINDIGKEIT

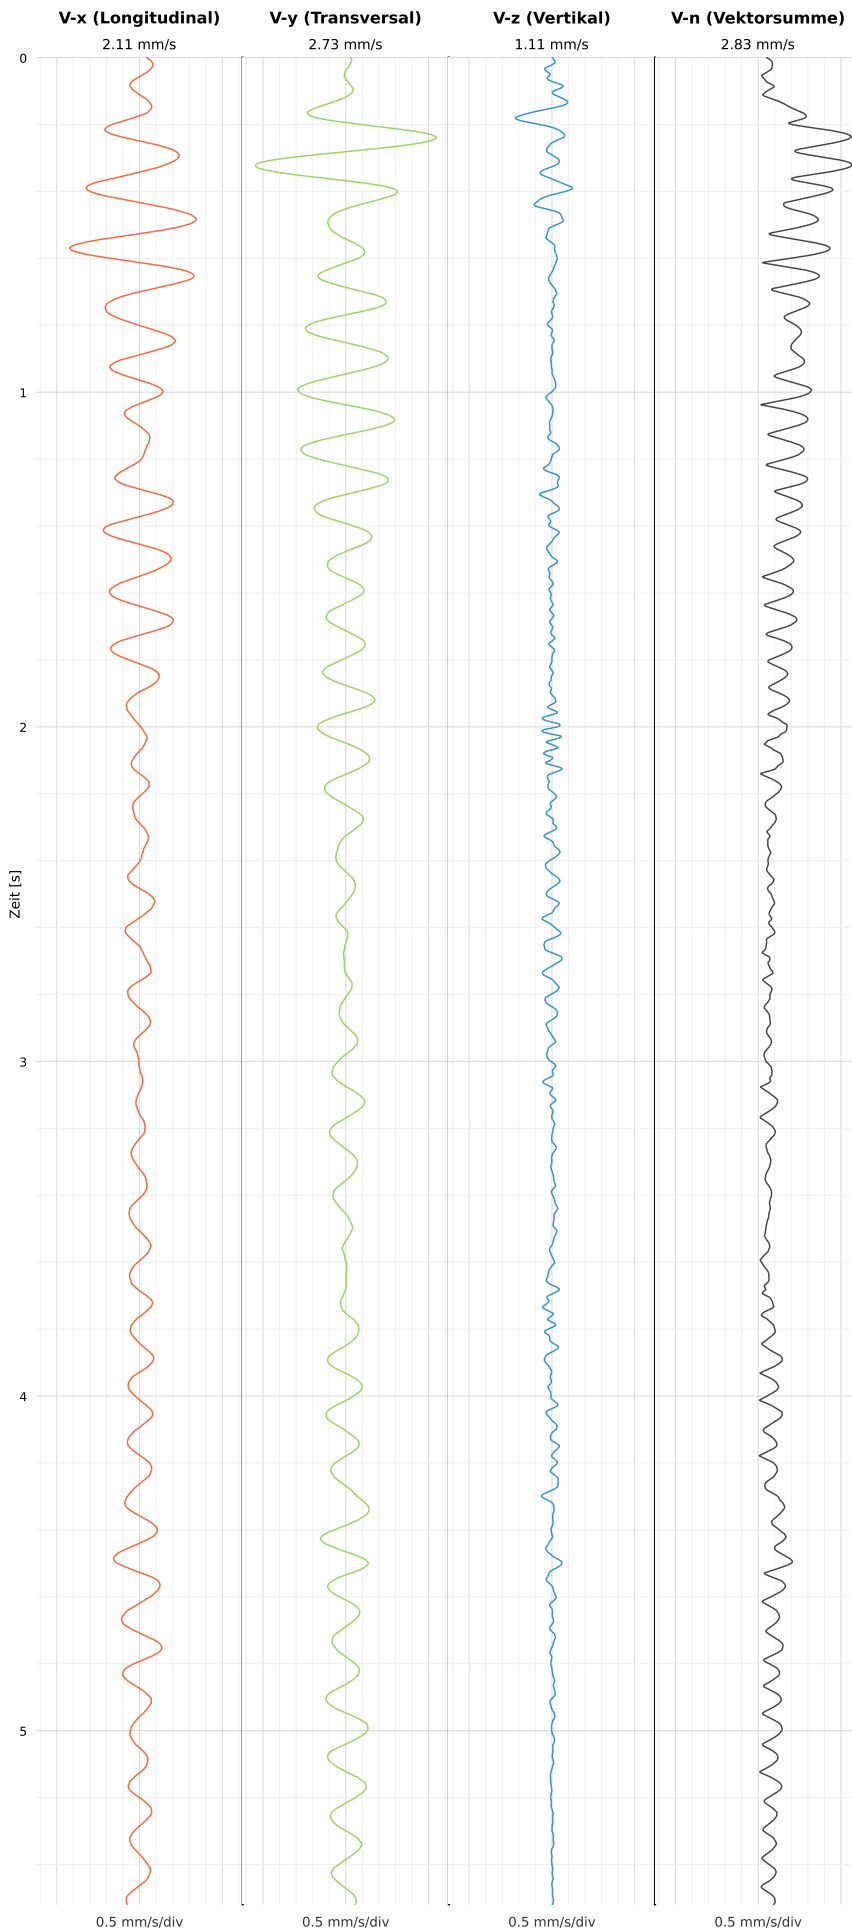


DATEI: 2492-RH6-15052026-120238\_raw.csv

Aufzeichnungsdauer: 5.52 s | Abtastrate: 1000 Hz

Datum	15.05.2026
Zeit	12:02:38
Event-ID	2492-RH6-15052026-120238
Status	Ereignis
X	2.11 mm/s @ 5.8 Hz
Y	2.73 mm/s @ 5.8 Hz
Z	1.11 mm/s @ 12.1 Hz
Vn	2.83 mm/s @ 5.8 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

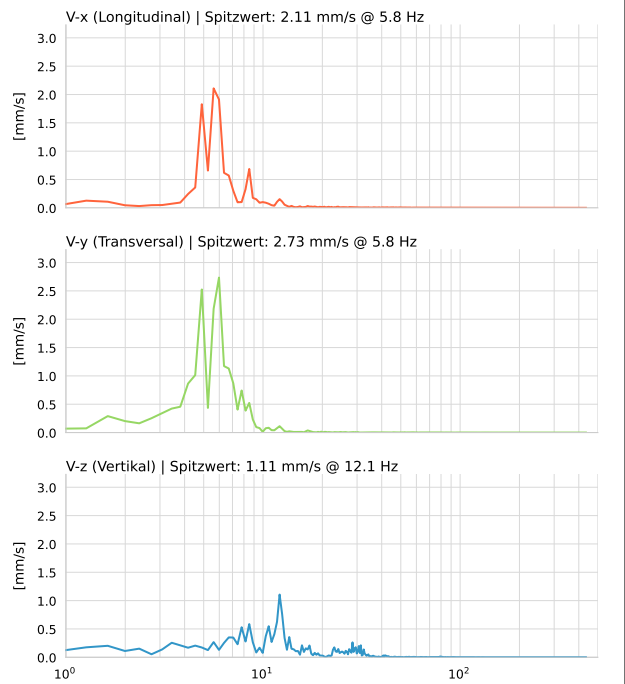

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.8 Hz	5.3 Hz	6.0 Hz	9.2 Hz
Y	5.8 Hz	4.9 Hz	6.0 Hz	7.1 Hz
Z	12.1 Hz	7.8 Hz	12.1 Hz	23.4 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

