


SCHWINGGESCHWINDIGKEIT

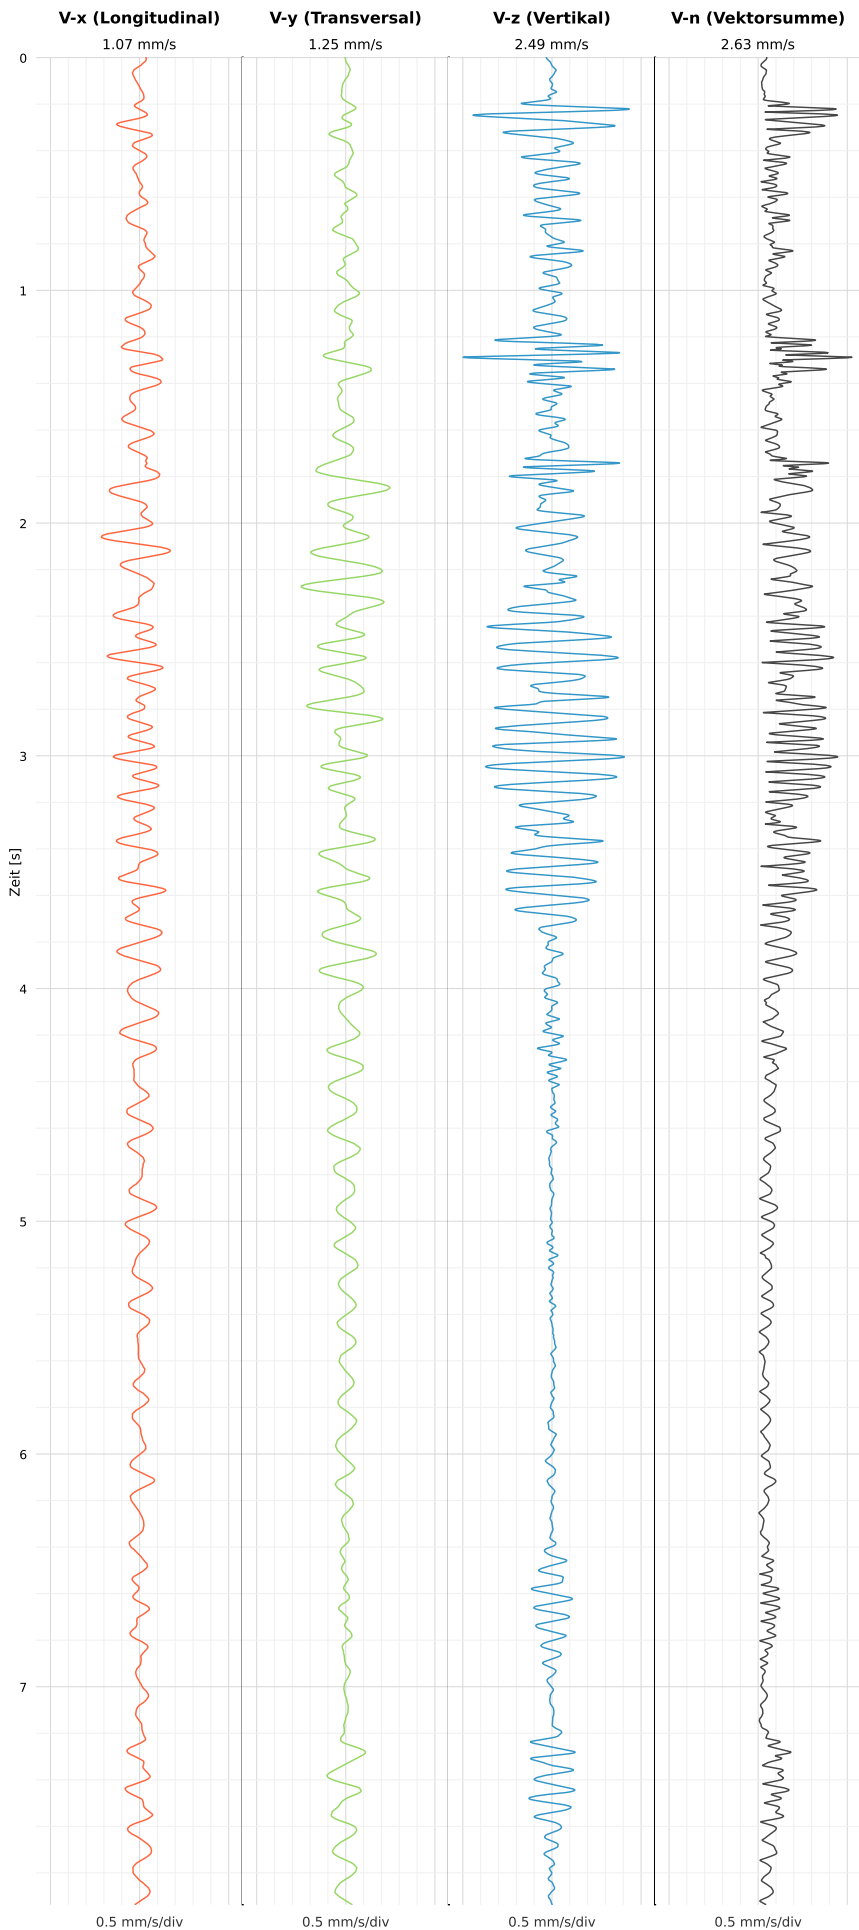


DATEI: 2492-RH6-15052026-124209_raw.csv

Aufzeichnungsdauer: 7.94 s | Abtastrate: 1000 Hz

| | |
|----------|--------------------------|
| Datum | 15.05.2026 |
| Zeit | 12:42:09 |
| Event-ID | 2492-RH6-15052026-124209 |
| Status | Ereignis |
| X | 1.07 mm/s @ 6.0 Hz |
| Y | 1.25 mm/s @ 6.0 Hz |
| Z | 2.49 mm/s @ 11.5 Hz |
| Vn | 2.63 mm/s @ 11.5 Hz |

SPEKTRALANALYSE - KOMPONENTEN FFT

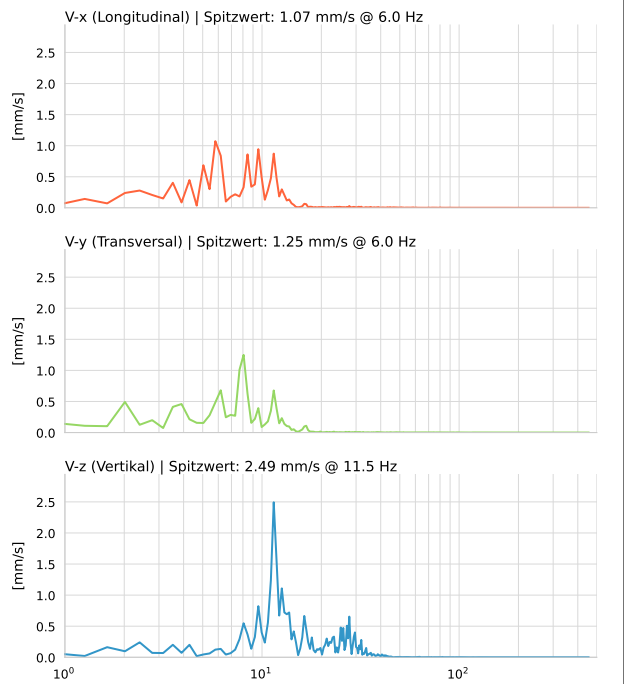

| Kanal | Spitzwert | Spektrum 25% | Spektrum 50% | Spektrum 75% |
|-------|-----------|--------------|--------------|--------------|
| X | 6.0 Hz | 5.8 Hz | 8.8 Hz | 11.5 Hz |
| Y | 6.0 Hz | 5.8 Hz | 8.1 Hz | 11.5 Hz |
| Z | 11.5 Hz | 11.5 Hz | 13.7 Hz | 25.1 Hz |

SPEKTRALANALYSE - FFT (DIN 4150-3)

