


SCHWINGGESCHWINDIGKEIT

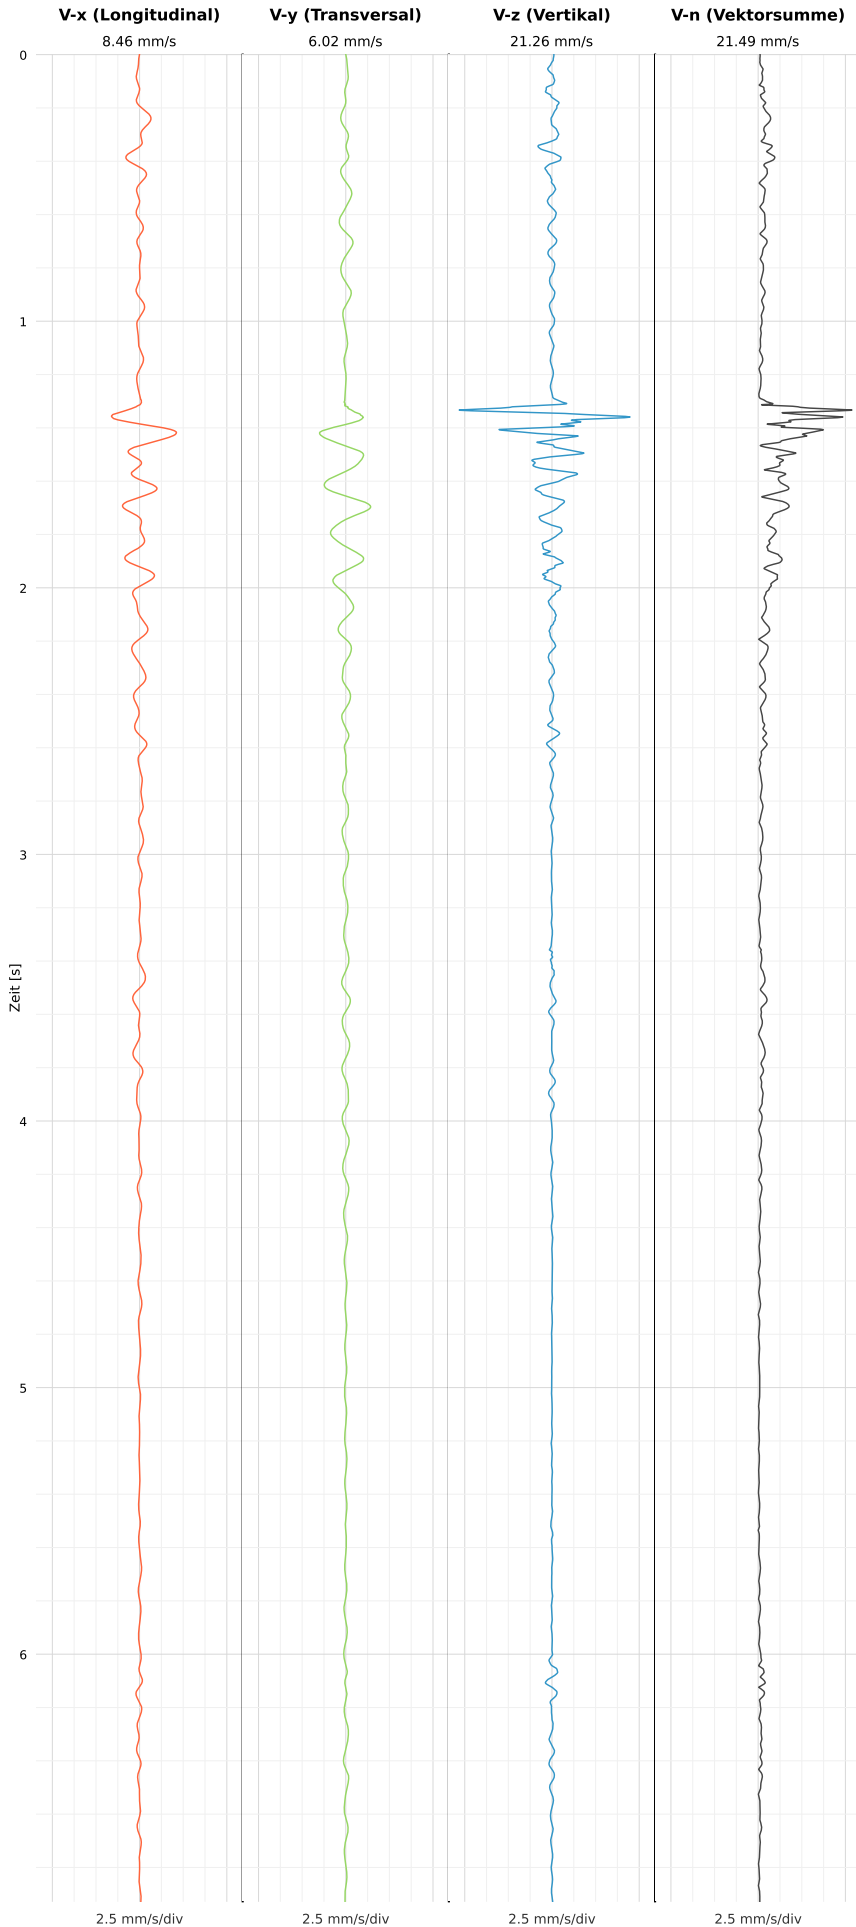


DATEI: 2492-RH6-15052026-140504_raw.csv

Aufzeichnungsdauer: 6.93 s | Abtastrate: 1000 Hz

Datum	15.05.2026
Zeit	14:05:04
Event-ID	2492-RH6-15052026-140504
Status	Kritisch
X	8.46 mm/s @ 5.9 Hz
Y	6.02 mm/s @ 5.5 Hz
Z	21.26 mm/s @ 9.7 Hz
Vn	21.49 mm/s @ 9.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

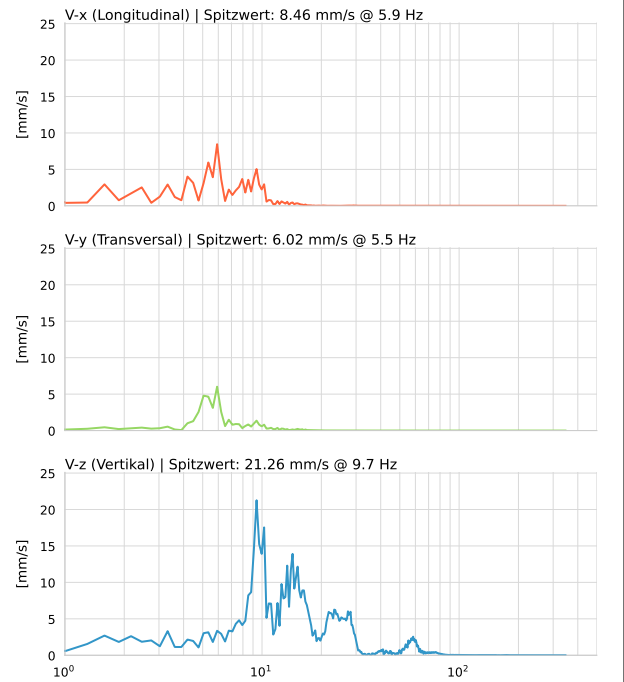

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.9 Hz	4.5 Hz	6.2 Hz	9.4 Hz
Y	5.5 Hz	5.1 Hz	5.9 Hz	8.8 Hz
Z	9.7 Hz	10.5 Hz	16.3 Hz	27.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

