


SCHWINGGESCHWINDIGKEIT

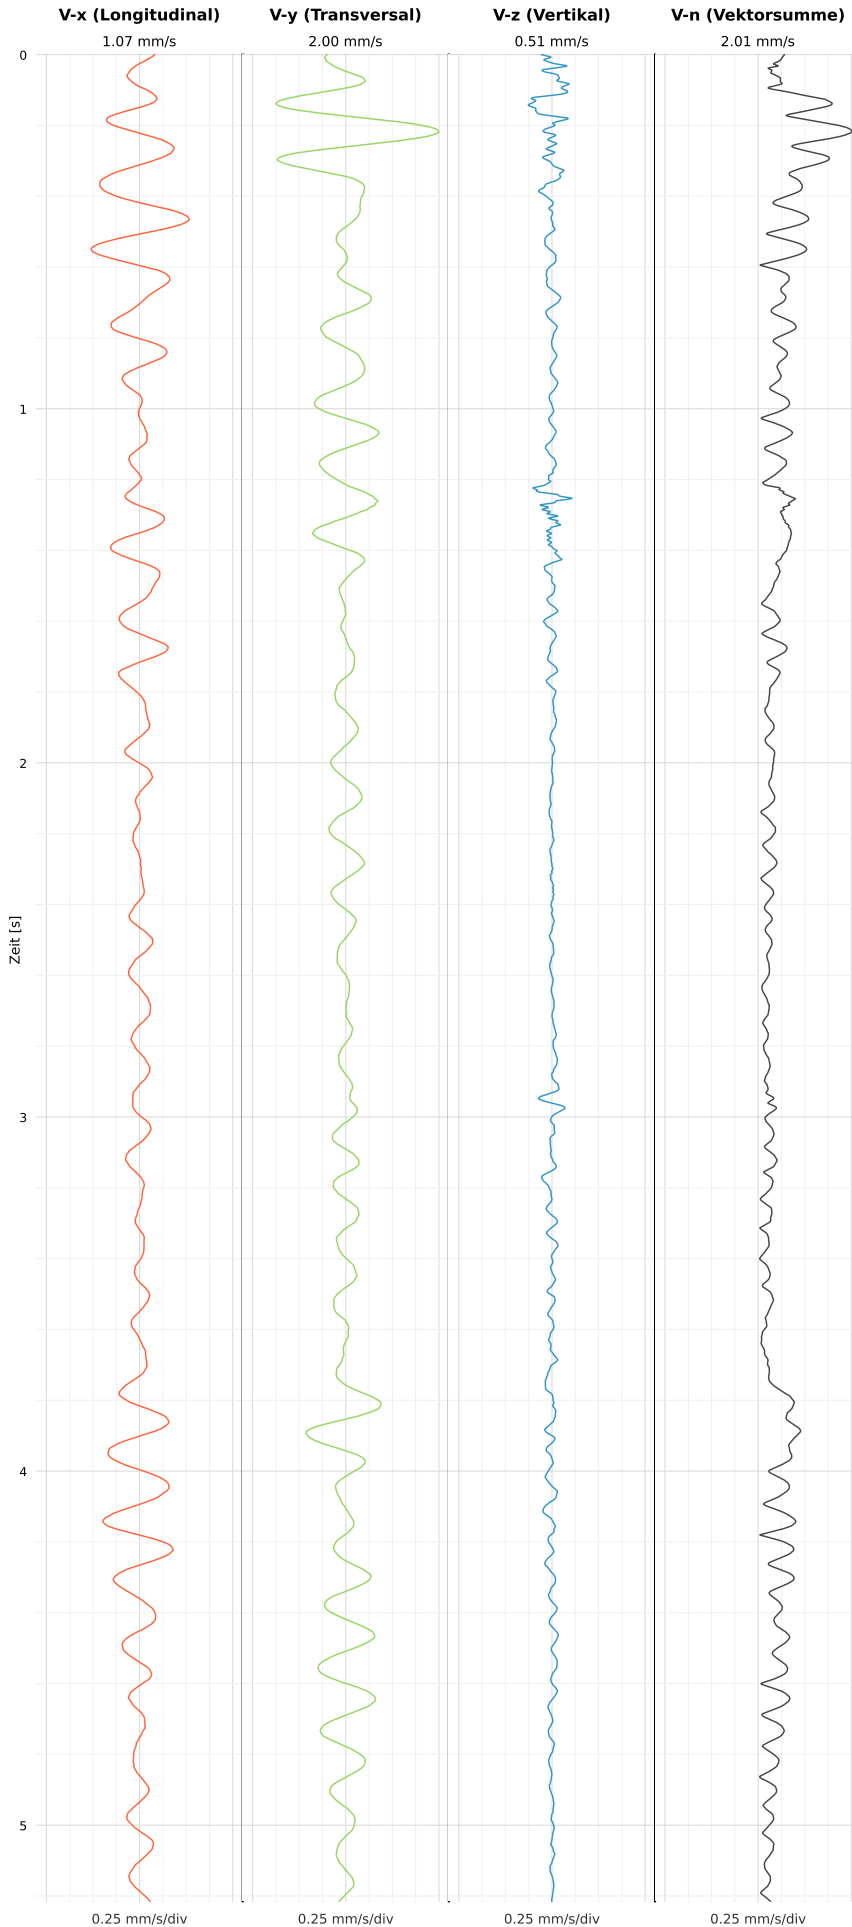


DATEI: 2492-RH6-15052026-194733_raw.csv

Aufzeichnungsdauer: 5.22 s | Abtastrate: 1000 Hz

Datum	15.05.2026
Zeit	19:47:33
Event-ID	2492-RH6-15052026-194733
Status	Ereignis
X	1.07 mm/s @ 5.9 Hz
Y	2.00 mm/s @ 5.9 Hz
Z	0.51 mm/s @ 12.8 Hz
Vn	2.01 mm/s @ 5.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

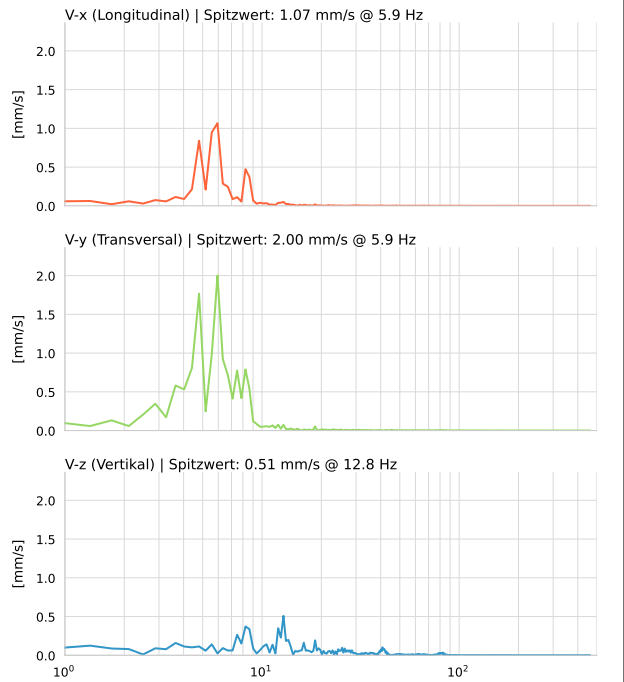

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.9 Hz	4.8 Hz	5.9 Hz	8.2 Hz
Y	5.9 Hz	4.8 Hz	5.9 Hz	7.9 Hz
Z	12.8 Hz	8.6 Hz	15.9 Hz	39.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

