


## SCHWINGGESCHWINDIGKEIT

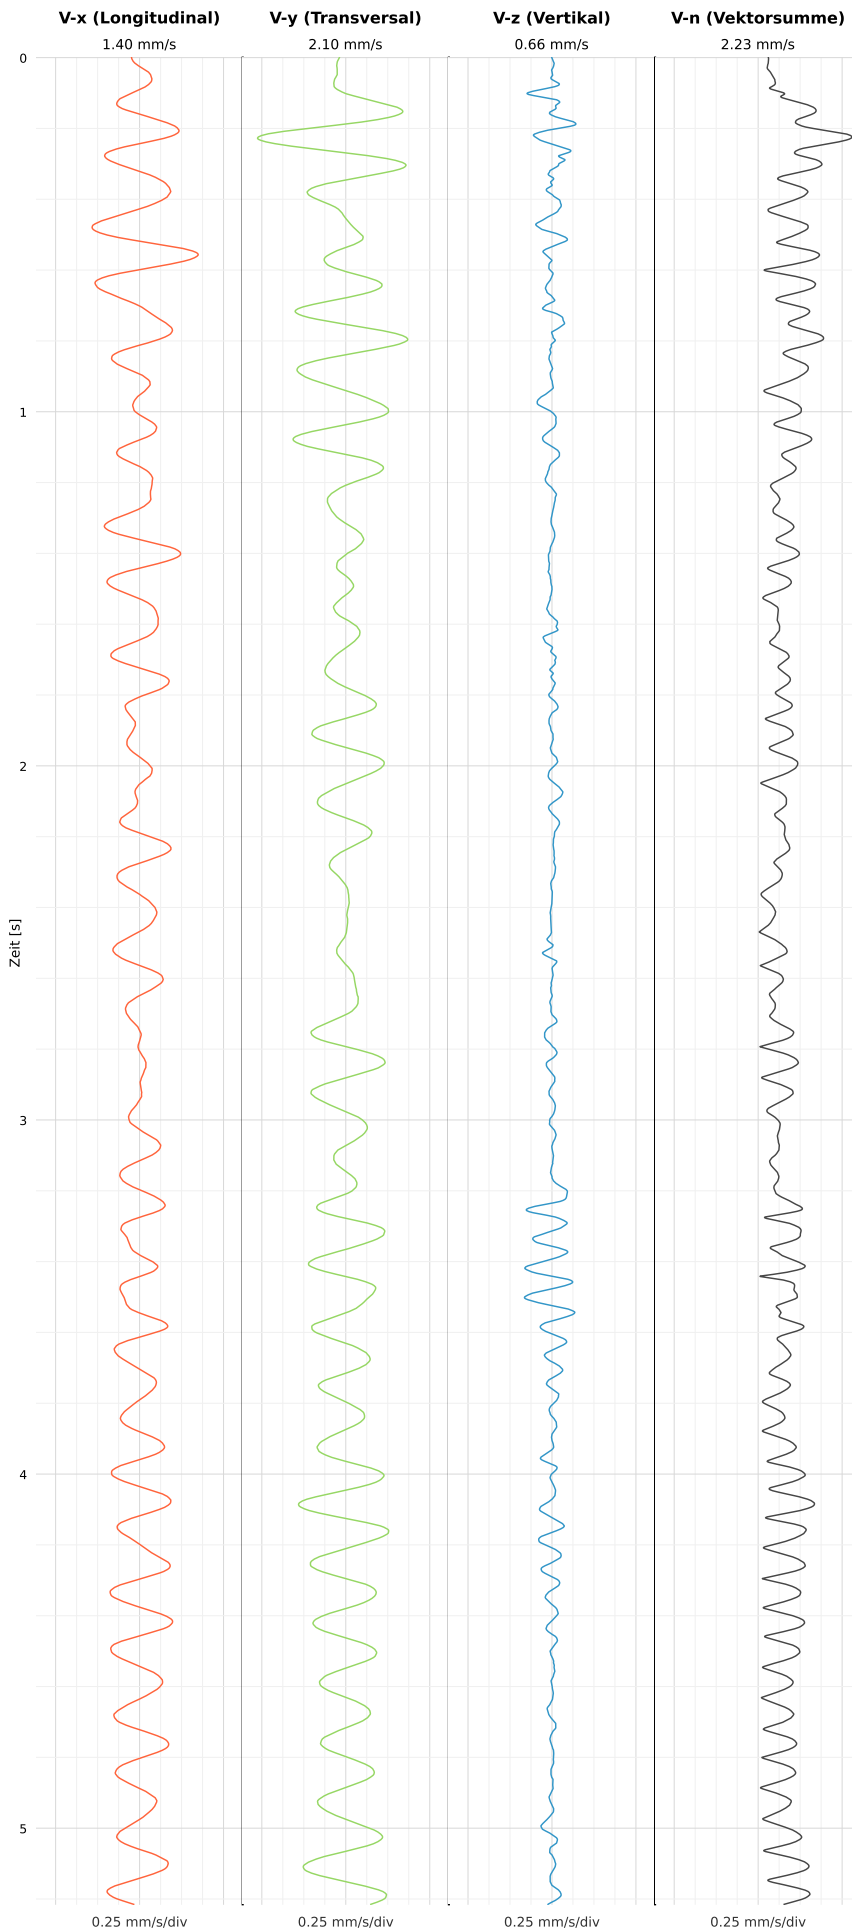


DATEI: 2492-RH6-15052026-232807\_raw.csv

Aufzeichnungsdauer: 5.22 s | Abtastrate: 1000 Hz

Datum	15.05.2026
Zeit	23:28:07
Event-ID	2492-RH6-15052026-232807
Status	Ereignis
X	1.40 mm/s @ 5.9 Hz
Y	2.10 mm/s @ 5.9 Hz
Z	0.66 mm/s @ 12.3 Hz
Vn	2.23 mm/s @ 5.9 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

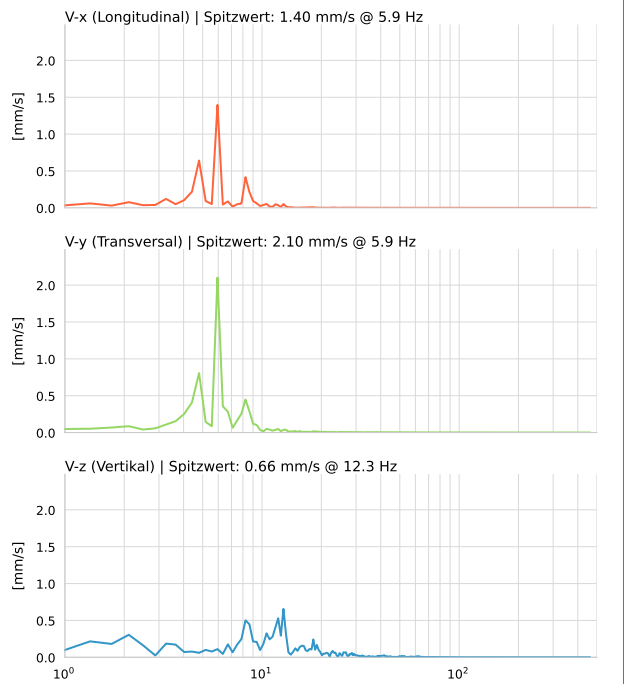

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.9 Hz	4.8 Hz	5.9 Hz	8.2 Hz
Y	5.9 Hz	4.8 Hz	5.9 Hz	9.0 Hz
Z	12.3 Hz	8.2 Hz	12.1 Hz	18.6 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

