


SCHWINGGESCHWINDIGKEIT

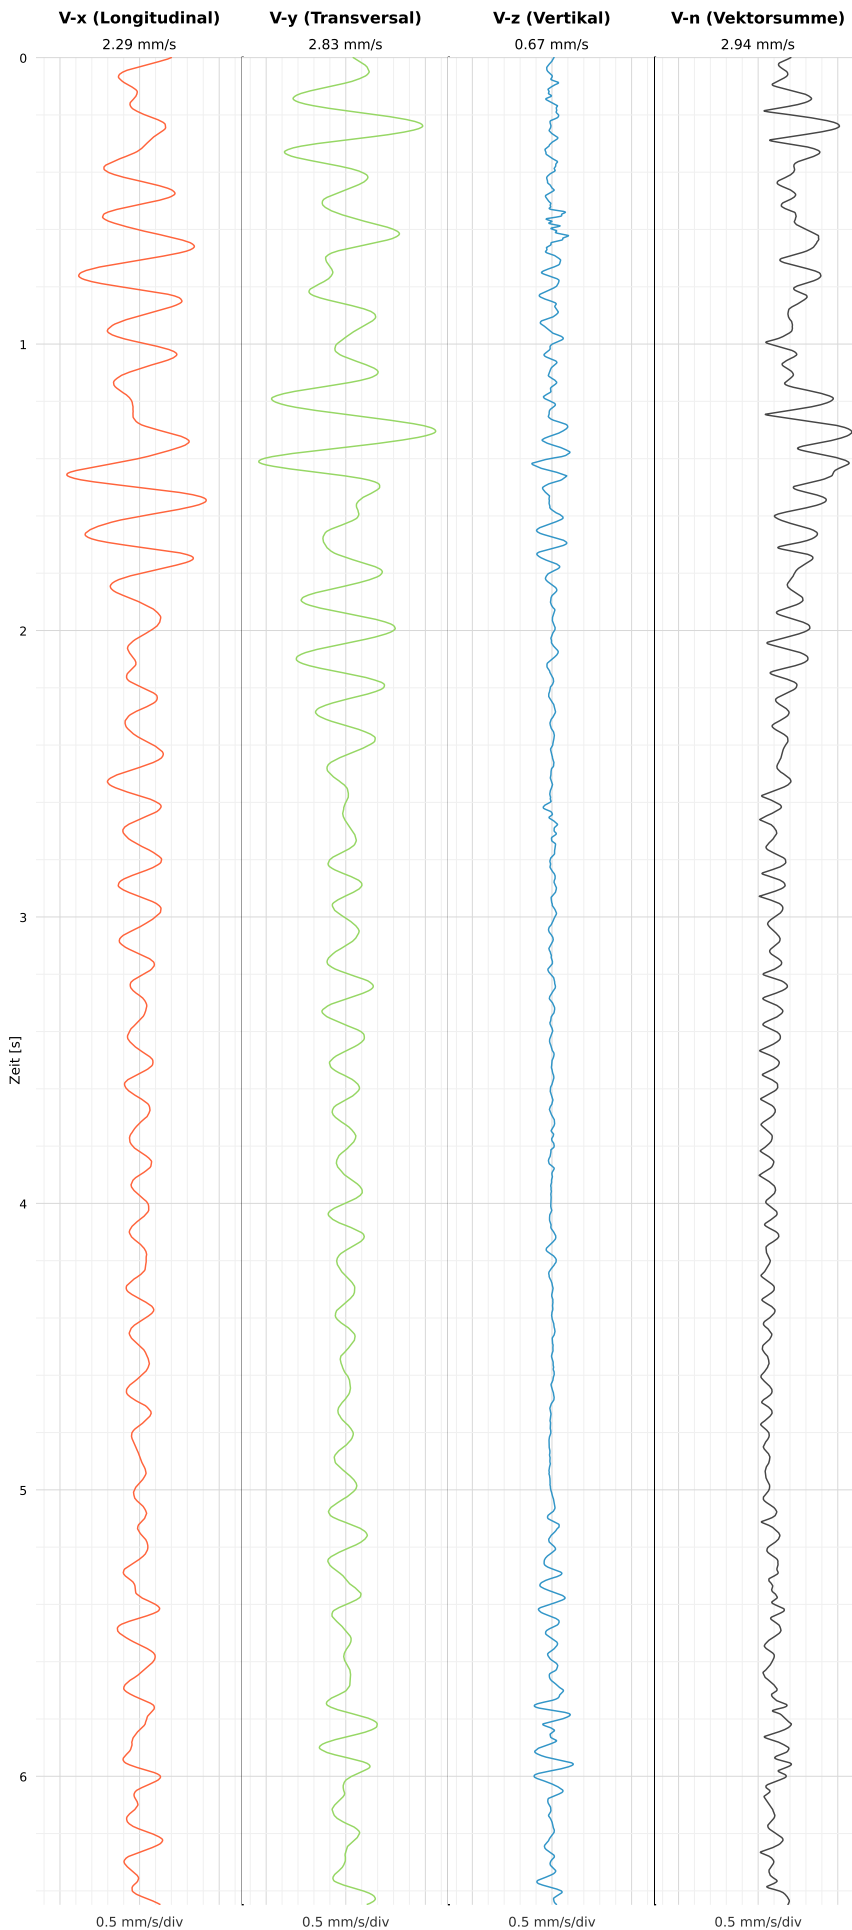


DATEI: 2492-RH6-16052026-094549_raw.csv

Aufzeichnungsdauer: 6.45 s | Abtastrate: 1000 Hz

Datum	16.05.2026
Zeit	09:45:49
Event-ID	2492-RH6-16052026-094549
Status	Ereignis
X	2.29 mm/s @ 5.7 Hz
Y	2.83 mm/s @ 5.7 Hz
Z	0.67 mm/s @ 12.2 Hz
Vn	2.94 mm/s @ 5.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

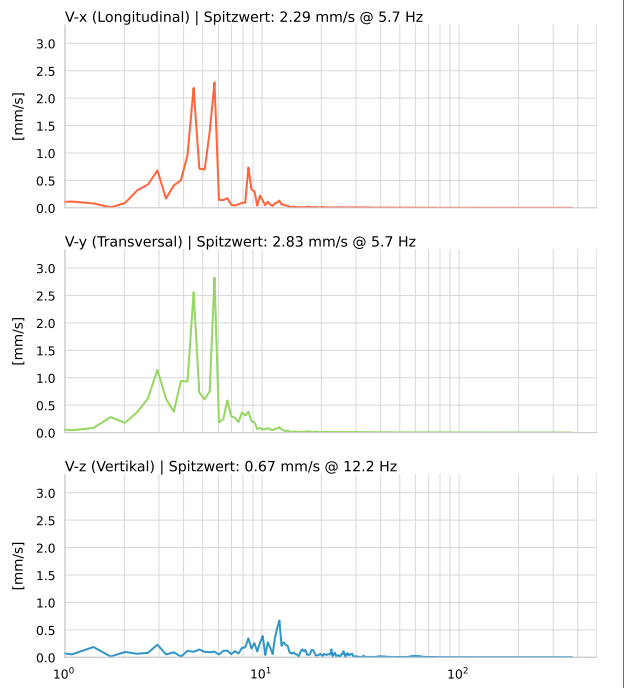

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.7 Hz	4.5 Hz	5.4 Hz	8.5 Hz
Y	5.7 Hz	3.9 Hz	5.1 Hz	7.0 Hz
Z	12.2 Hz	8.5 Hz	12.3 Hz	20.9 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

