


SCHWINGGESCHWINDIGKEIT

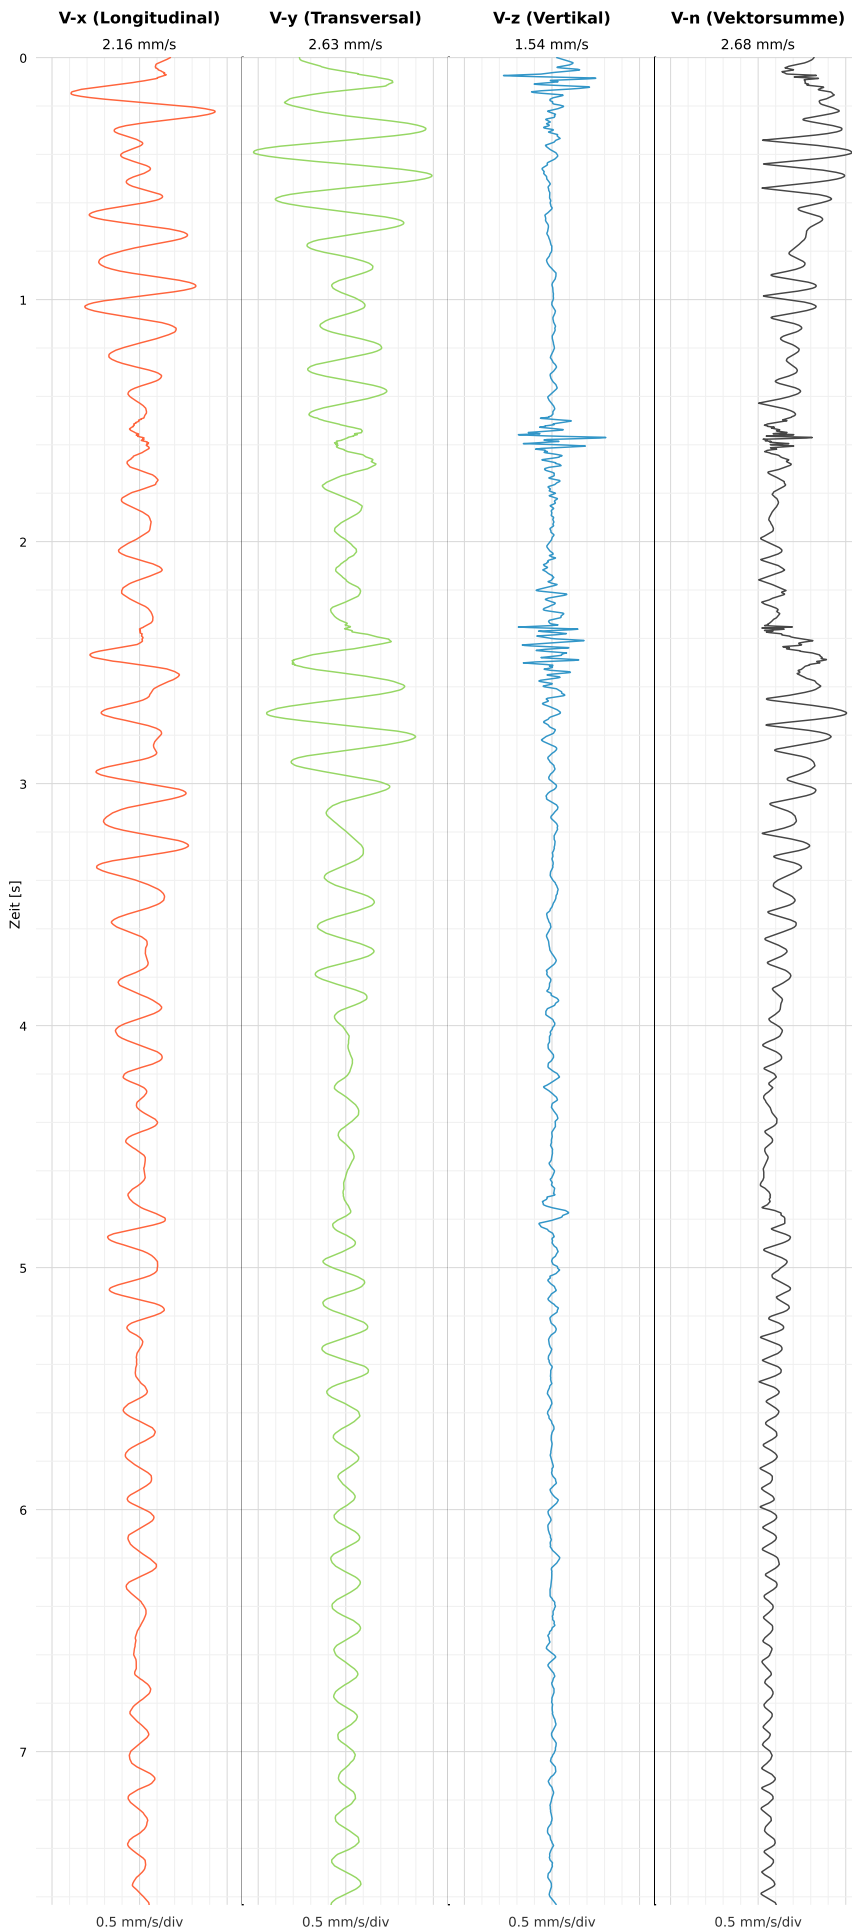


DATEI: 2492-RH6-16052026-213349_raw.csv

Aufzeichnungsdauer: 7.63 s | Abtastrate: 1000 Hz

Datum	16.05.2026
Zeit	21:33:49
Event-ID	2492-RH6-16052026-213349
Status	Ereignis
X	2.16 mm/s @ 4.6 Hz
Y	2.63 mm/s @ 4.6 Hz
Z	1.54 mm/s @ 12.6 Hz
Vn	2.68 mm/s @ 4.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

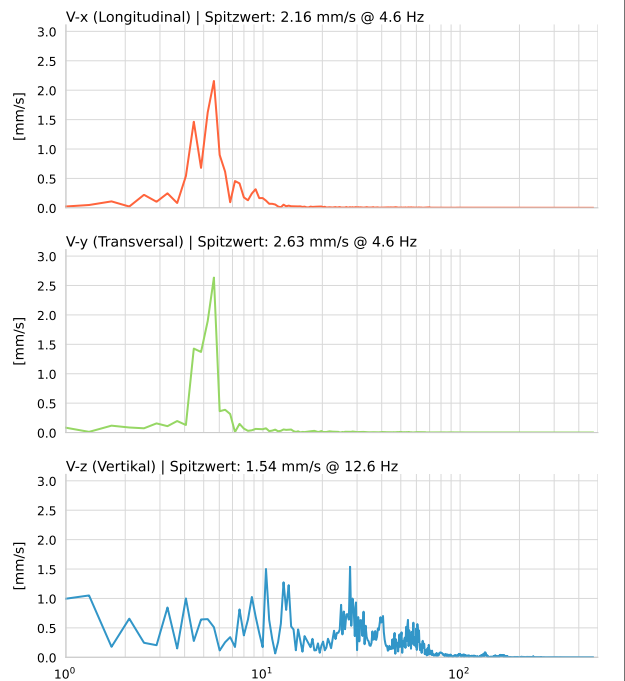

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	4.6 Hz	4.8 Hz	5.6 Hz	8.8 Hz
Y	4.6 Hz	4.8 Hz	5.6 Hz	7.6 Hz
Z	12.6 Hz	13.5 Hz	30.4 Hz	53.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

