


SCHWINGGESCHWINDIGKEIT

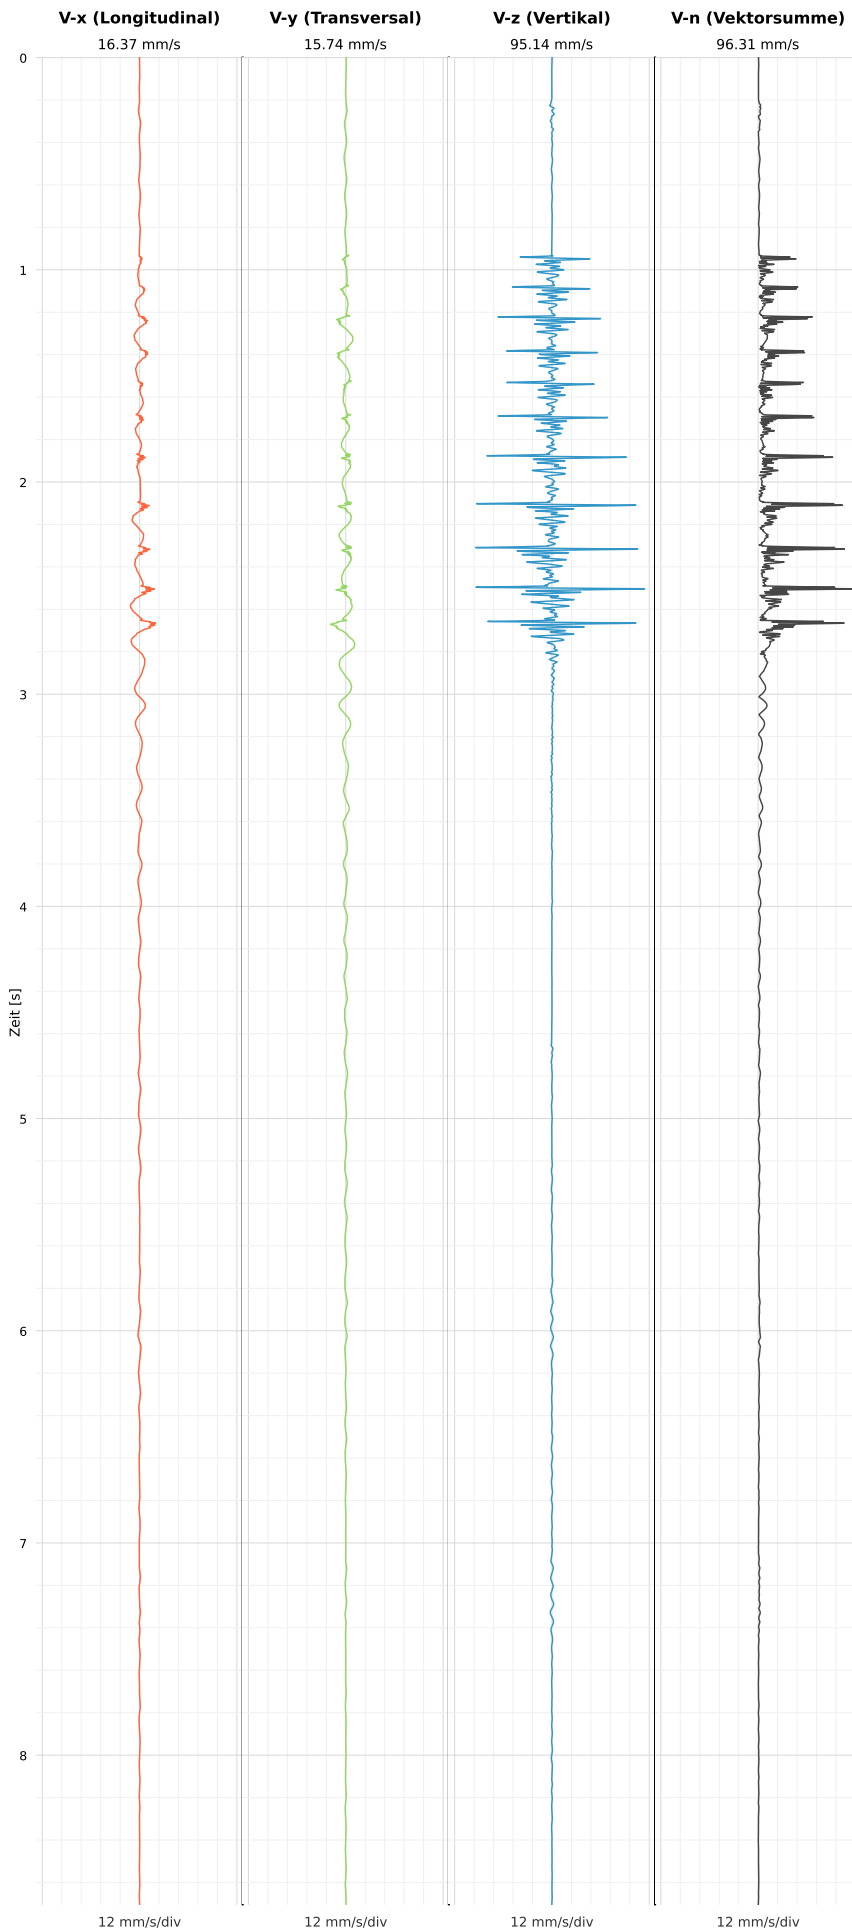


DATEI: 2492-RH6-16052026-224909_raw.csv

Aufzeichnungsdauer: 8.70 s | Abtastrate: 1000 Hz

Datum	16.05.2026
Zeit	22:49:09
Event-ID	2492-RH6-16052026-224909
Status	Kritisch
X	16.37 mm/s @ 5.5 Hz
Y	15.74 mm/s @ 5.5 Hz
Z	95.14 mm/s @ 62.8 Hz
Vn	96.31 mm/s @ 62.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

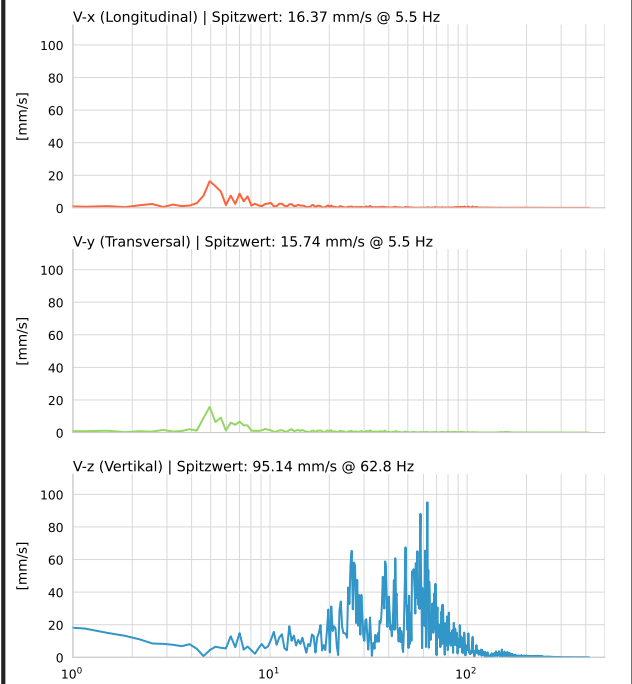

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.5 Hz	6.3 Hz	15.3 Hz	83.2 Hz
Y	5.5 Hz	6.7 Hz	21.1 Hz	76.3 Hz
Z	62.8 Hz	37.0 Hz	54.9 Hz	71.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

