


## SCHWINGGESCHWINDIGKEIT

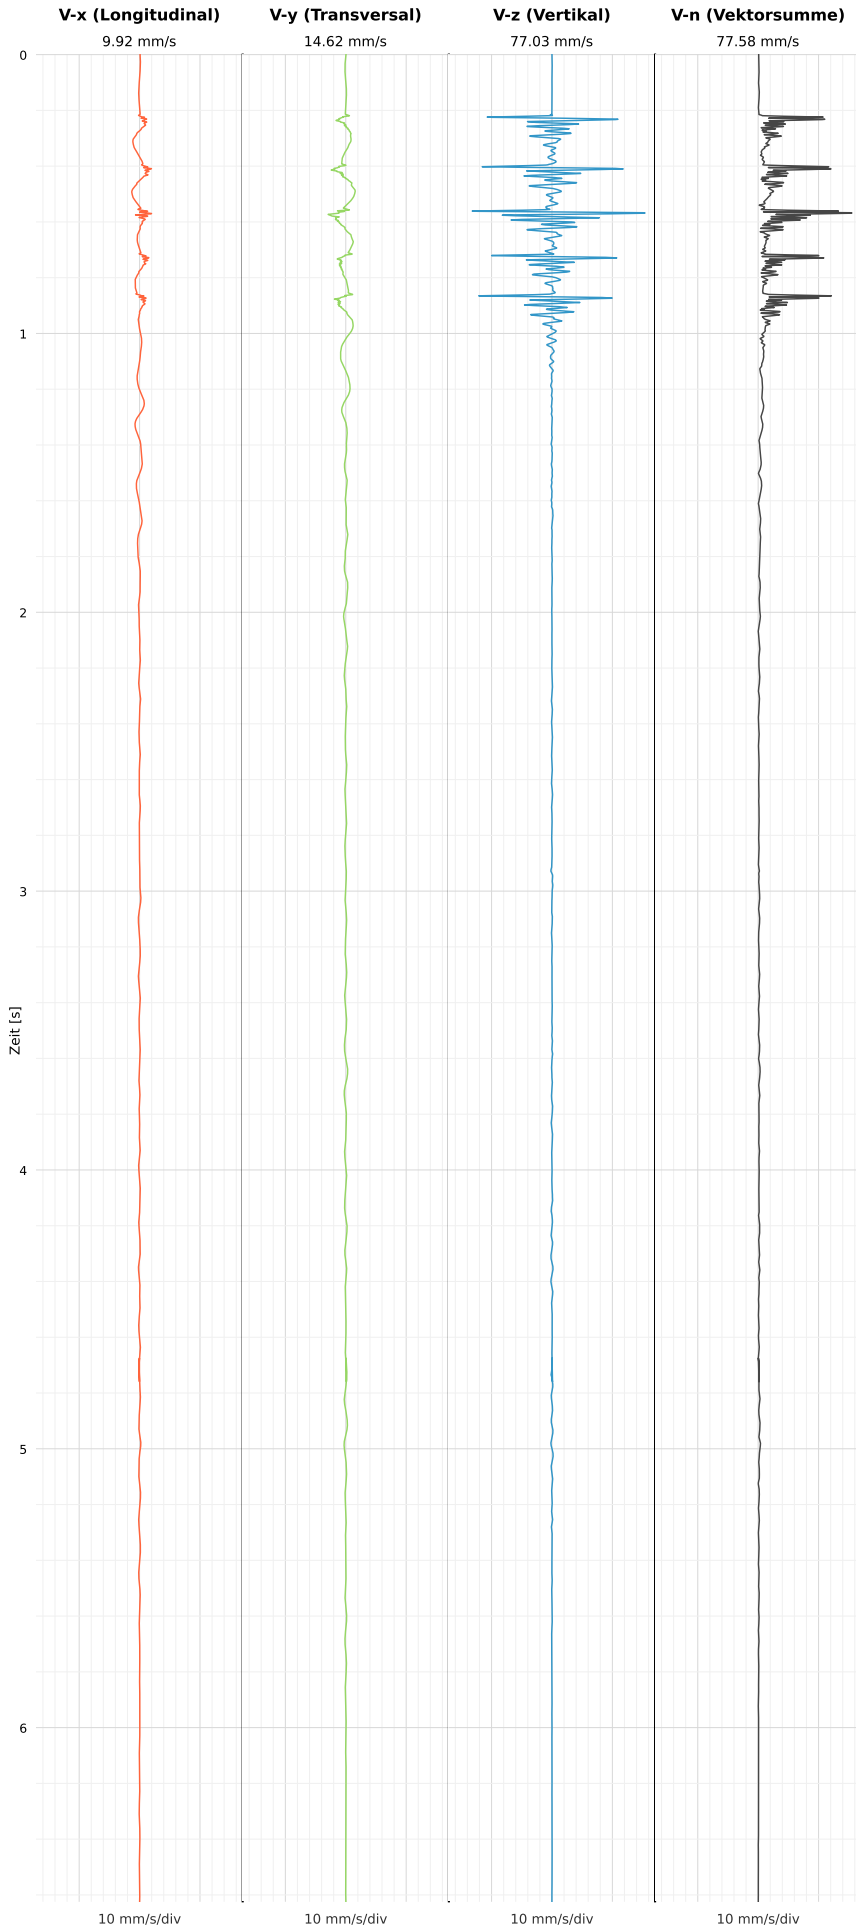


DATEI: 2492-RH6-17052026-105900\_raw.csv

Aufzeichnungsdauer: 6.62 s | Abtastrate: 1000 Hz

Datum	17.05.2026
Zeit	10:59:00
Event-ID	2492-RH6-17052026-105900
Status	Kritisch
X	9.92 mm/s @ 5.6 Hz
Y	14.62 mm/s @ 5.6 Hz
Z	77.03 mm/s @ 62.5 Hz
Vn	77.58 mm/s @ 62.5 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

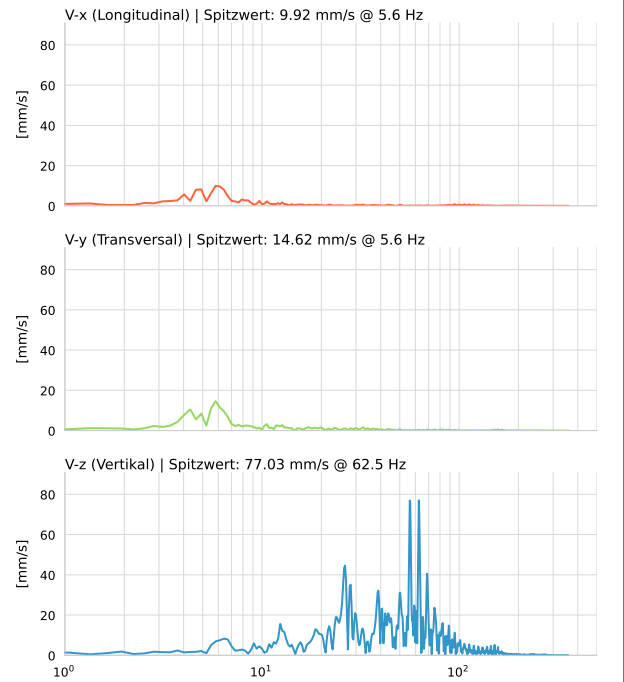

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.6 Hz	6.1 Hz	23.7 Hz	102.1 Hz
Y	5.6 Hz	6.1 Hz	20.1 Hz	75.9 Hz
Z	62.5 Hz	38.9 Hz	57.4 Hz	76.2 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

