


SCHWINGGESCHWINDIGKEIT

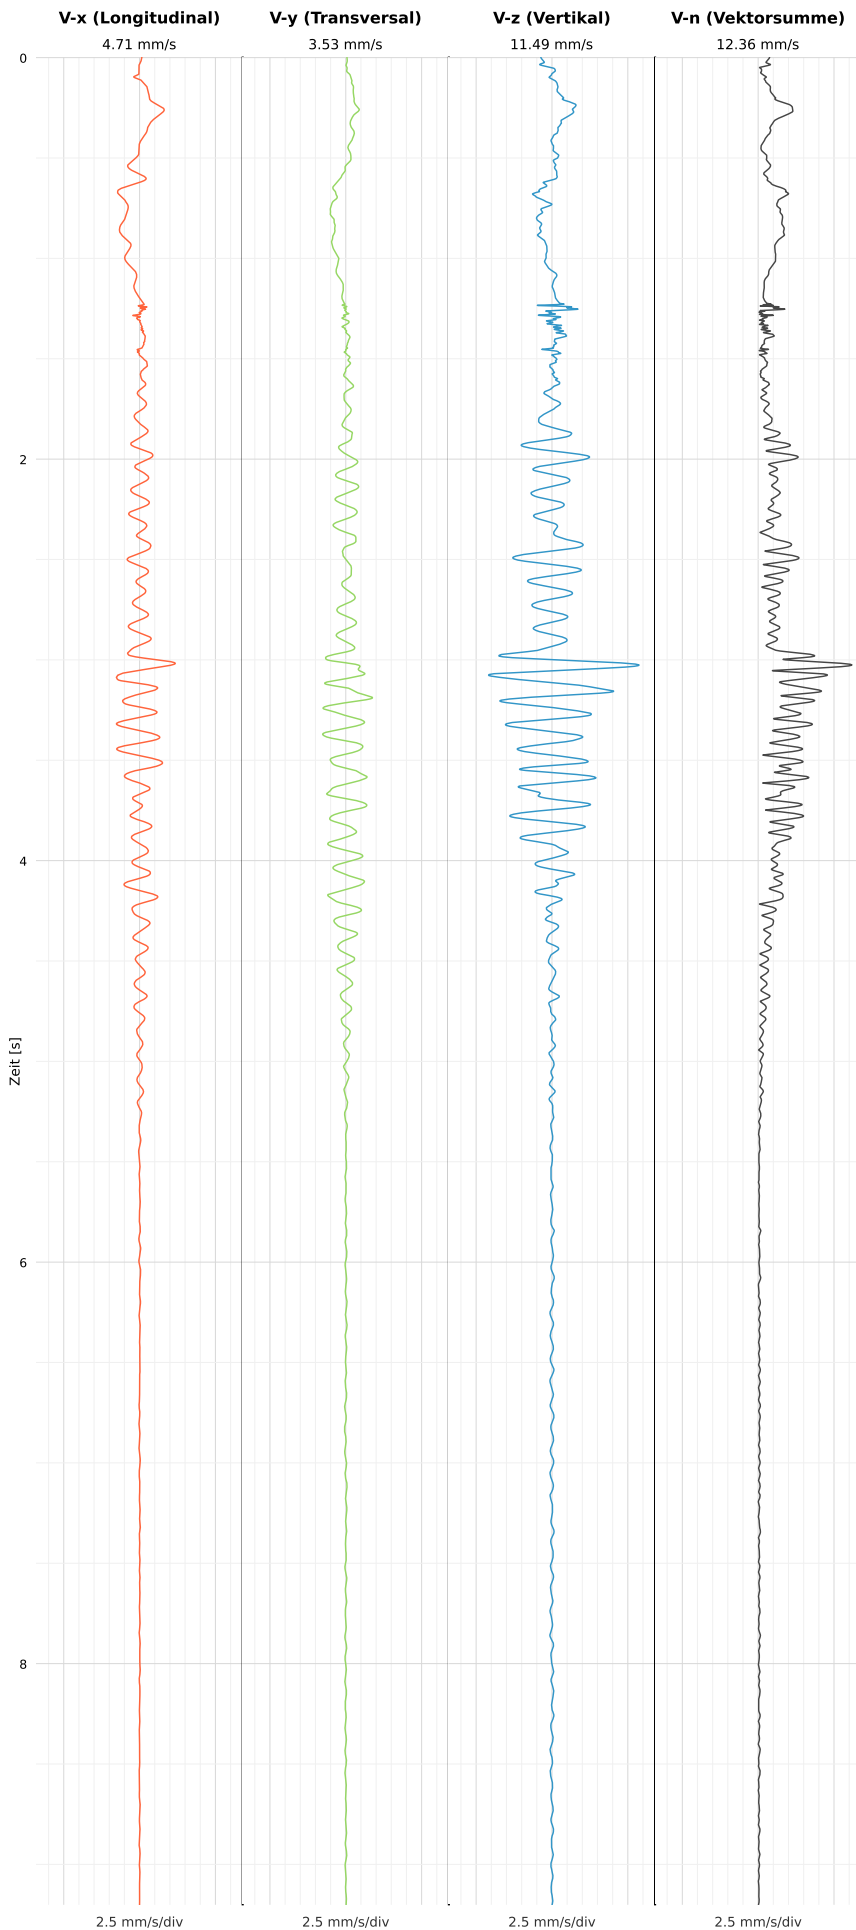


DATEI: 2493-HS-5-11052026-220714_raw.csv

Aufzeichnungsdauer: 9.20 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	00:07:14
Event-ID	2493-HS-5-11052026-220714
Status	Kritisch
X	4.71 mm/s @ 8.6 Hz
Y	3.53 mm/s @ 7.6 Hz
Z	11.49 mm/s @ 8.6 Hz
Vn	12.36 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

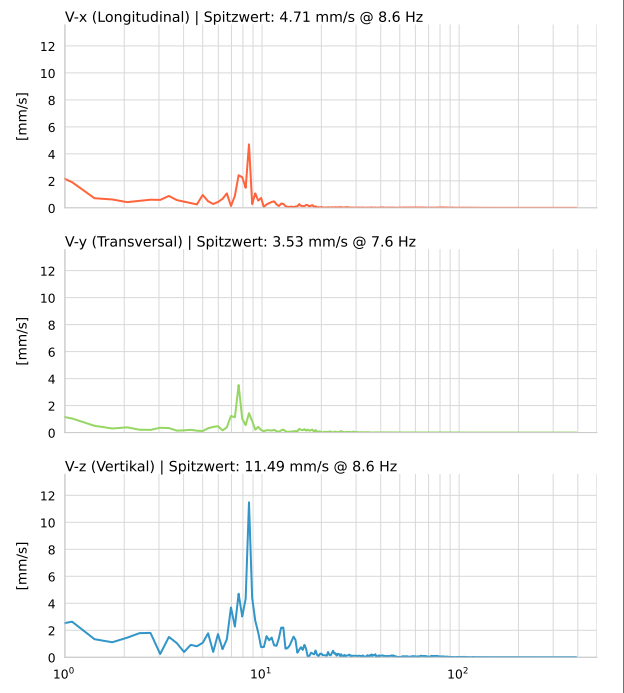

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	2.7 Hz	7.6 Hz	9.9 Hz
Y	7.6 Hz	3.7 Hz	7.6 Hz	11.5 Hz
Z	8.6 Hz	7.0 Hz	8.9 Hz	15.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

