


SCHWINGGESCHWINDIGKEIT

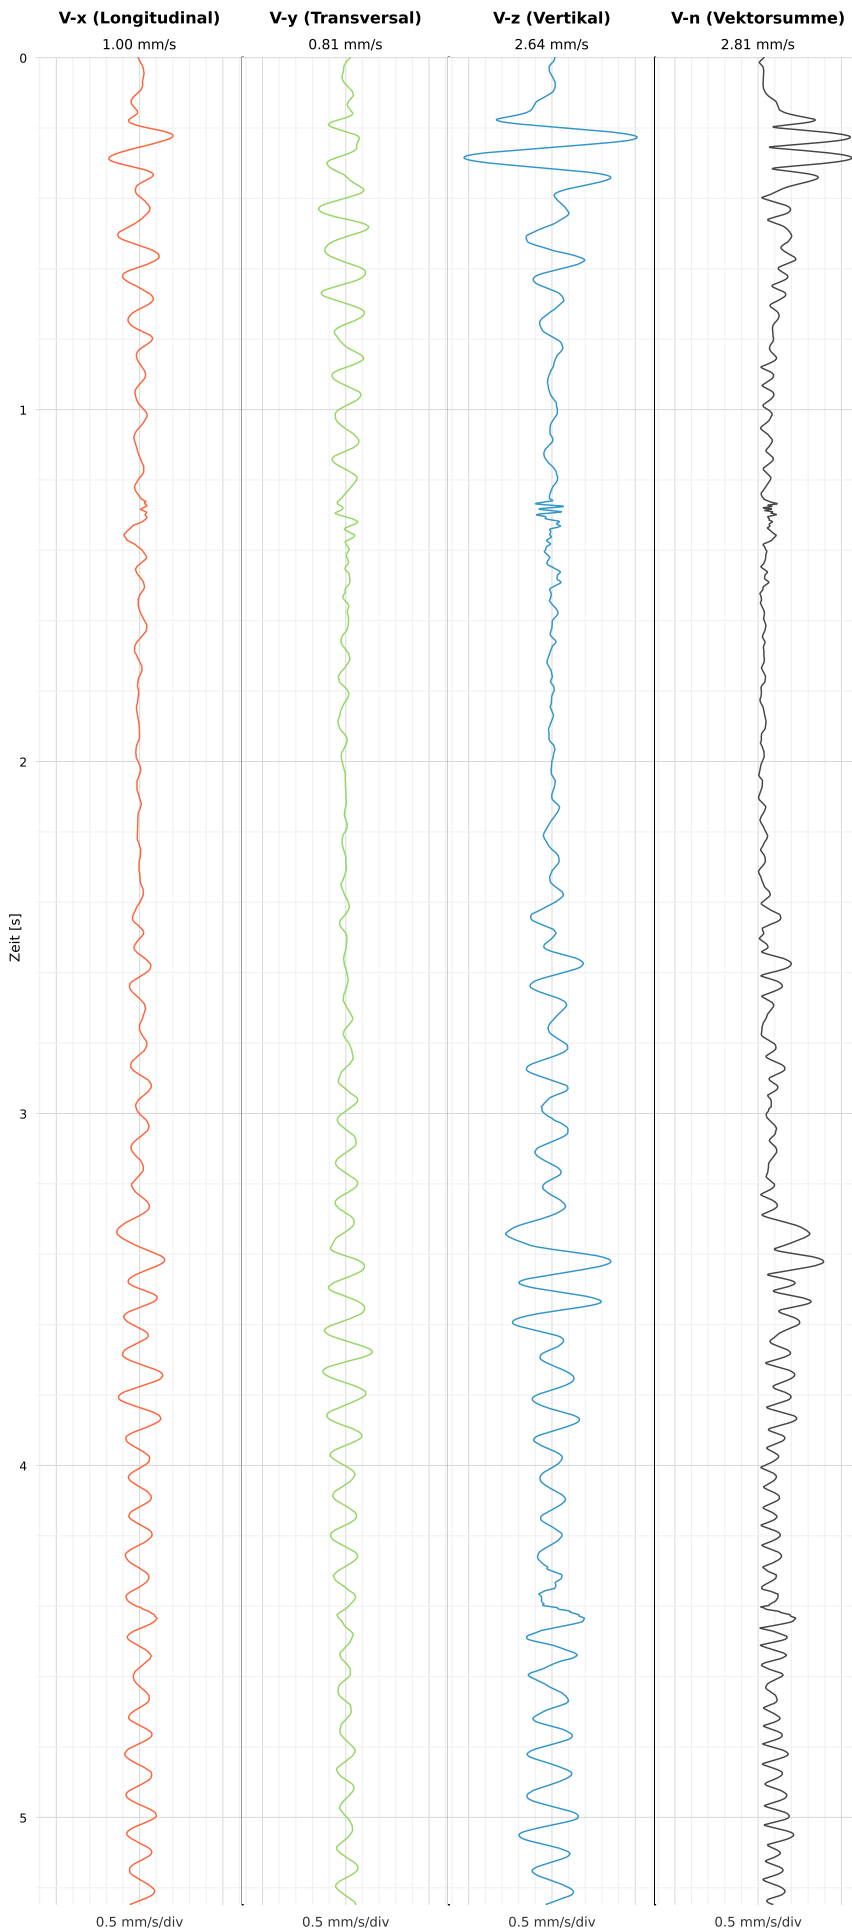


DATEI: 2493-HS-5-12052026-061924_raw.csv

Aufzeichnungsdauer: 5.25 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	08:19:24
Event-ID	2493-HS-5-12052026-061924
Status	Ereignis
X	1.00 mm/s @ 8.6 Hz
Y	0.81 mm/s @ 8.6 Hz
Z	2.64 mm/s @ 8.6 Hz
Vn	2.81 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

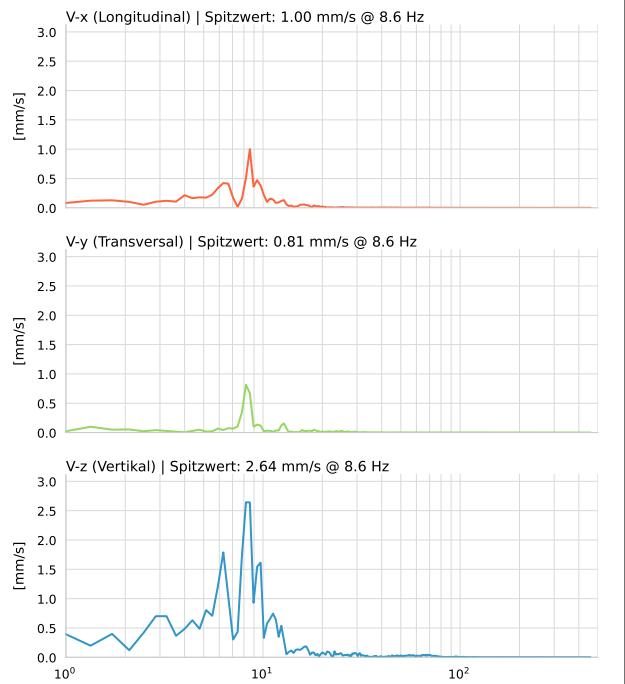

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	6.3 Hz	8.6 Hz	11.2 Hz
Y	8.6 Hz	7.8 Hz	8.6 Hz	15.4 Hz
Z	8.6 Hz	6.3 Hz	8.6 Hz	12.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

