


SCHWINGGESCHWINDIGKEIT

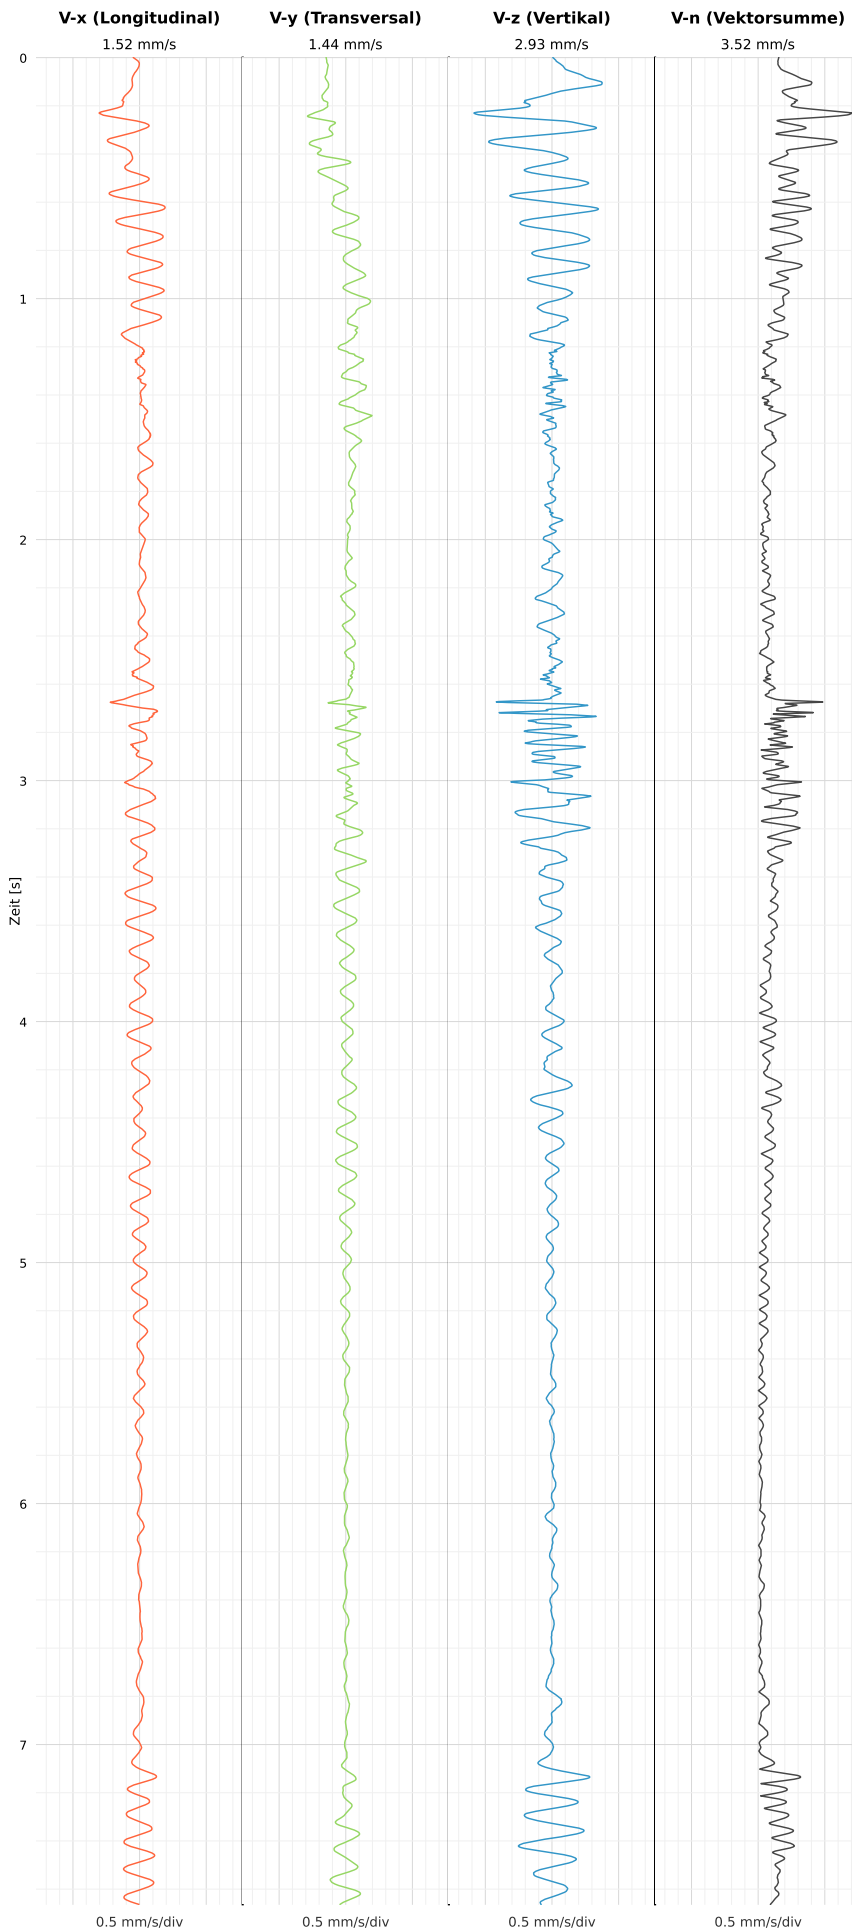


DATEI: 2493-HS-5-12052026-063042_raw.csv

Aufzeichnungsdauer: 7.66 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	08:30:42
Event-ID	2493-HS-5-12052026-063042
Status	Ereignis
X	1.52 mm/s @ 8.6 Hz
Y	1.44 mm/s @ 8.6 Hz
Z	2.93 mm/s @ 8.6 Hz
Vn	3.52 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

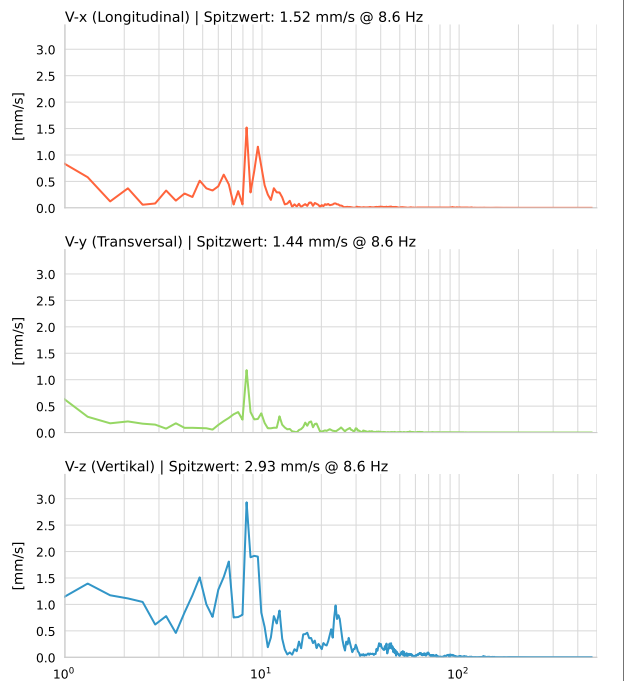

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	4.0 Hz	8.4 Hz	12.3 Hz
Y	8.6 Hz	1.7 Hz	8.4 Hz	19.3 Hz
Z	8.6 Hz	6.4 Hz	10.3 Hz	26.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

