


SCHWINGGESCHWINDIGKEIT

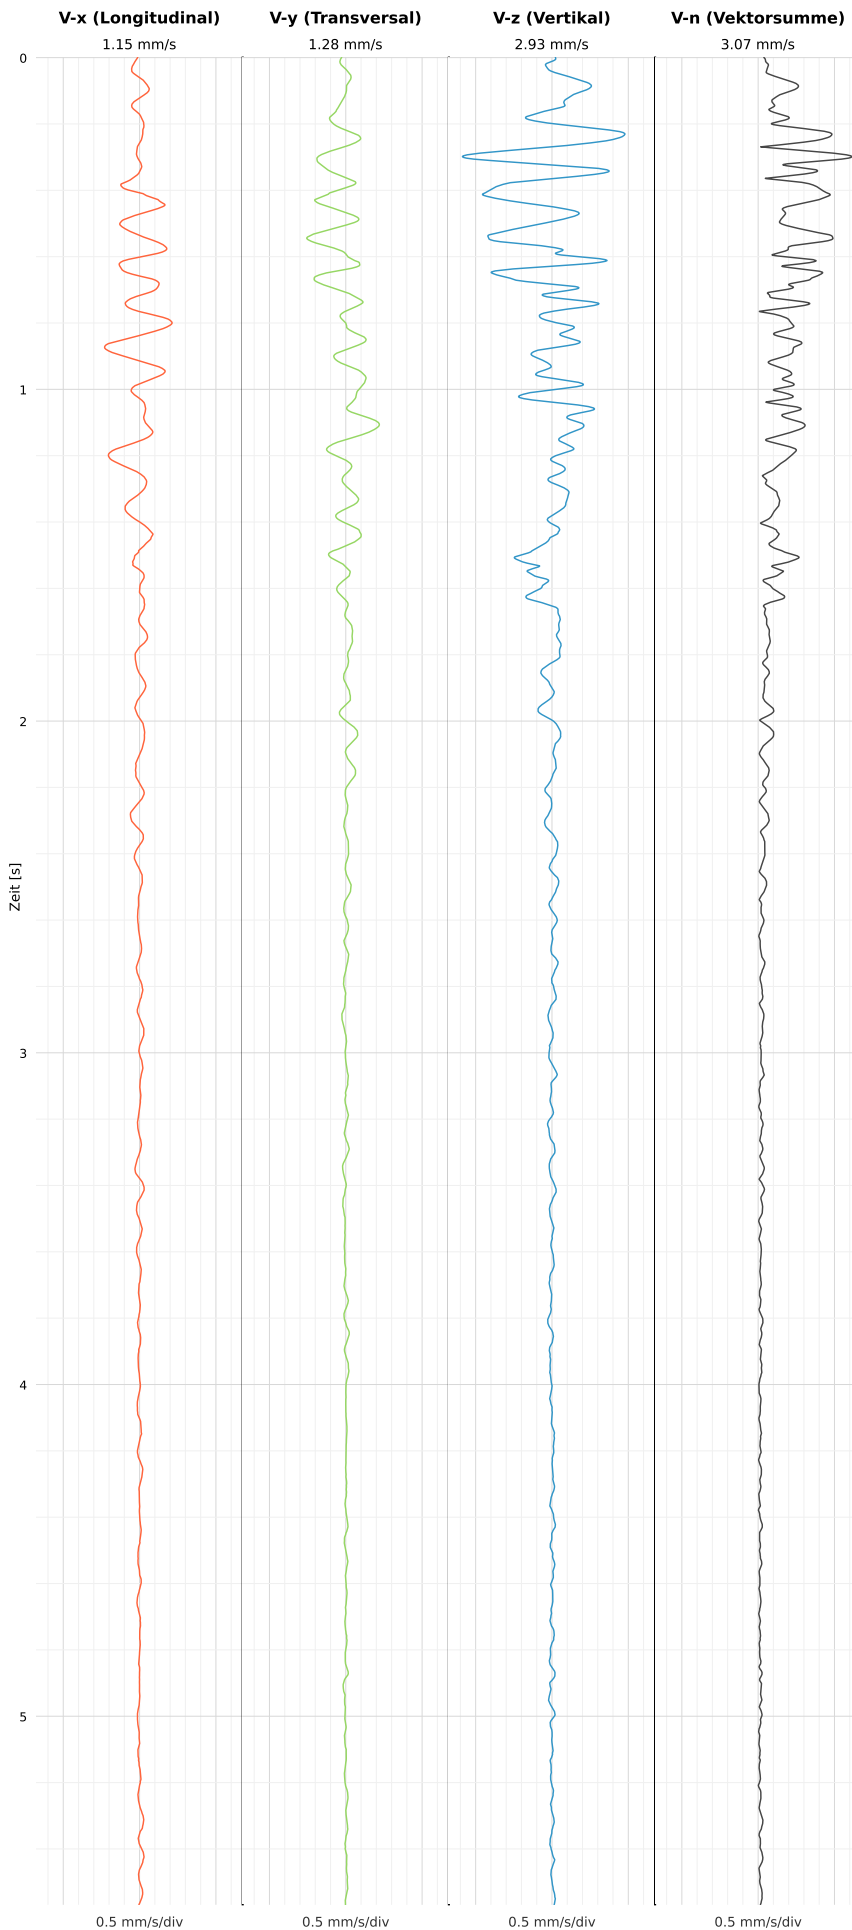


DATEI: 2493-HS-5-12052026-064159_raw.csv

Aufzeichnungsdauer: 5.57 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	08:41:59
Event-ID	2493-HS-5-12052026-064159
Status	Ereignis
X	1.15 mm/s @ 6.7 Hz
Y	1.28 mm/s @ 8.6 Hz
Z	2.93 mm/s @ 8.6 Hz
Vn	3.07 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

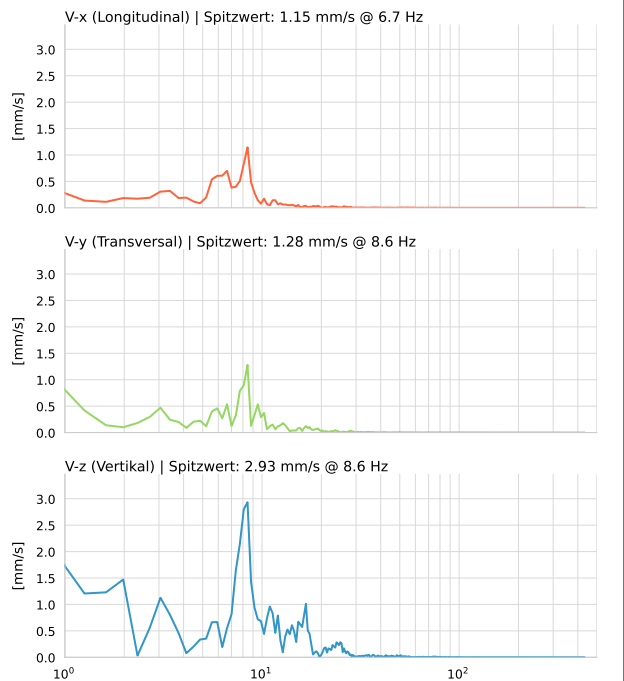

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	6.7 Hz	5.6 Hz	7.7 Hz	9.2 Hz
Y	8.6 Hz	3.4 Hz	7.7 Hz	10.2 Hz
Z	8.6 Hz	5.9 Hz	8.4 Hz	14.9 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

