


SCHWINGGESCHWINDIGKEIT

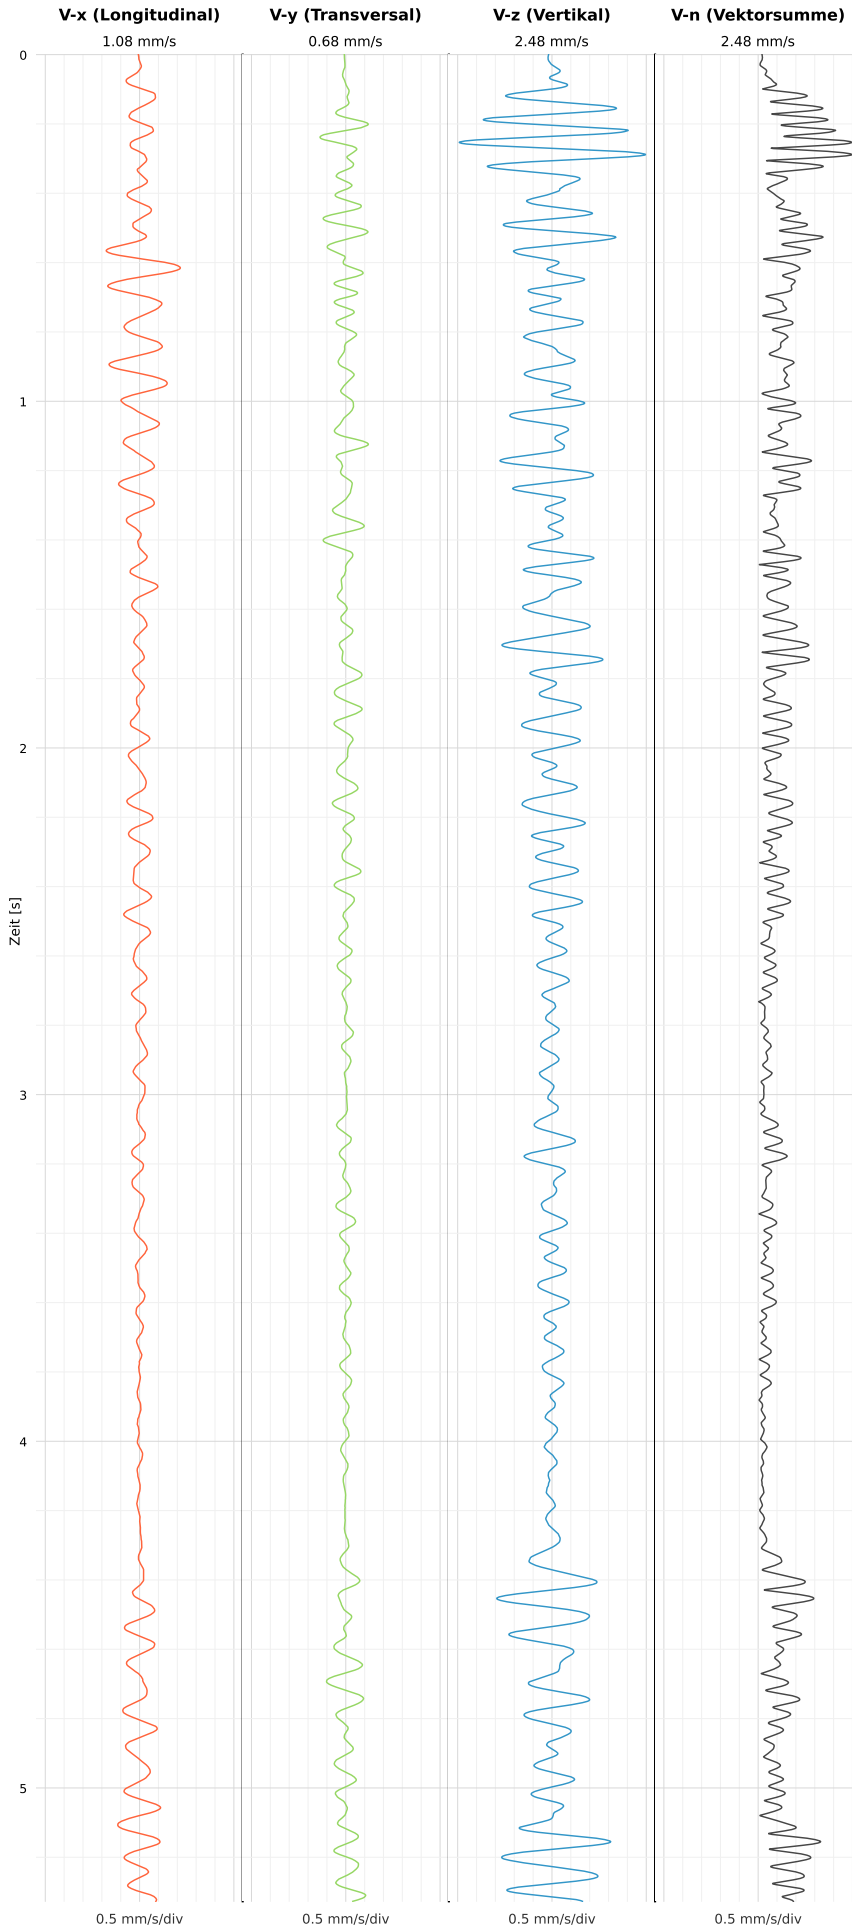


DATEI: 2493-HS-5-12052026-065823_raw.csv

Aufzeichnungsdauer: 5.33 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	08:58:23
Event-ID	2493-HS-5-12052026-065823
Status	Ereignis
X	1.08 mm/s @ 8.8 Hz
Y	0.68 mm/s @ 12.9 Hz
Z	2.48 mm/s @ 8.8 Hz
Vn	2.48 mm/s @ 8.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

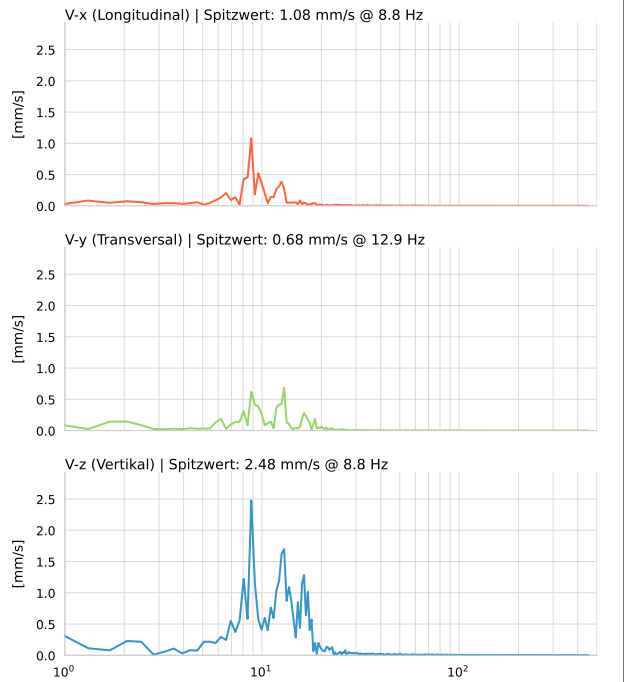

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.8 Hz	8.4 Hz	9.9 Hz	14.8 Hz
Y	12.9 Hz	8.8 Hz	12.2 Hz	16.7 Hz
Z	8.8 Hz	9.2 Hz	13.0 Hz	16.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

