


SCHWINGGESCHWINDIGKEIT

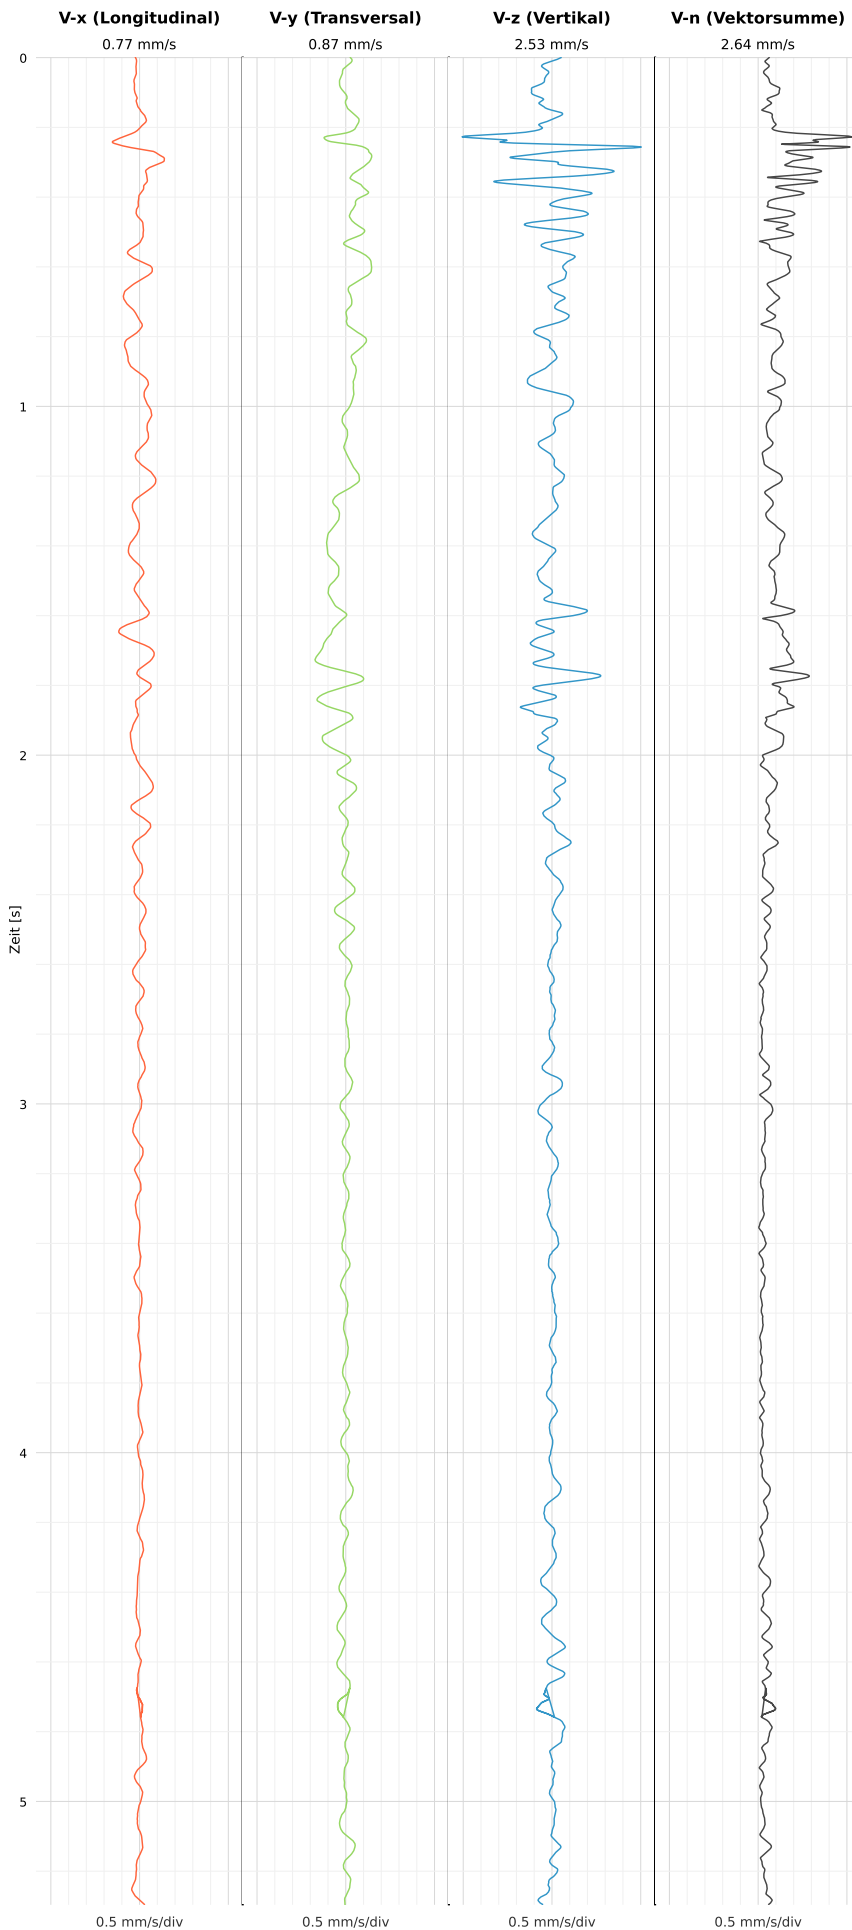


DATEI: 2493-HS-5-12052026-103710_raw.csv

Aufzeichnungsdauer: 5.30 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	12:37:10
Event-ID	2493-HS-5-12052026-103710
Status	Ereignis
X	0.77 mm/s @ 8.2 Hz
Y	0.87 mm/s @ 9.5 Hz
Z	2.53 mm/s @ 8.7 Hz
Vn	2.64 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

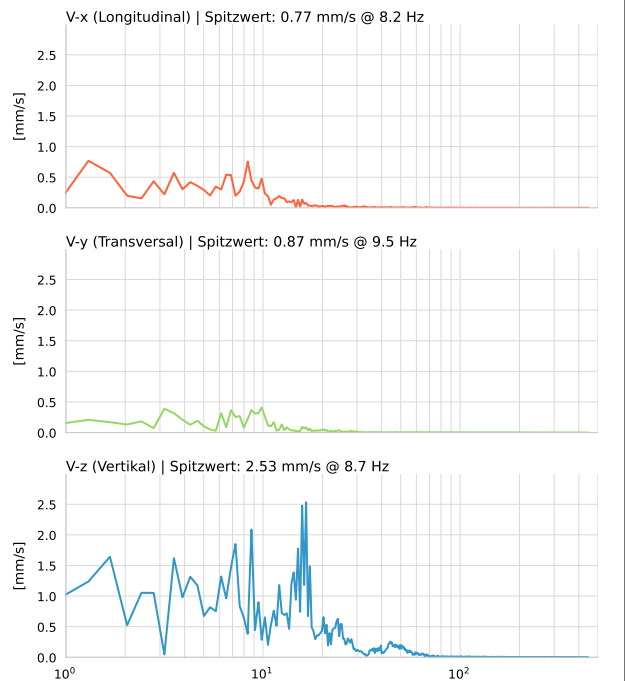

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.2 Hz	4.3 Hz	8.0 Hz	12.8 Hz
Y	9.5 Hz	3.2 Hz	7.6 Hz	12.5 Hz
Z	8.7 Hz	6.9 Hz	15.1 Hz	25.1 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

