


SCHWINGGESCHWINDIGKEIT

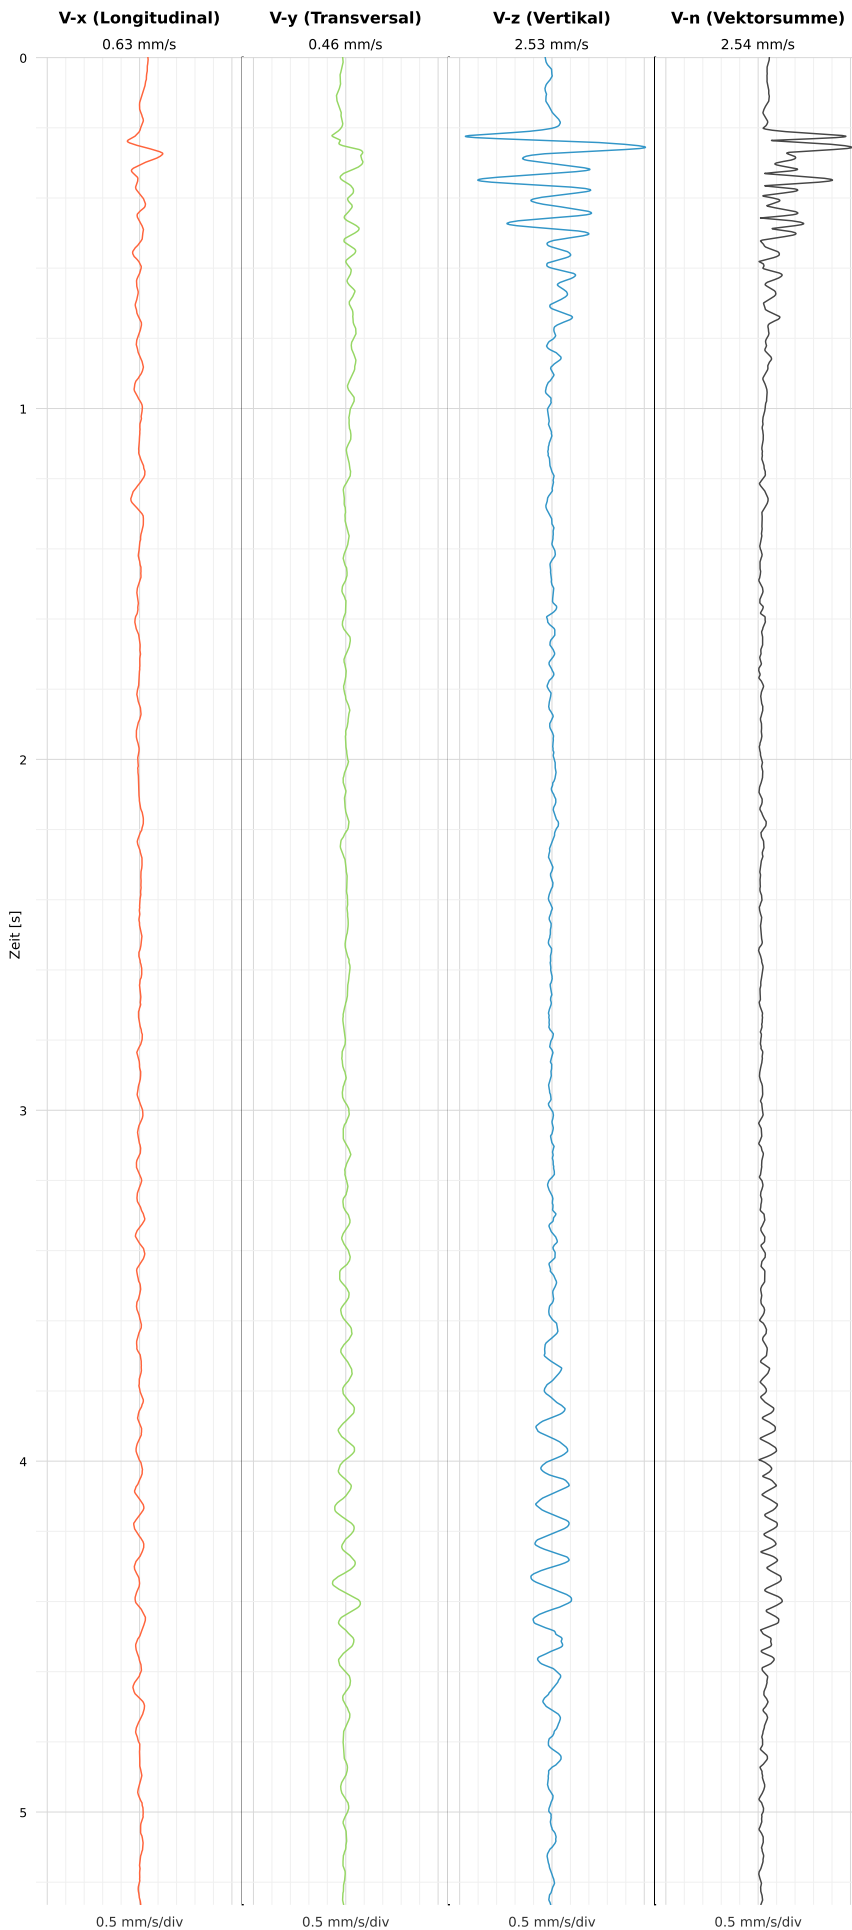


DATEI: 2493-HS-5-12052026-112836_raw.csv

Aufzeichnungsdauer: 5.26 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	13:28:36
Event-ID	2493-HS-5-12052026-112836
Status	Ereignis
X	0.63 mm/s @ 9.7 Hz
Y	0.46 mm/s @ 9.1 Hz
Z	2.53 mm/s @ 8.7 Hz
Vn	2.54 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

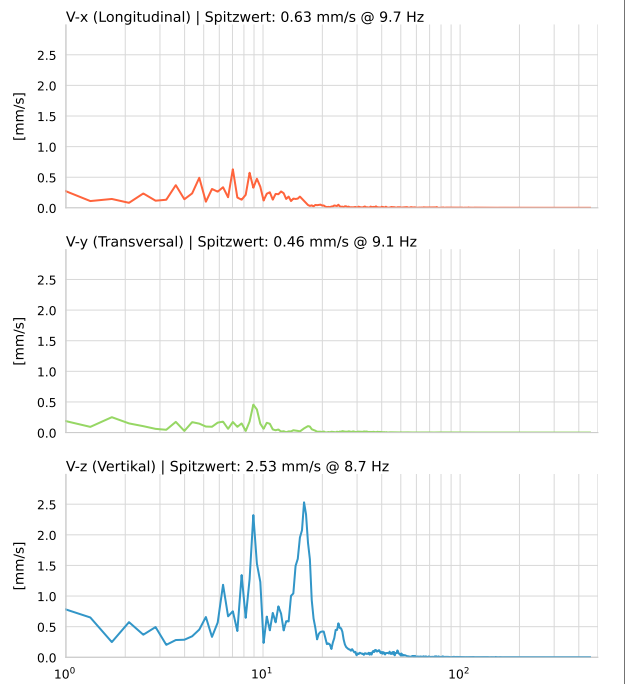

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.7 Hz	5.9 Hz	9.7 Hz	16.1 Hz
Y	9.1 Hz	3.2 Hz	8.5 Hz	15.0 Hz
Z	8.7 Hz	8.9 Hz	15.0 Hz	18.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

