


SCHWINGGESCHWINDIGKEIT

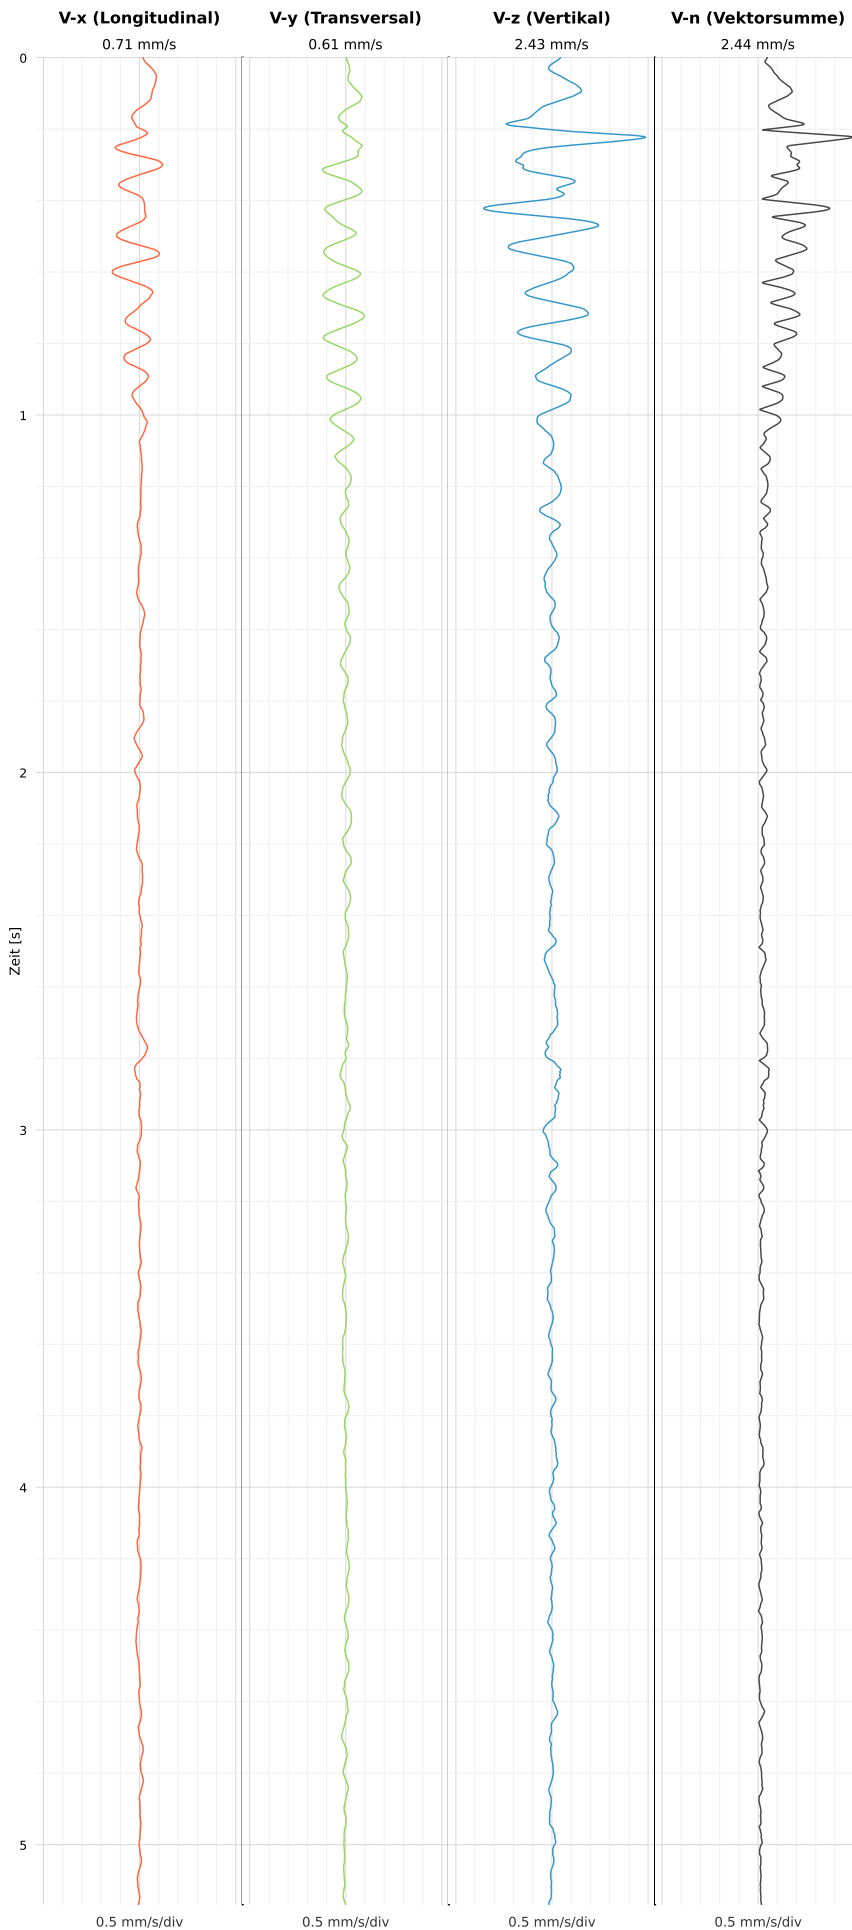


DATEI: 2493-HS-5-12052026-124511_raw.csv

Aufzeichnungsdauer: 5.17 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	14:45:11
Event-ID	2493-HS-5-12052026-124511
Status	Ereignis
X	0.71 mm/s @ 8.5 Hz
Y	0.61 mm/s @ 8.5 Hz
Z	2.43 mm/s @ 8.5 Hz
Vn	2.44 mm/s @ 8.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

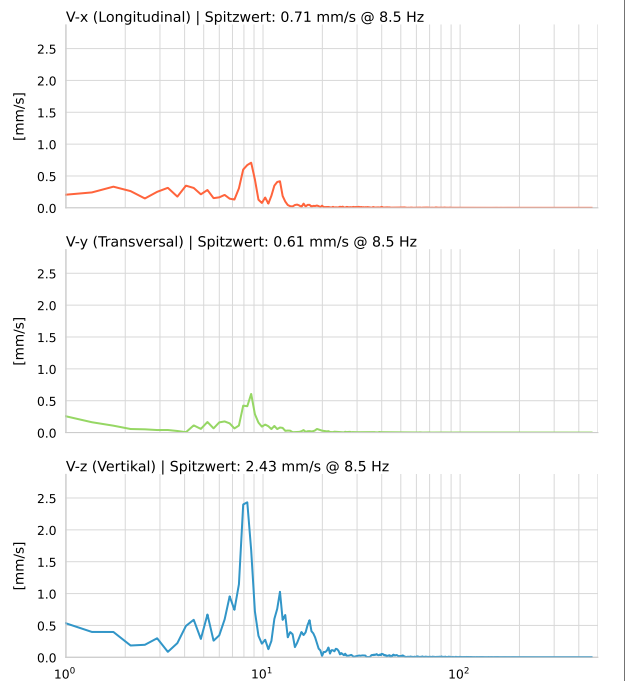

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.5 Hz	4.5 Hz	8.3 Hz	11.8 Hz
Y	8.5 Hz	6.0 Hz	8.7 Hz	11.4 Hz
Z	8.5 Hz	7.5 Hz	9.1 Hz	16.8 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

