


SCHWINGGESCHWINDIGKEIT

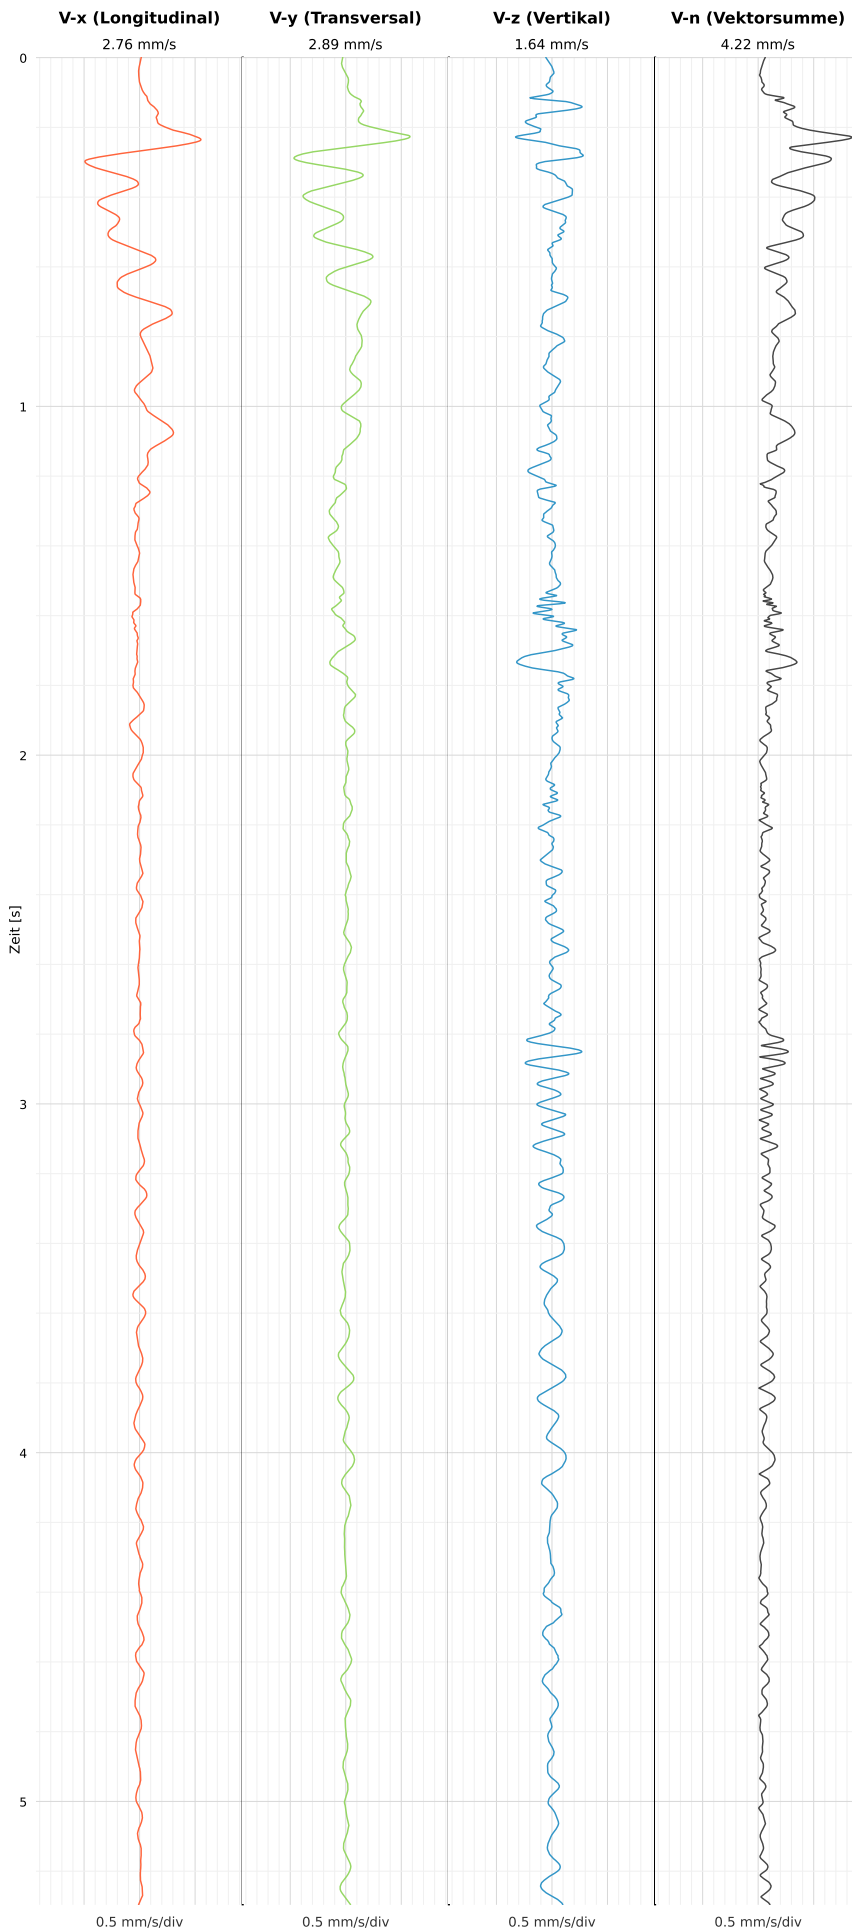


DATEI: 2493-HS-5-12052026-132029_raw.csv

Aufzeichnungsdauer: 5.30 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	15:20:29
Event-ID	2493-HS-5-12052026-132029
Status	Ereignis
X	2.76 mm/s @ 8.7 Hz
Y	2.89 mm/s @ 8.1 Hz
Z	1.64 mm/s @ 8.5 Hz
Vn	4.22 mm/s @ 8.1 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

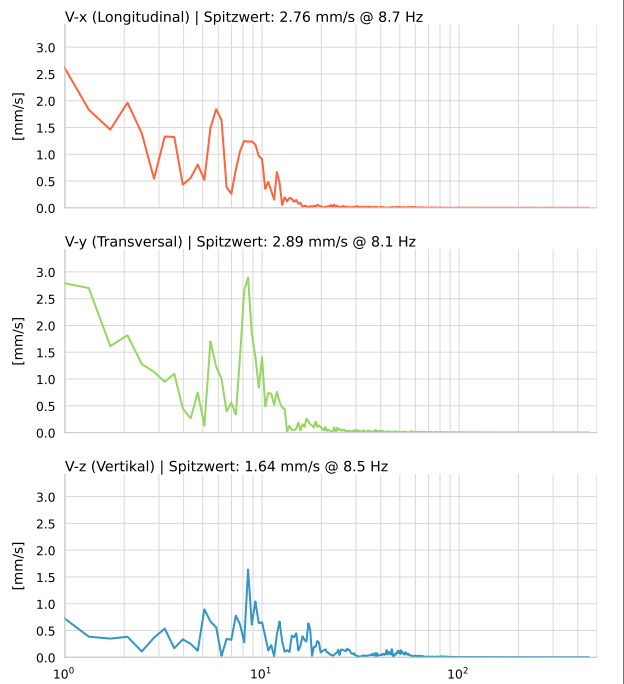

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	2.1 Hz	5.9 Hz	9.3 Hz
Y	8.1 Hz	2.5 Hz	7.7 Hz	10.4 Hz
Z	8.5 Hz	7.4 Hz	12.3 Hz	27.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

