


SCHWINGGESCHWINDIGKEIT



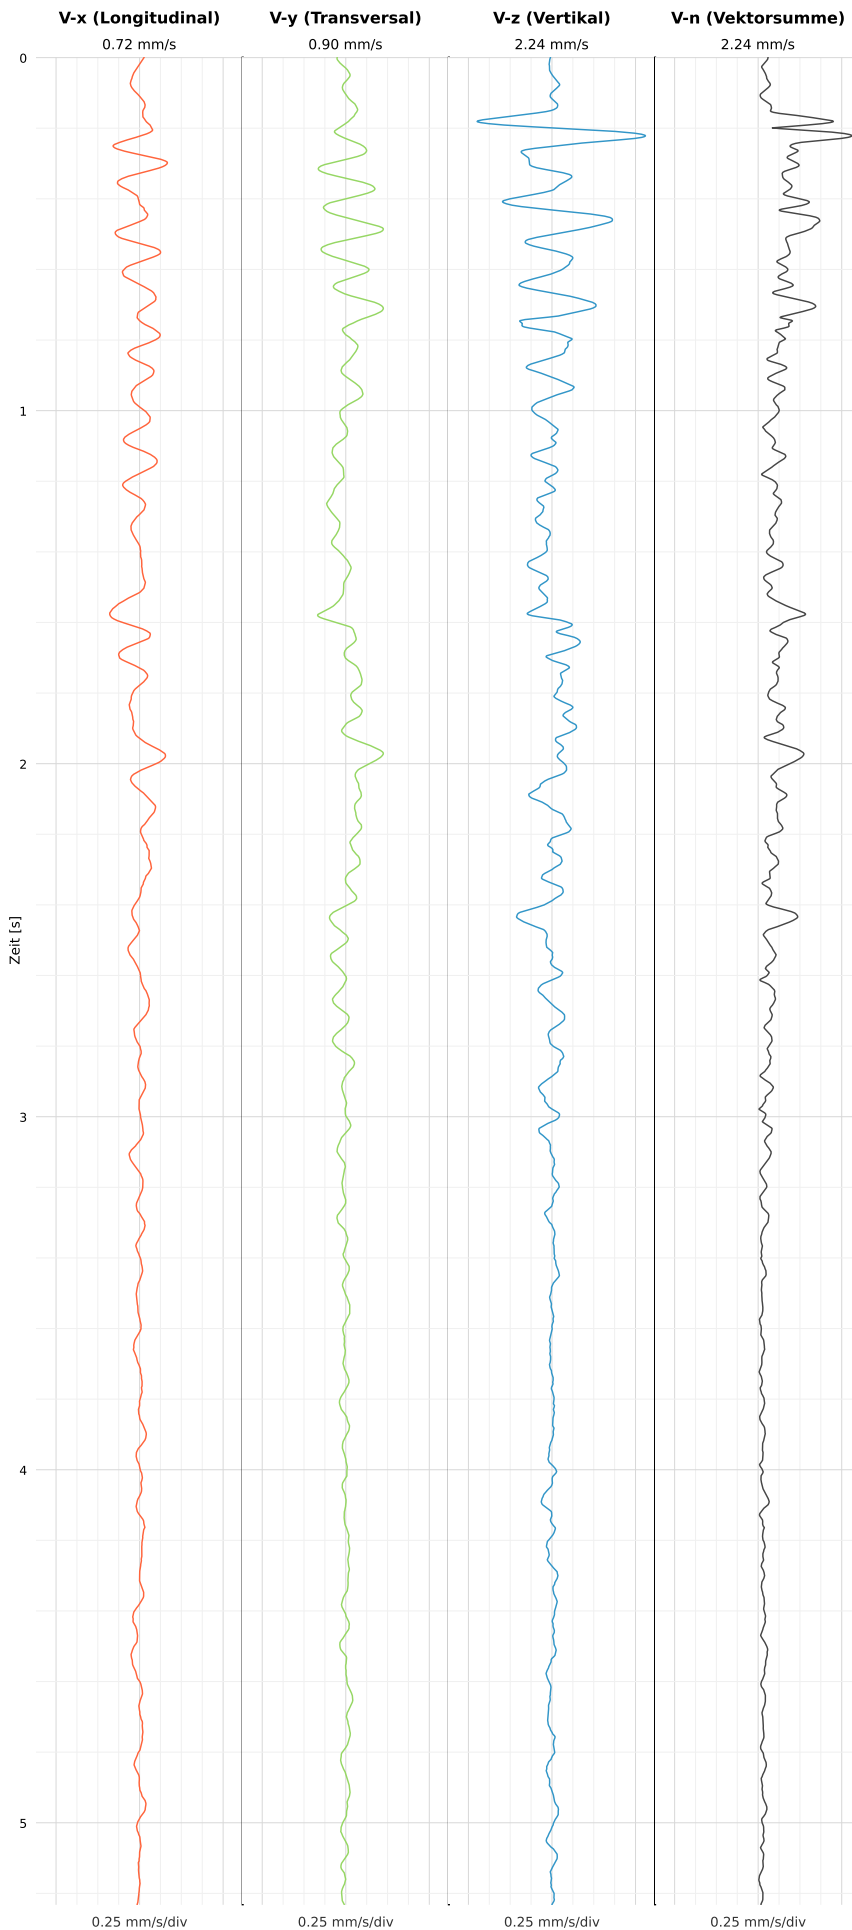


DATEI: 2493-HS-5-12052026-135402_raw.csv

Aufzeichnungsdauer: 5.23 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	15:54:02
Event-ID	2493-HS-5-12052026-135402
Status	Ereignis
X	0.72 mm/s @ 8.4 Hz
Y	0.90 mm/s @ 9.4 Hz
Z	2.24 mm/s @ 8.4 Hz
Vn	2.24 mm/s @ 8.4 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

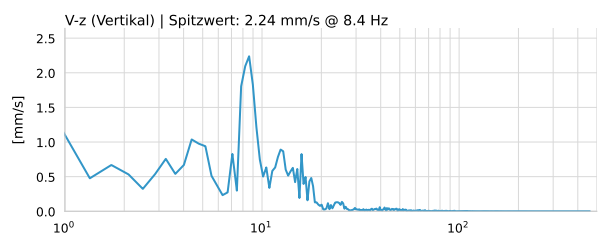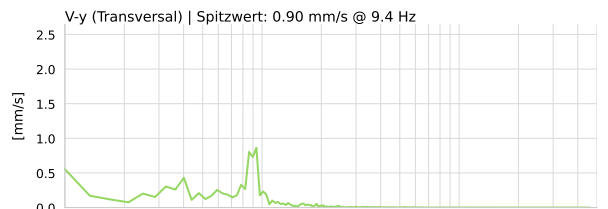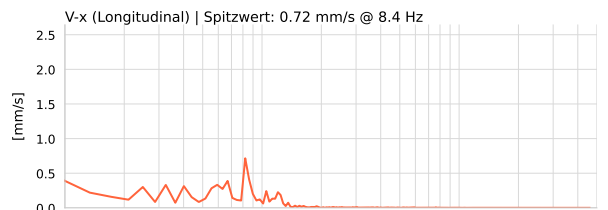

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	3.6 Hz	7.5 Hz	10.9 Hz
Y	9.4 Hz	3.2 Hz	8.2 Hz	9.7 Hz
Z	8.4 Hz	5.2 Hz	9.0 Hz	14.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

