


SCHWINGGESCHWINDIGKEIT



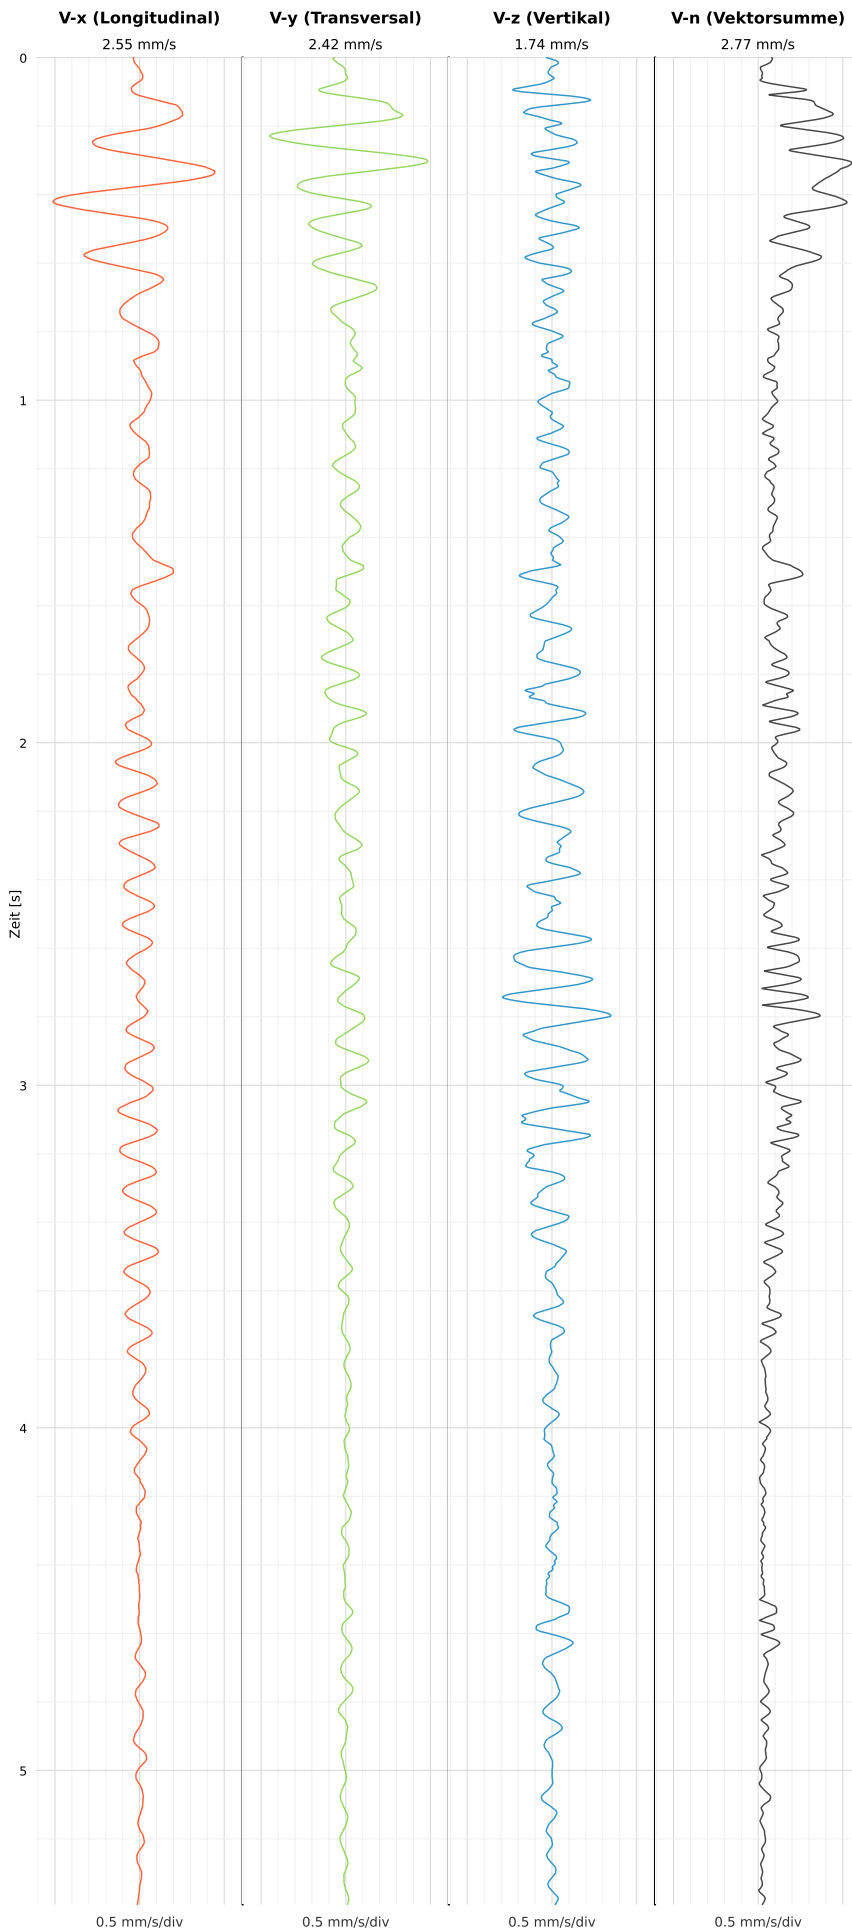


DATEI: 2493-HS-5-12052026-144727_raw.csv

Aufzeichnungsdauer: 5.39 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	16:47:27
Event-ID	2493-HS-5-12052026-144727
Status	Ereignis
X	2.55 mm/s @ 8.7 Hz
Y	2.42 mm/s @ 8.0 Hz
Z	1.74 mm/s @ 8.9 Hz
Vn	2.77 mm/s @ 8.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

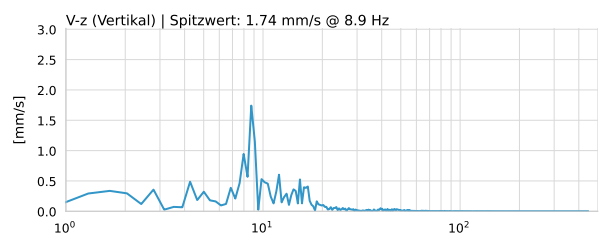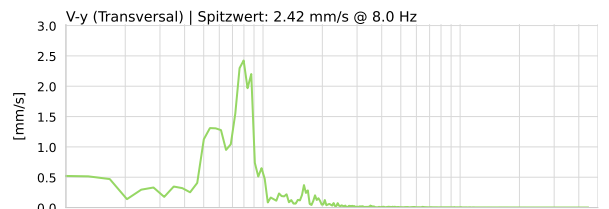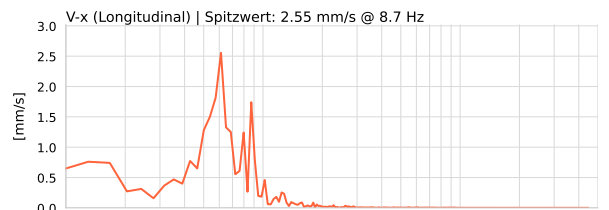

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	4.6 Hz	6.1 Hz	8.7 Hz
Y	8.0 Hz	5.7 Hz	8.0 Hz	9.8 Hz
Z	8.9 Hz	8.0 Hz	10.2 Hz	16.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

