


SCHWINGGESCHWINDIGKEIT

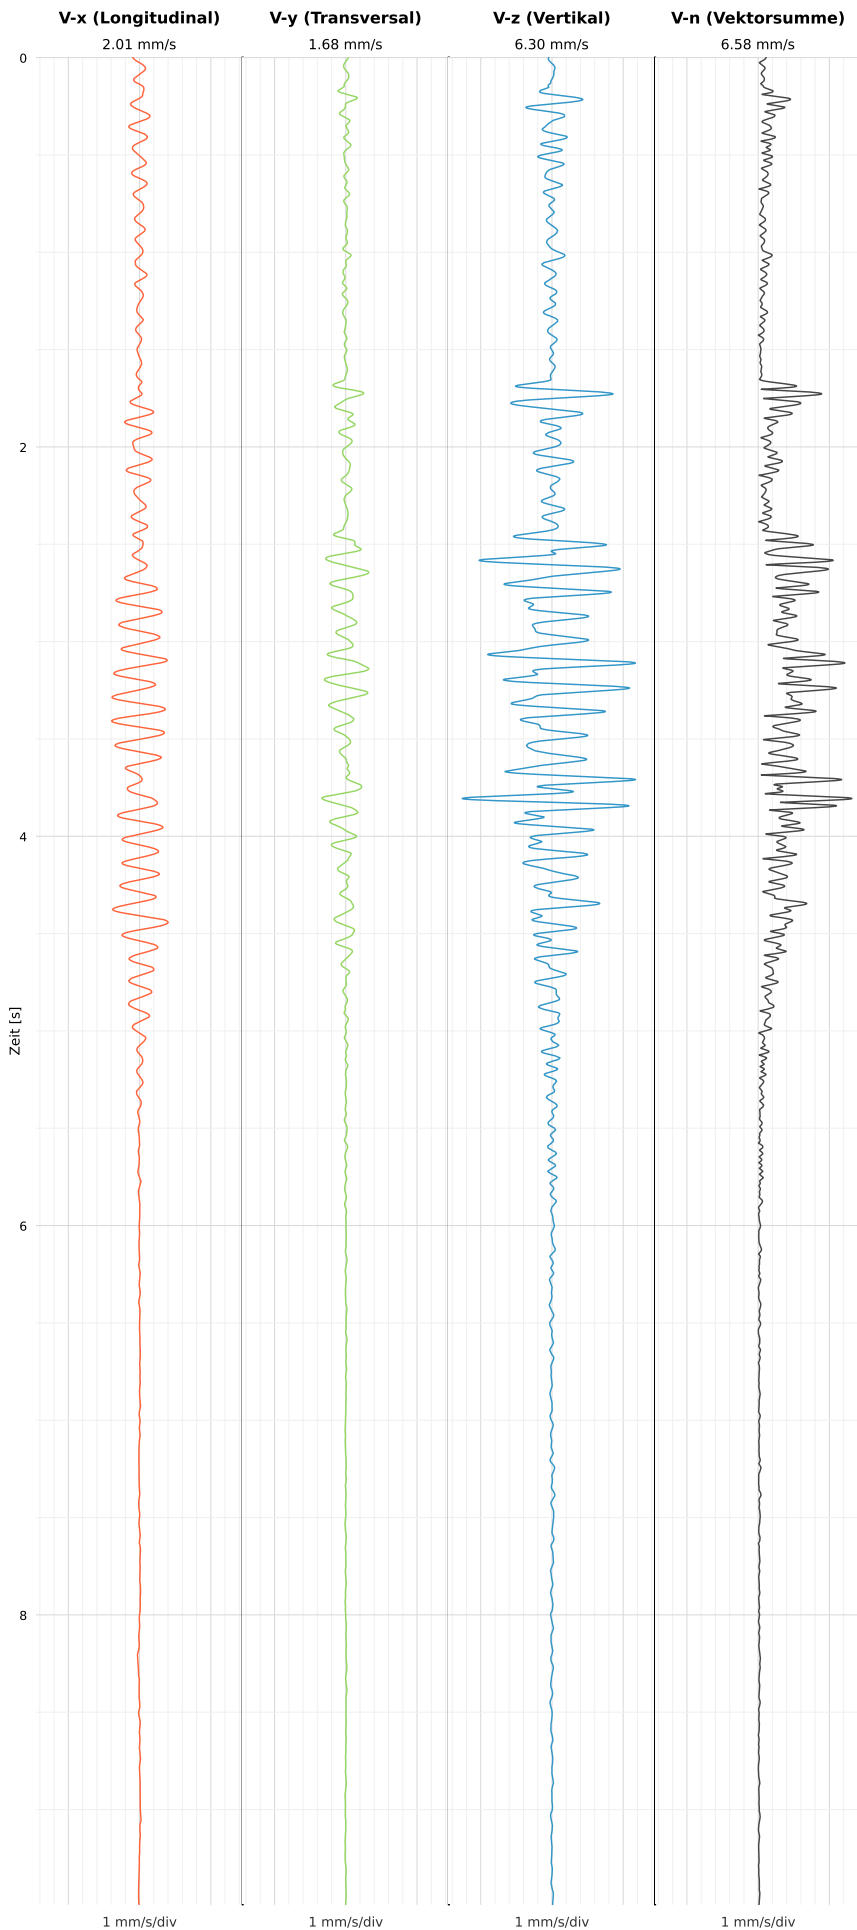


DATEI: 2493-HS-5-12052026-144744_raw.csv

Aufzeichnungsdauer: 9.49 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	16:47:44
Event-ID	2493-HS-5-12052026-144744
Status	Kritisch
X	2.01 mm/s @ 8.2 Hz
Y	1.68 mm/s @ 8.1 Hz
Z	6.30 mm/s @ 8.2 Hz
Vn	6.58 mm/s @ 8.2 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

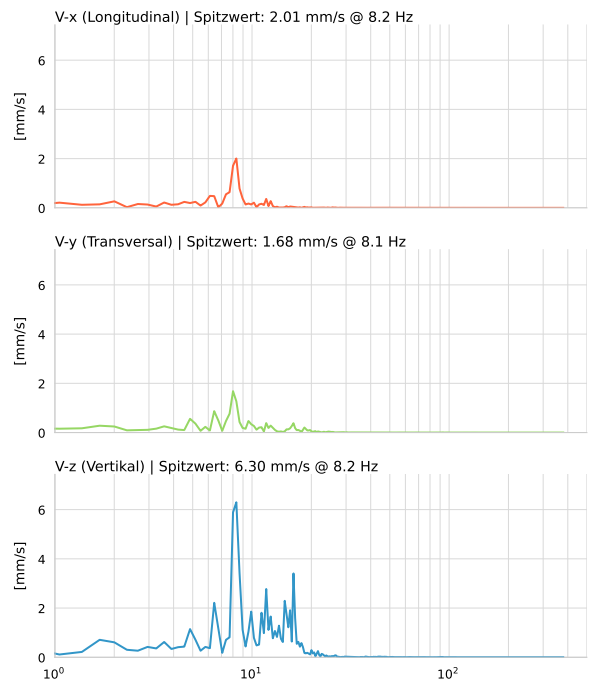

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.2 Hz	6.4 Hz	8.3 Hz	9.9 Hz
Y	8.1 Hz	6.4 Hz	8.3 Hz	12.8 Hz
Z	8.2 Hz	8.0 Hz	10.9 Hz	15.0 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

