


SCHWINGGESCHWINDIGKEIT

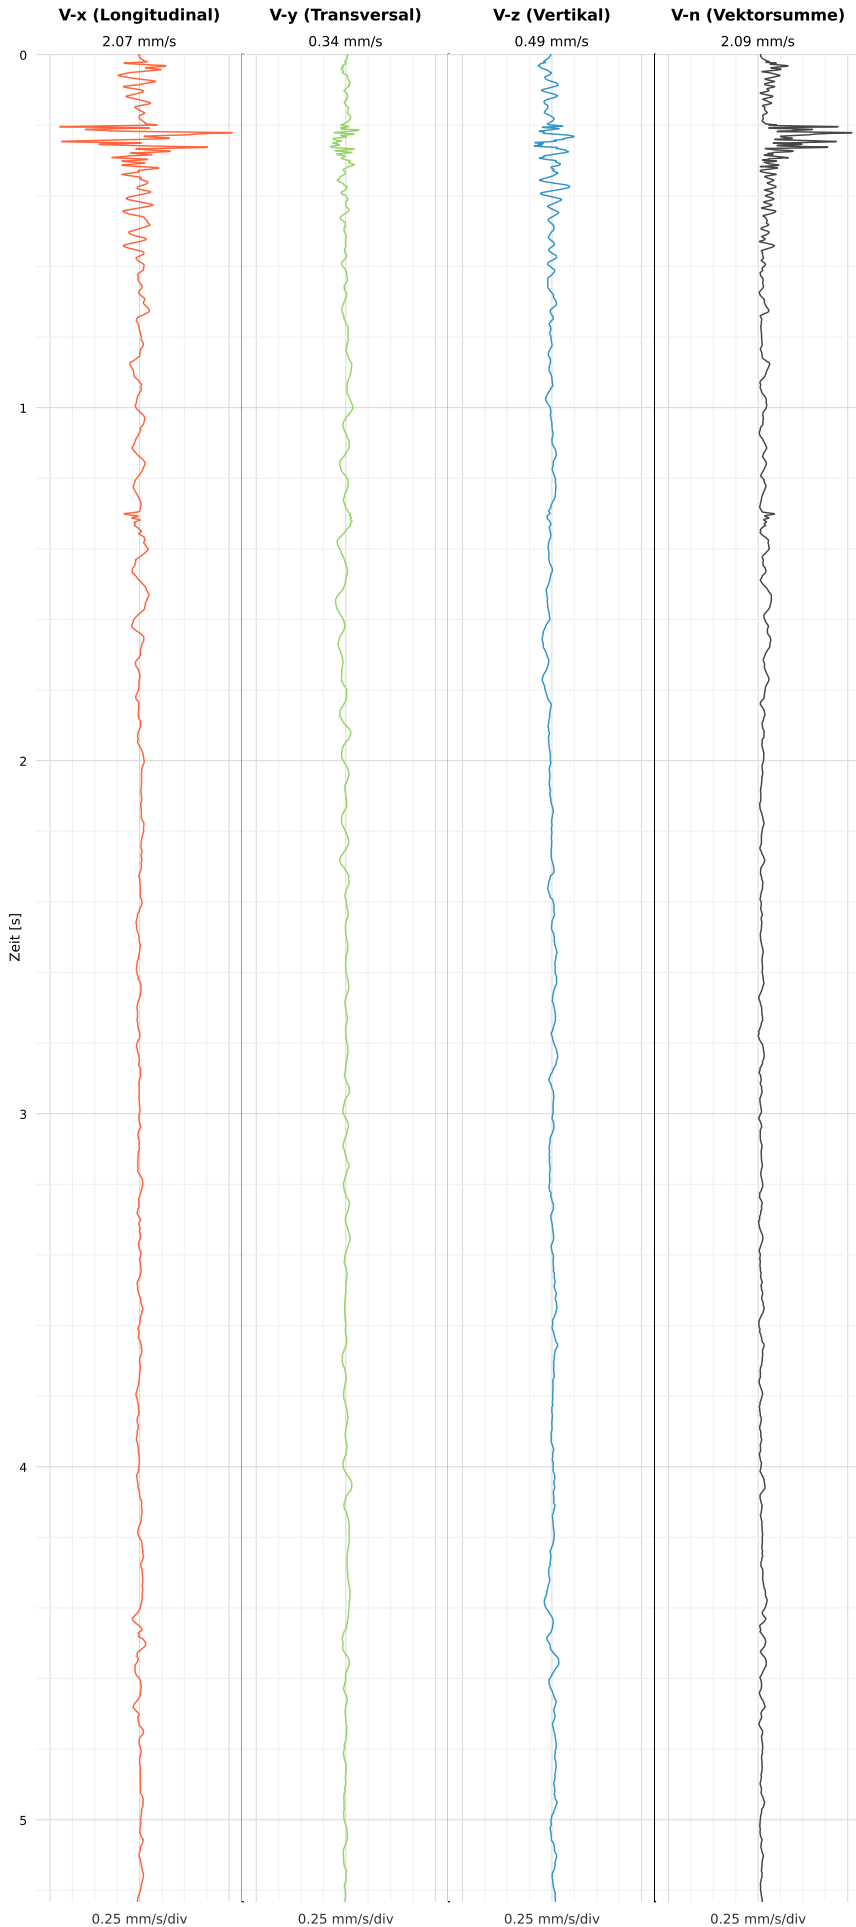


DATEI: 2493-HS-5-12052026-223520_raw.csv

Aufzeichnungsdauer: 5.23 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	00:35:20
Event-ID	2493-HS-5-12052026-223520
Status	Ereignis
X	2.07 mm/s @ 8.8 Hz
Y	0.34 mm/s @ 9.8 Hz
Z	0.49 mm/s @ 1.3 Hz
Vn	2.09 mm/s @ 8.8 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

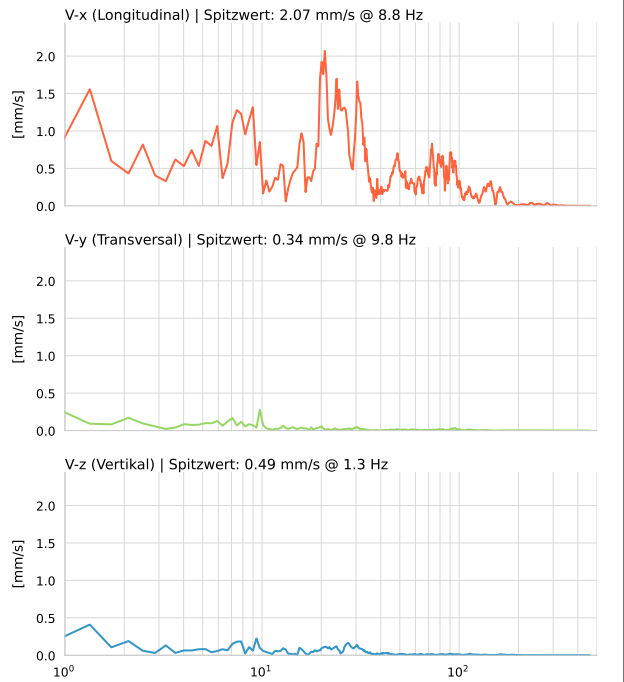

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.8 Hz	23.5 Hz	52.9 Hz	94.2 Hz
Y	9.8 Hz	6.7 Hz	25.0 Hz	91.6 Hz
Z	1.3 Hz	9.0 Hz	26.9 Hz	66.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

