


SCHWINGGESCHWINDIGKEIT

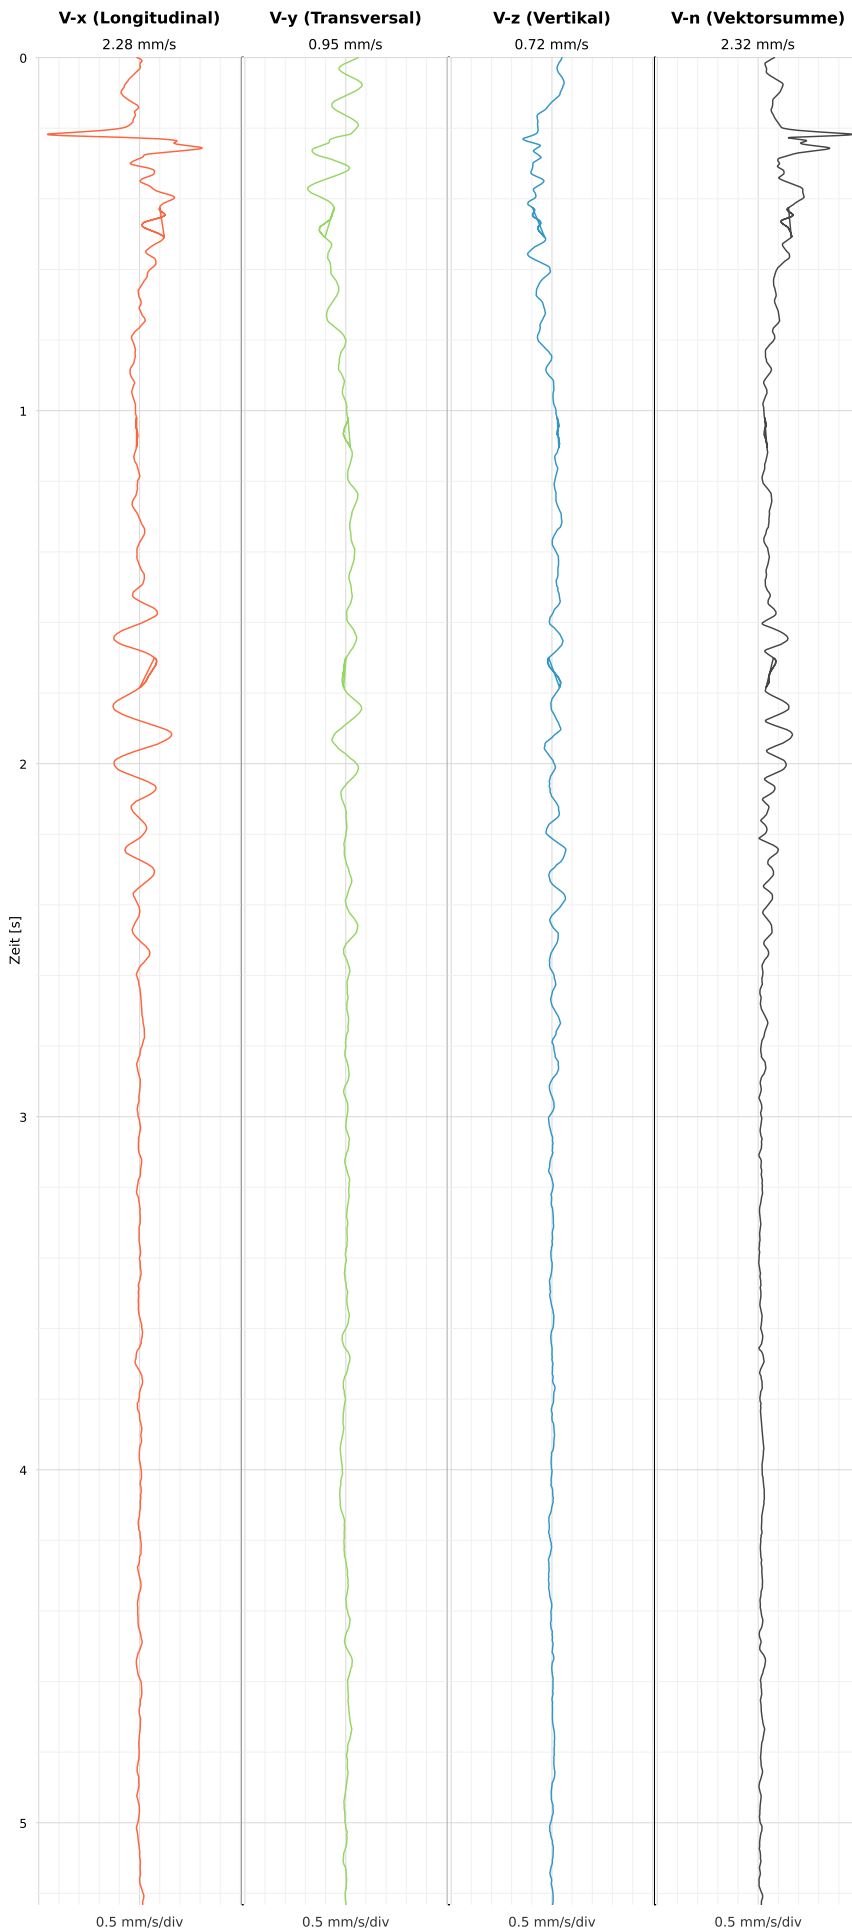


DATEI: 2493-HS-5-12052026-225218_raw.csv

Aufzeichnungsdauer: 5.23 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	00:52:18
Event-ID	2493-HS-5-12052026-225218
Status	Ereignis
X	2.28 mm/s @ 4.7 Hz
Y	0.95 mm/s @ 6.6 Hz
Z	0.72 mm/s @ 8.6 Hz
Vn	2.32 mm/s @ 5.0 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

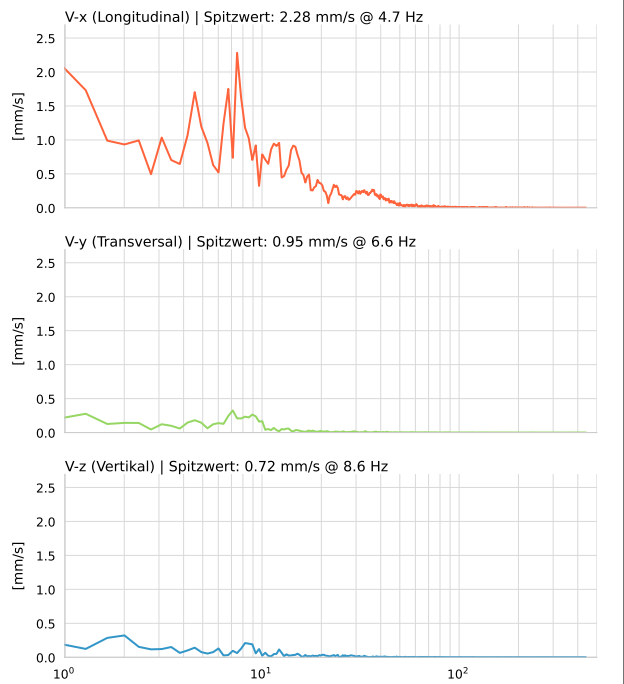

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	4.7 Hz	5.3 Hz	11.5 Hz	25.0 Hz
Y	6.6 Hz	1.3 Hz	7.1 Hz	13.3 Hz
Z	8.6 Hz	1.6 Hz	8.2 Hz	24.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

