


SCHWINGGESCHWINDIGKEIT



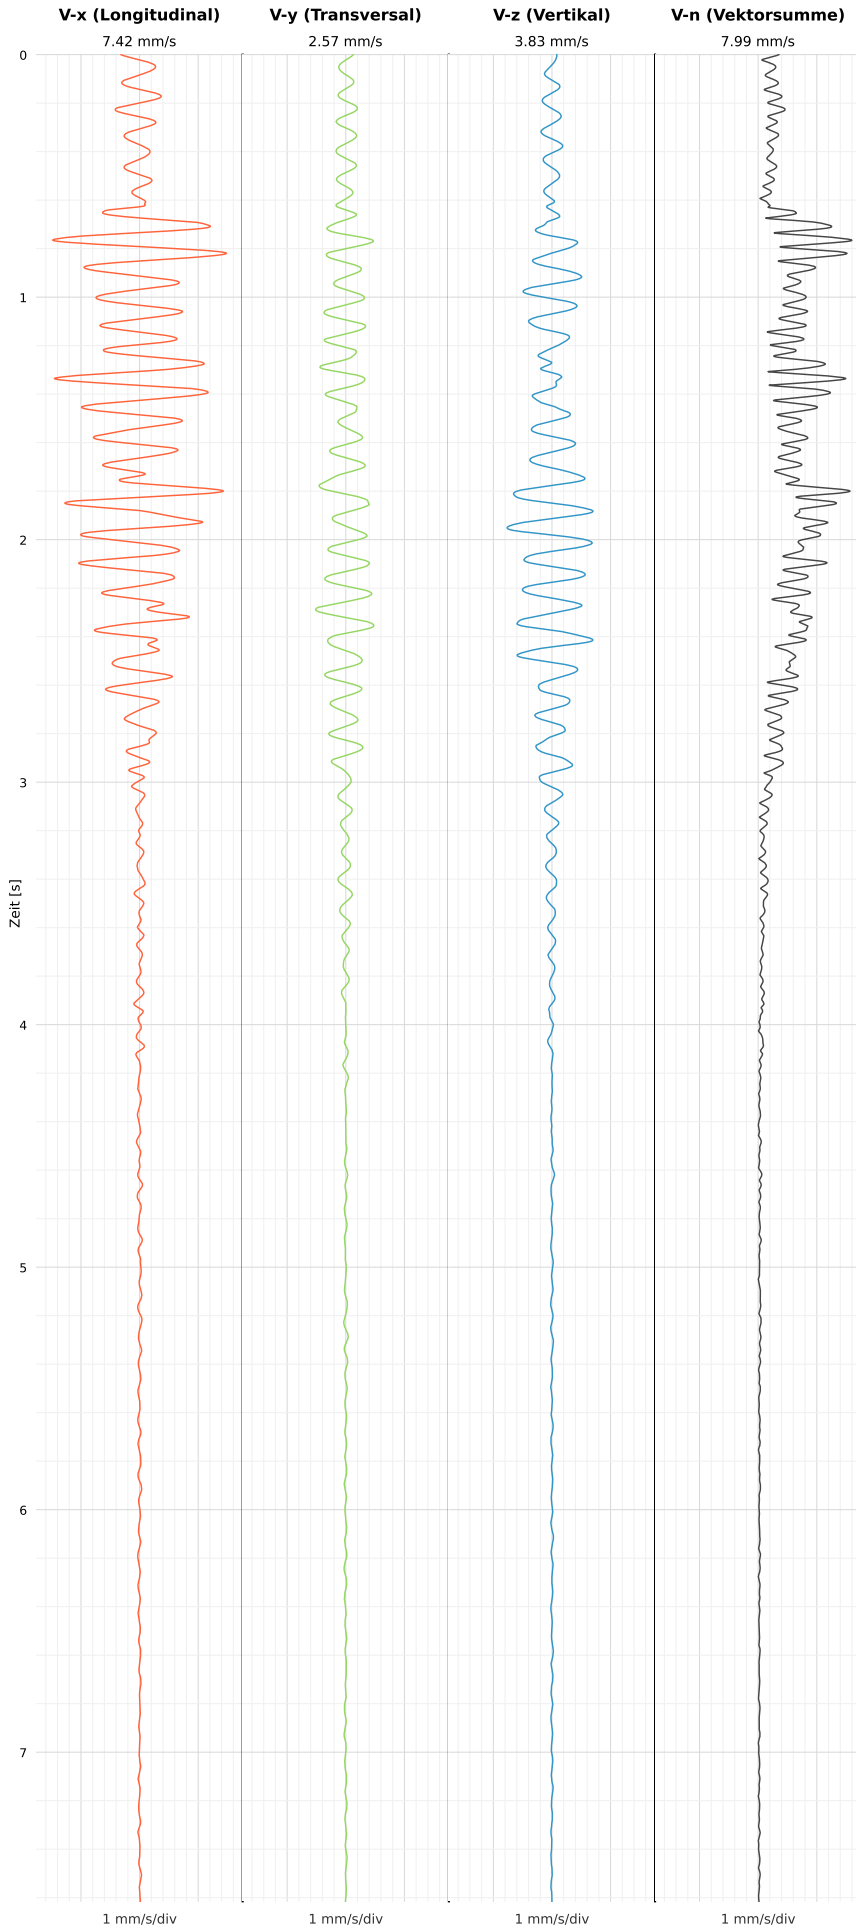


DATEI: 2493-HS-5-12052026-230402_raw.csv

Aufzeichnungsdauer: 7.62 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	01:04:02
Event-ID	2493-HS-5-12052026-230402
Status	Kritisch
X	7.42 mm/s @ 7.9 Hz
Y	2.57 mm/s @ 8.0 Hz
Z	3.83 mm/s @ 7.6 Hz
Vn	7.99 mm/s @ 7.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

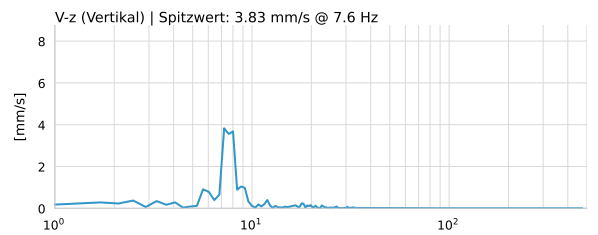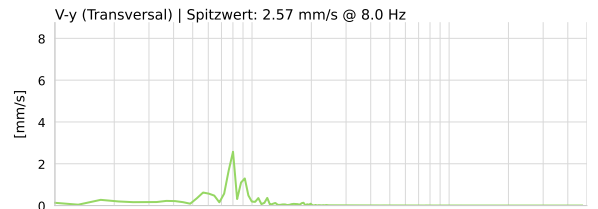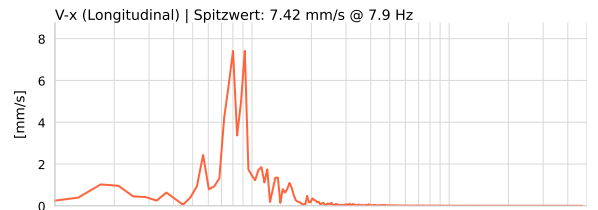

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.9 Hz	7.6 Hz	9.2 Hz	12.7 Hz
Y	8.0 Hz	6.8 Hz	8.0 Hz	10.4 Hz
Z	7.6 Hz	7.2 Hz	7.6 Hz	9.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

