


SCHWINGGESCHWINDIGKEIT

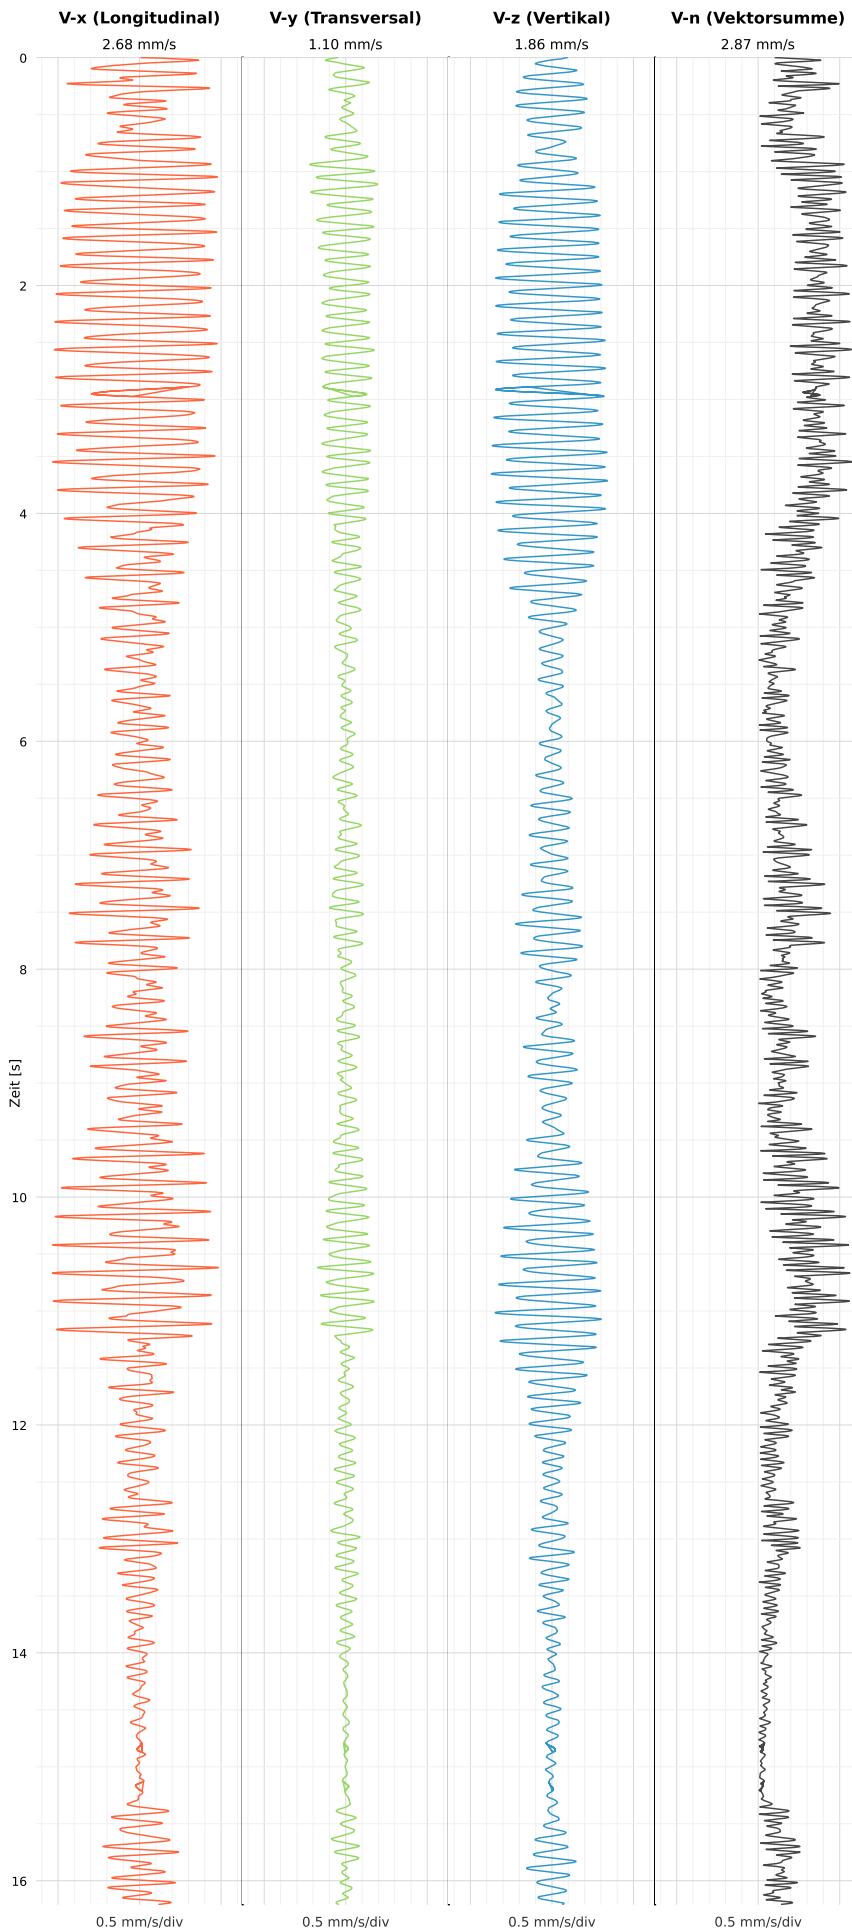


DATEI: 2493-HS-5-13052026-090208_raw.csv

Aufzeichnungsdauer: 16.21 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:02:08
Event-ID	2493-HS-5-13052026-090208
Status	Ereignis
X	2.68 mm/s @ 7.9 Hz
Y	1.10 mm/s @ 7.9 Hz
Z	1.86 mm/s @ 7.9 Hz
Vn	2.87 mm/s @ 7.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

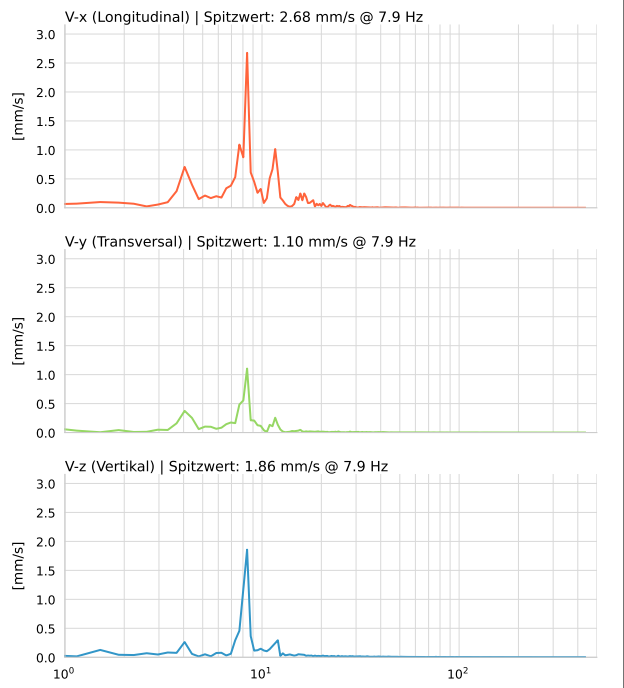

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.9 Hz	7.7 Hz	8.8 Hz	14.6 Hz
Y	7.9 Hz	7.3 Hz	8.4 Hz	14.9 Hz
Z	7.9 Hz	8.0 Hz	9.1 Hz	31.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

