


SCHWINGGESCHWINDIGKEIT

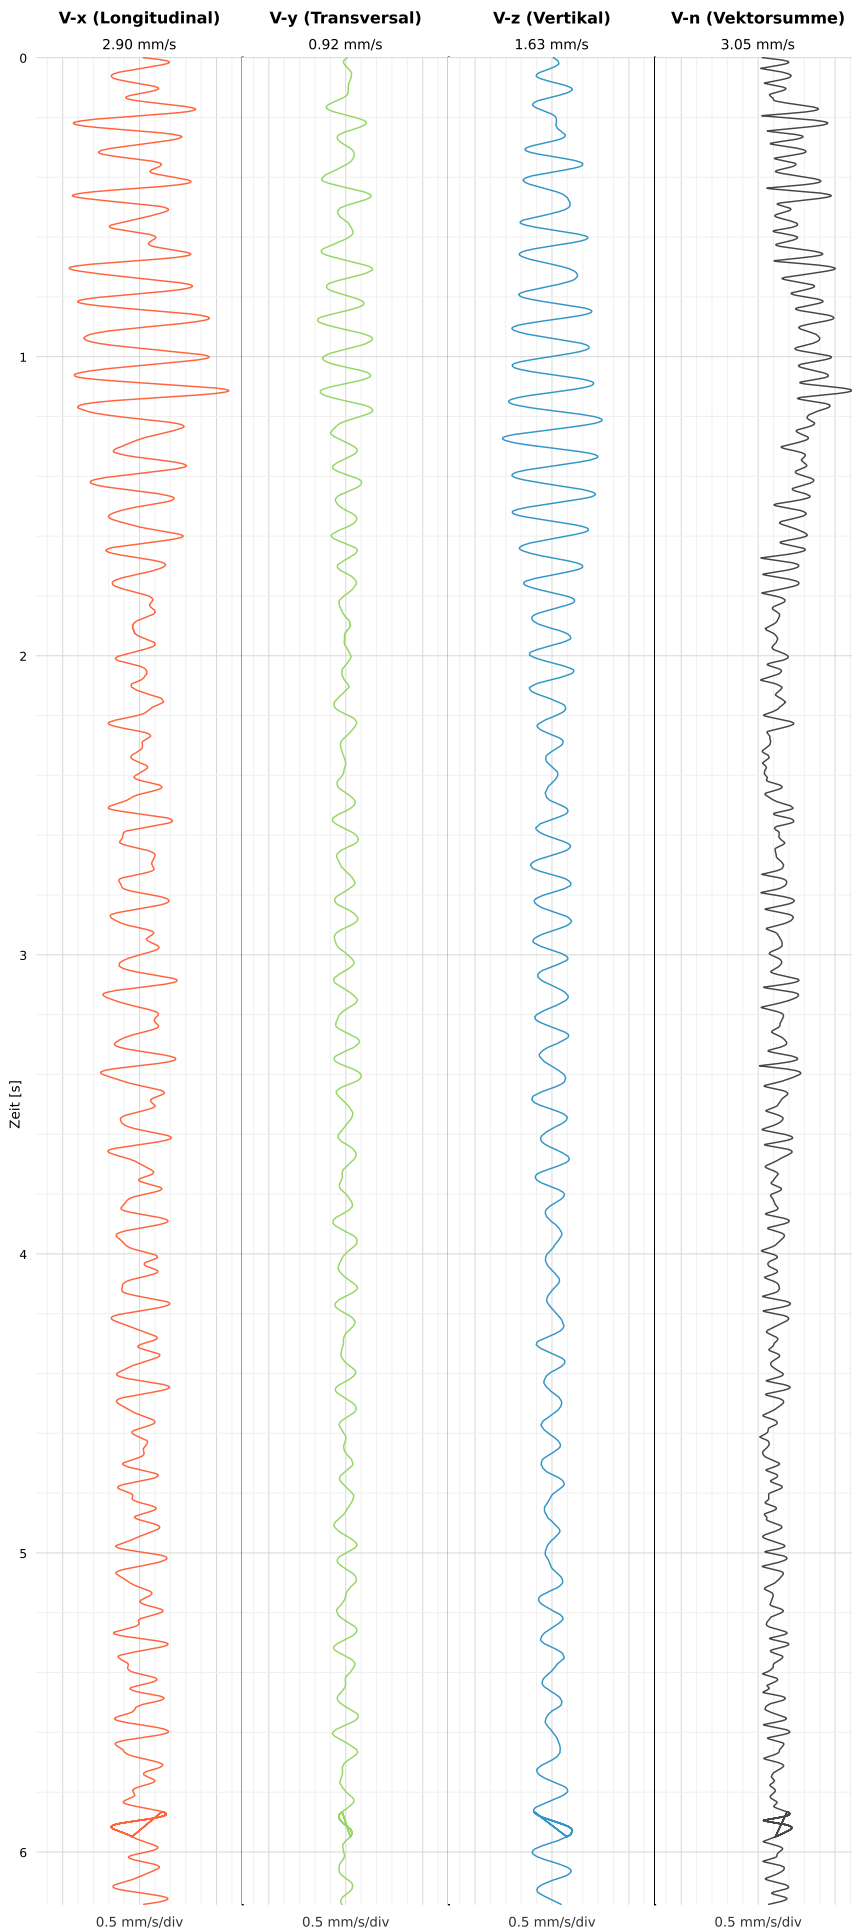


DATEI: 2493-HS-5-13052026-090258_raw.csv

Aufzeichnungsdauer: 6.18 s | Abtastrate: 1000 Hz

Datum	13.05.2026
Zeit	11:02:58
Event-ID	2493-HS-5-13052026-090258
Status	Ereignis
X	2.90 mm/s @ 7.6 Hz
Y	0.92 mm/s @ 7.6 Hz
Z	1.63 mm/s @ 8.2 Hz
Vn	3.05 mm/s @ 7.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

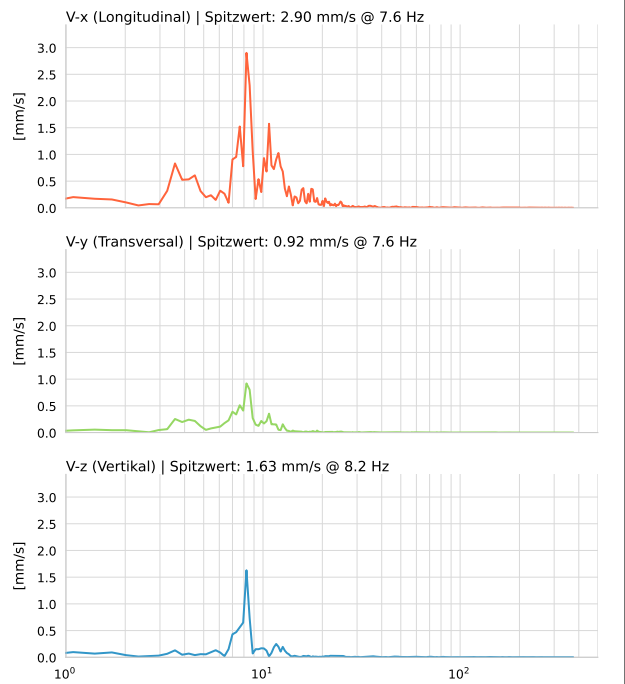

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	7.6 Hz	7.9 Hz	10.4 Hz	15.7 Hz
Y	7.6 Hz	7.0 Hz	8.6 Hz	11.4 Hz
Z	8.2 Hz	7.6 Hz	8.6 Hz	24.7 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

