


SCHWINGGESCHWINDIGKEIT

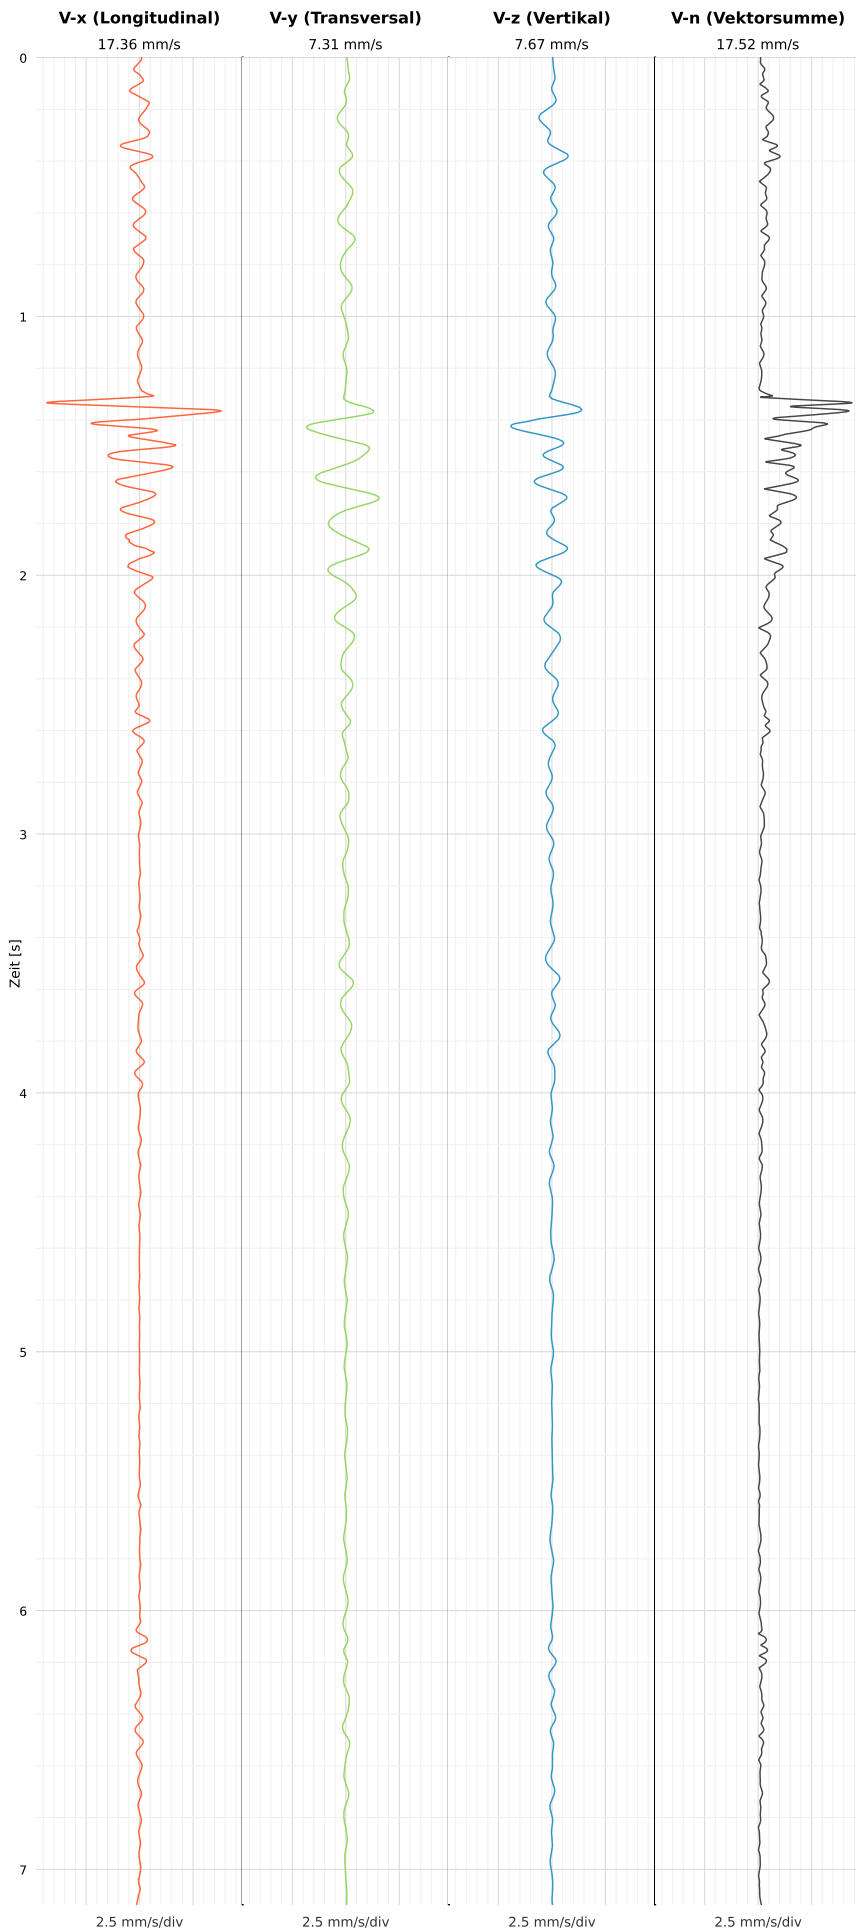


DATEI: 2493-HS5-15052026-140503_raw.csv

Aufzeichnungsdauer: 7.14 s | Abtastrate: 1000 Hz

Datum	15.05.2026
Zeit	14:05:03
Event-ID	2493-HS5-15052026-140503
Status	Kritisch
X	17.36 mm/s @ 9.7 Hz
Y	7.31 mm/s @ 5.9 Hz
Z	7.67 mm/s @ 5.9 Hz
Vn	17.52 mm/s @ 9.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

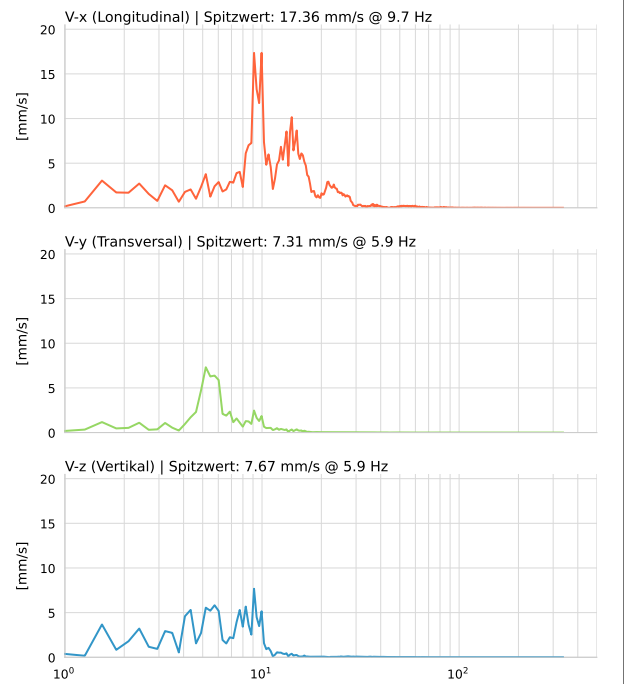

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.7 Hz	9.4 Hz	13.3 Hz	18.1 Hz
Y	5.9 Hz	5.2 Hz	6.0 Hz	8.8 Hz
Z	5.9 Hz	4.3 Hz	7.1 Hz	9.1 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

