


SCHWINGGESCHWINDIGKEIT

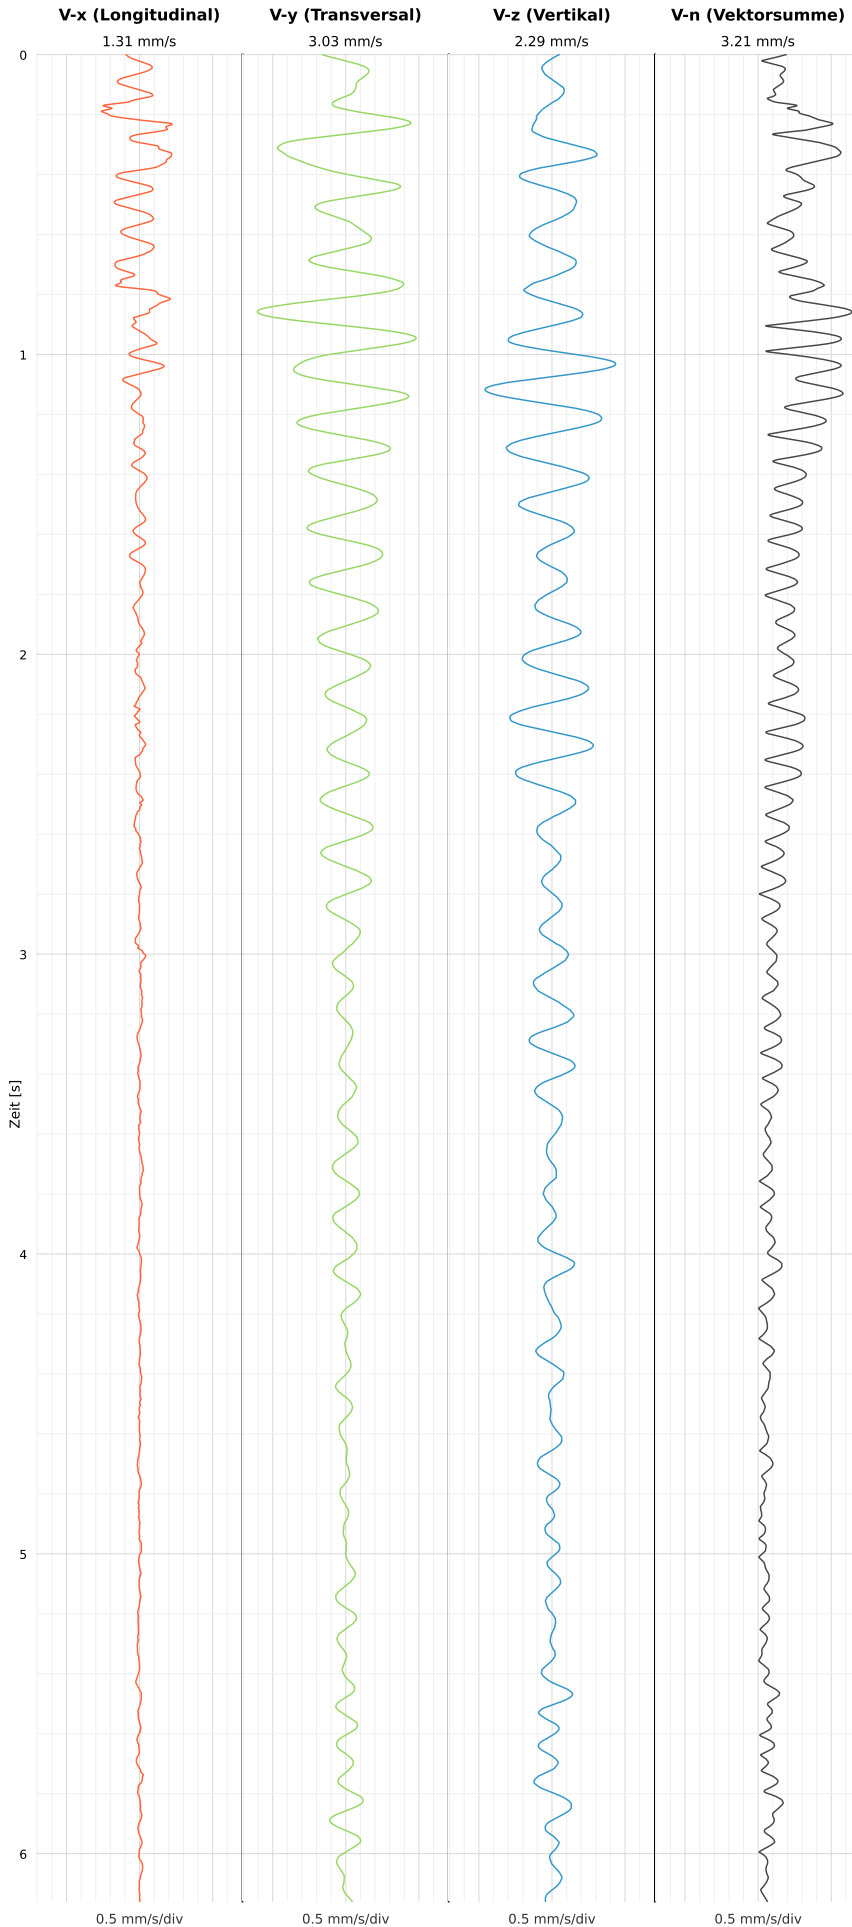


DATEI: 2493-HS5-17052026-121356_raw.csv

Aufzeichnungsdauer: 6.16 s | Abtastrate: 1000 Hz

Datum	17.05.2026
Zeit	12:13:56
Event-ID	2493-HS5-17052026-121356
Status	Hinweis
X	1.31 mm/s @ 5.5 Hz
Y	3.03 mm/s @ 5.7 Hz
Z	2.29 mm/s @ 5.7 Hz
Vn	3.21 mm/s @ 5.7 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

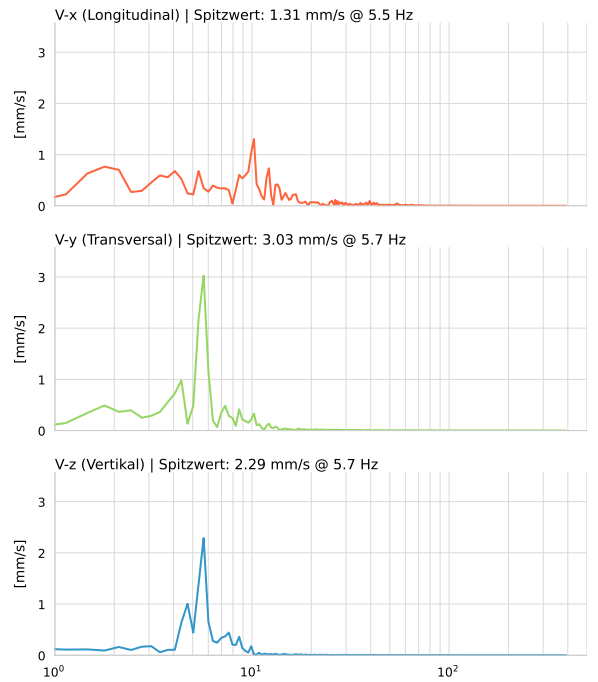

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	5.5 Hz	5.4 Hz	10.2 Hz	17.4 Hz
Y	5.7 Hz	4.4 Hz	5.7 Hz	9.6 Hz
Z	5.7 Hz	5.0 Hz	5.7 Hz	7.6 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

