


SCHWINGGESCHWINDIGKEIT

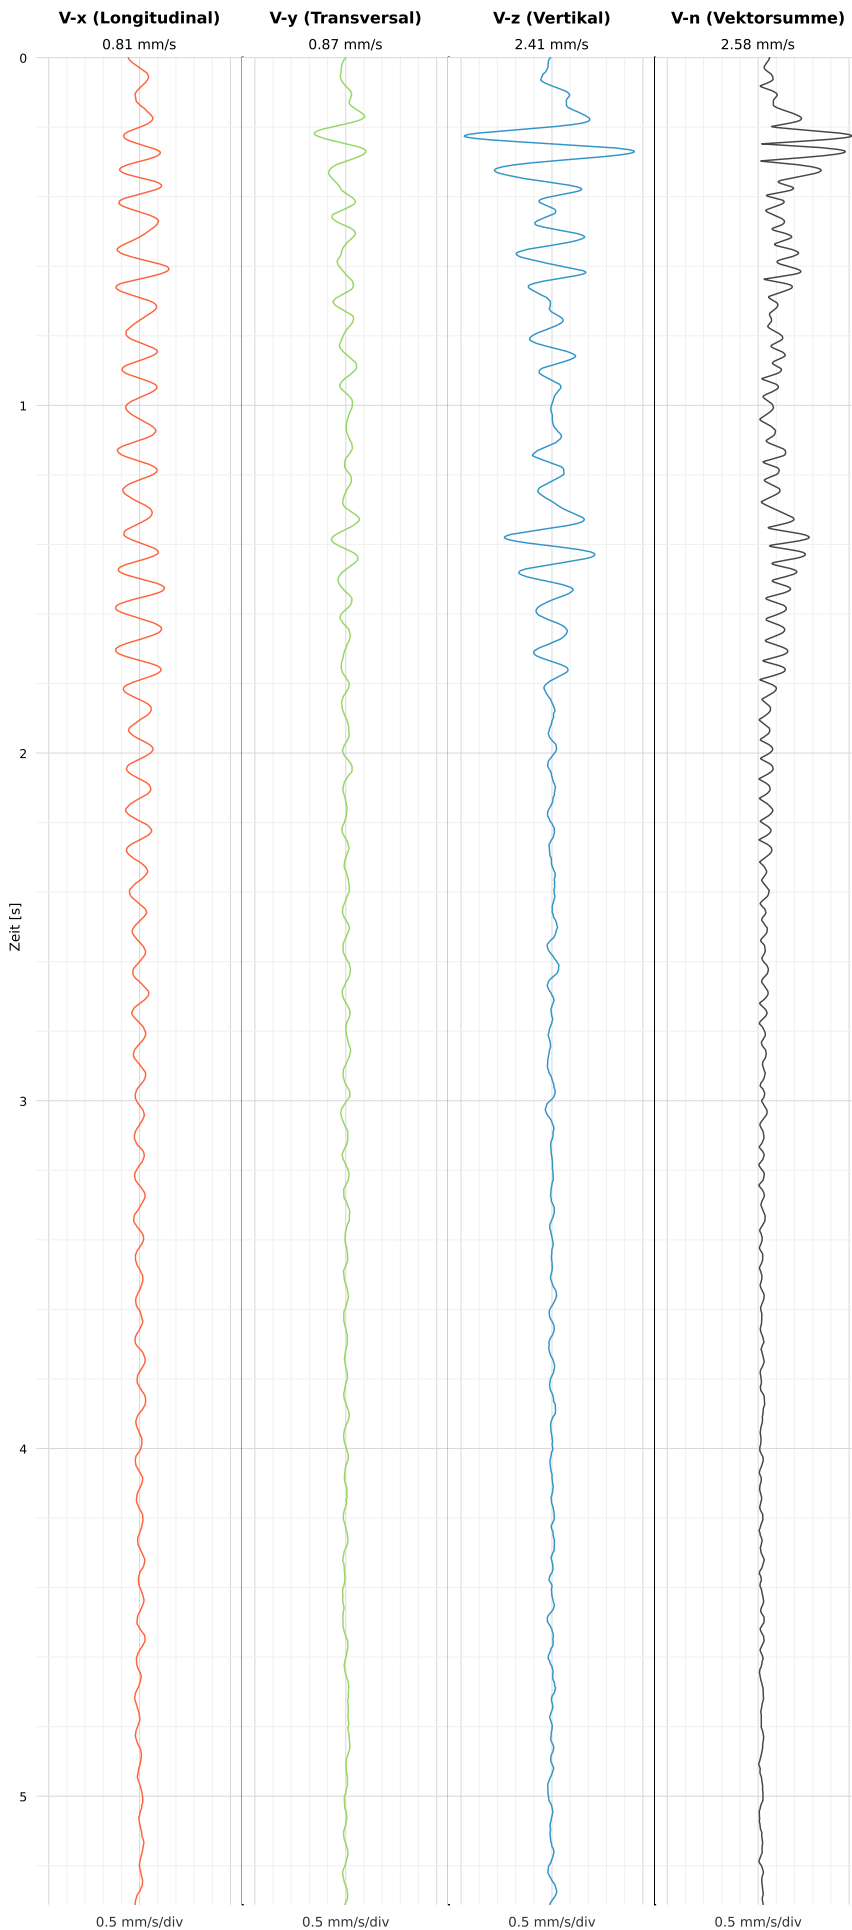


DATEI: 2493-PG-4-12052026-065010_raw.csv

Aufzeichnungsdauer: 5.31 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	08:50:10
Event-ID	2493-PG-4-12052026-065010
Status	Ereignis
X	0.81 mm/s @ 8.7 Hz
Y	0.87 mm/s @ 8.5 Hz
Z	2.41 mm/s @ 8.5 Hz
Vn	2.58 mm/s @ 8.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

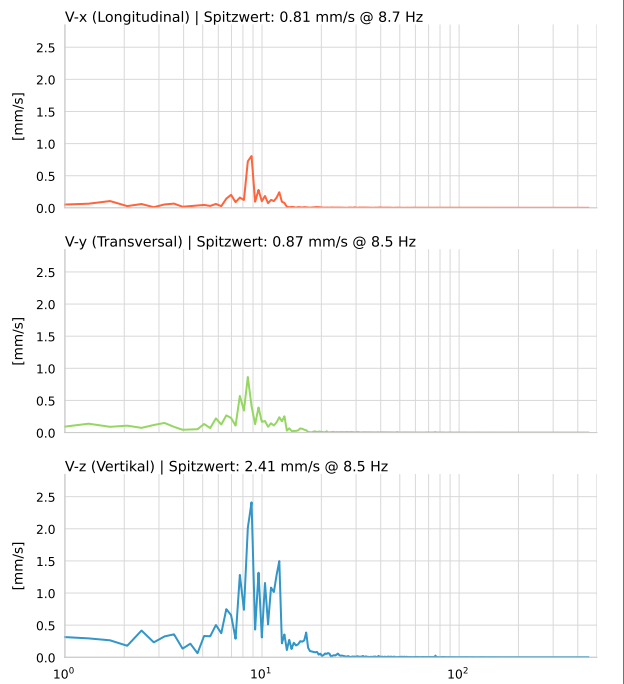

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.7 Hz	7.7 Hz	8.8 Hz	11.9 Hz
Y	8.5 Hz	6.6 Hz	8.5 Hz	11.9 Hz
Z	8.5 Hz	7.7 Hz	9.6 Hz	12.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

