


SCHWINGGESCHWINDIGKEIT

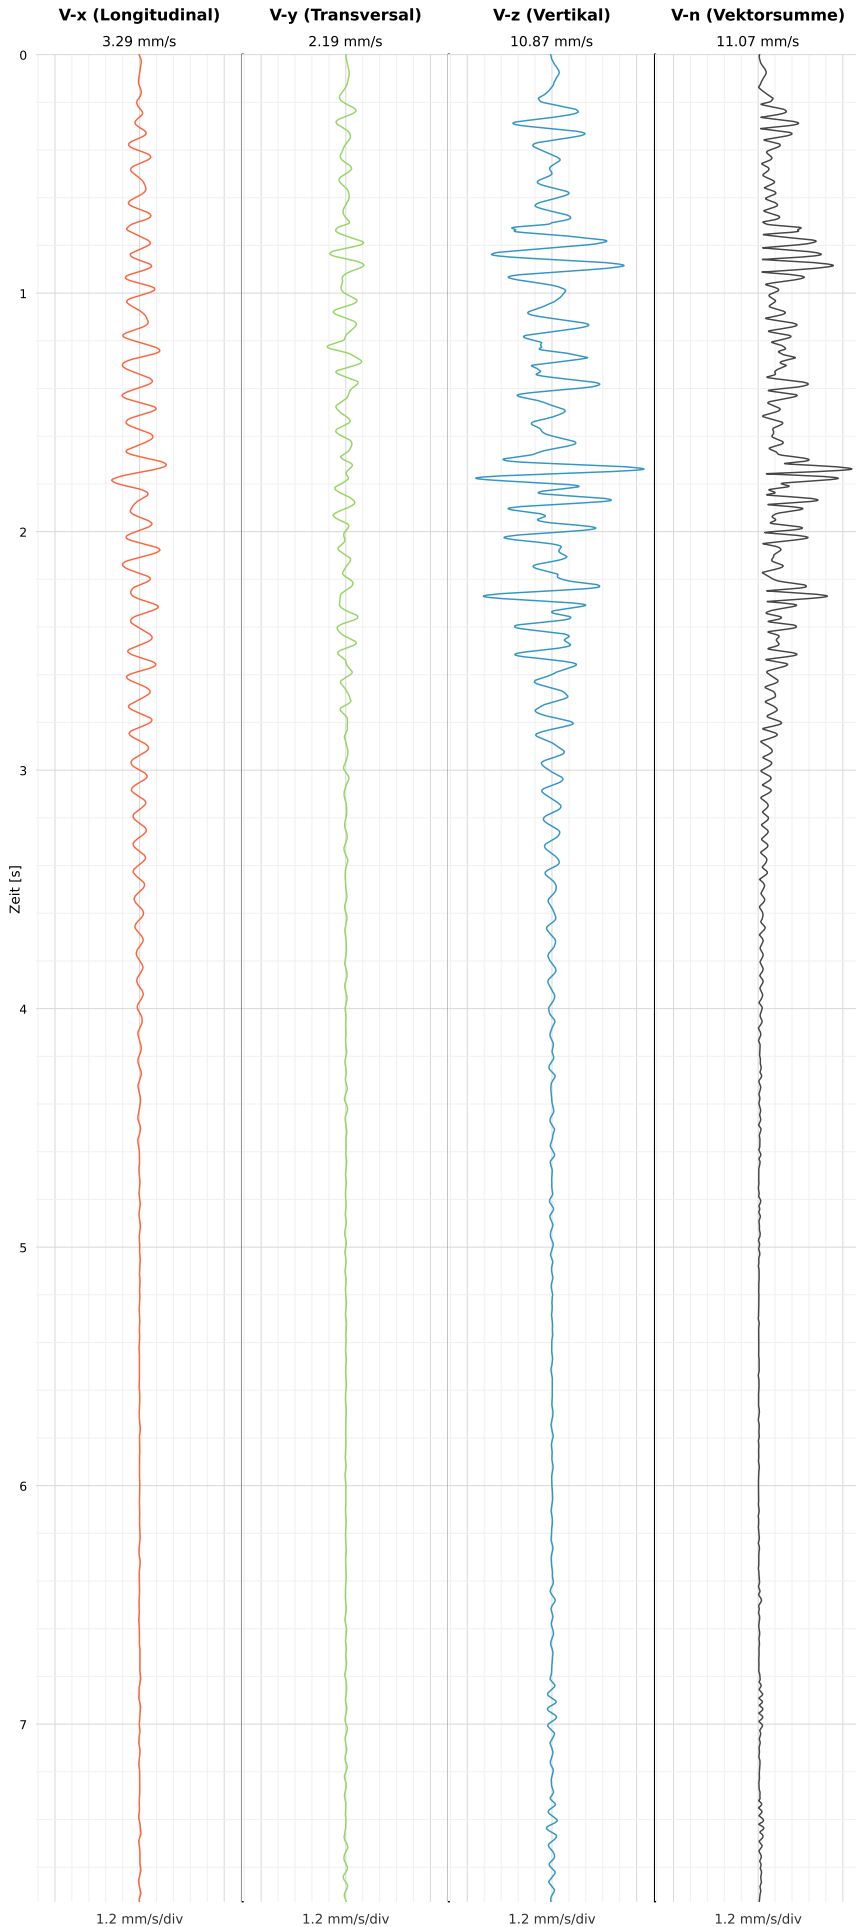


DATEI: 2493-PG-4-12052026-065237_raw.csv

Aufzeichnungsdauer: 7.74 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	08:52:37
Event-ID	2493-PG-4-12052026-065237
Status	Kritisch
X	3.29 mm/s @ 8.5 Hz
Y	2.19 mm/s @ 8.5 Hz
Z	10.87 mm/s @ 8.5 Hz
Vn	11.07 mm/s @ 8.5 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

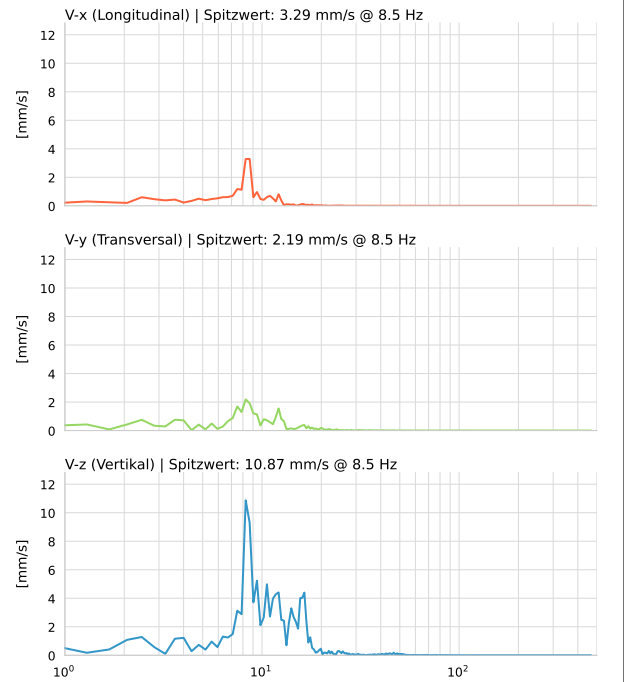

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.5 Hz	6.3 Hz	8.3 Hz	9.8 Hz
Y	8.5 Hz	7.1 Hz	8.7 Hz	12.1 Hz
Z	8.5 Hz	8.3 Hz	11.0 Hz	15.2 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

