


SCHWINGGESCHWINDIGKEIT

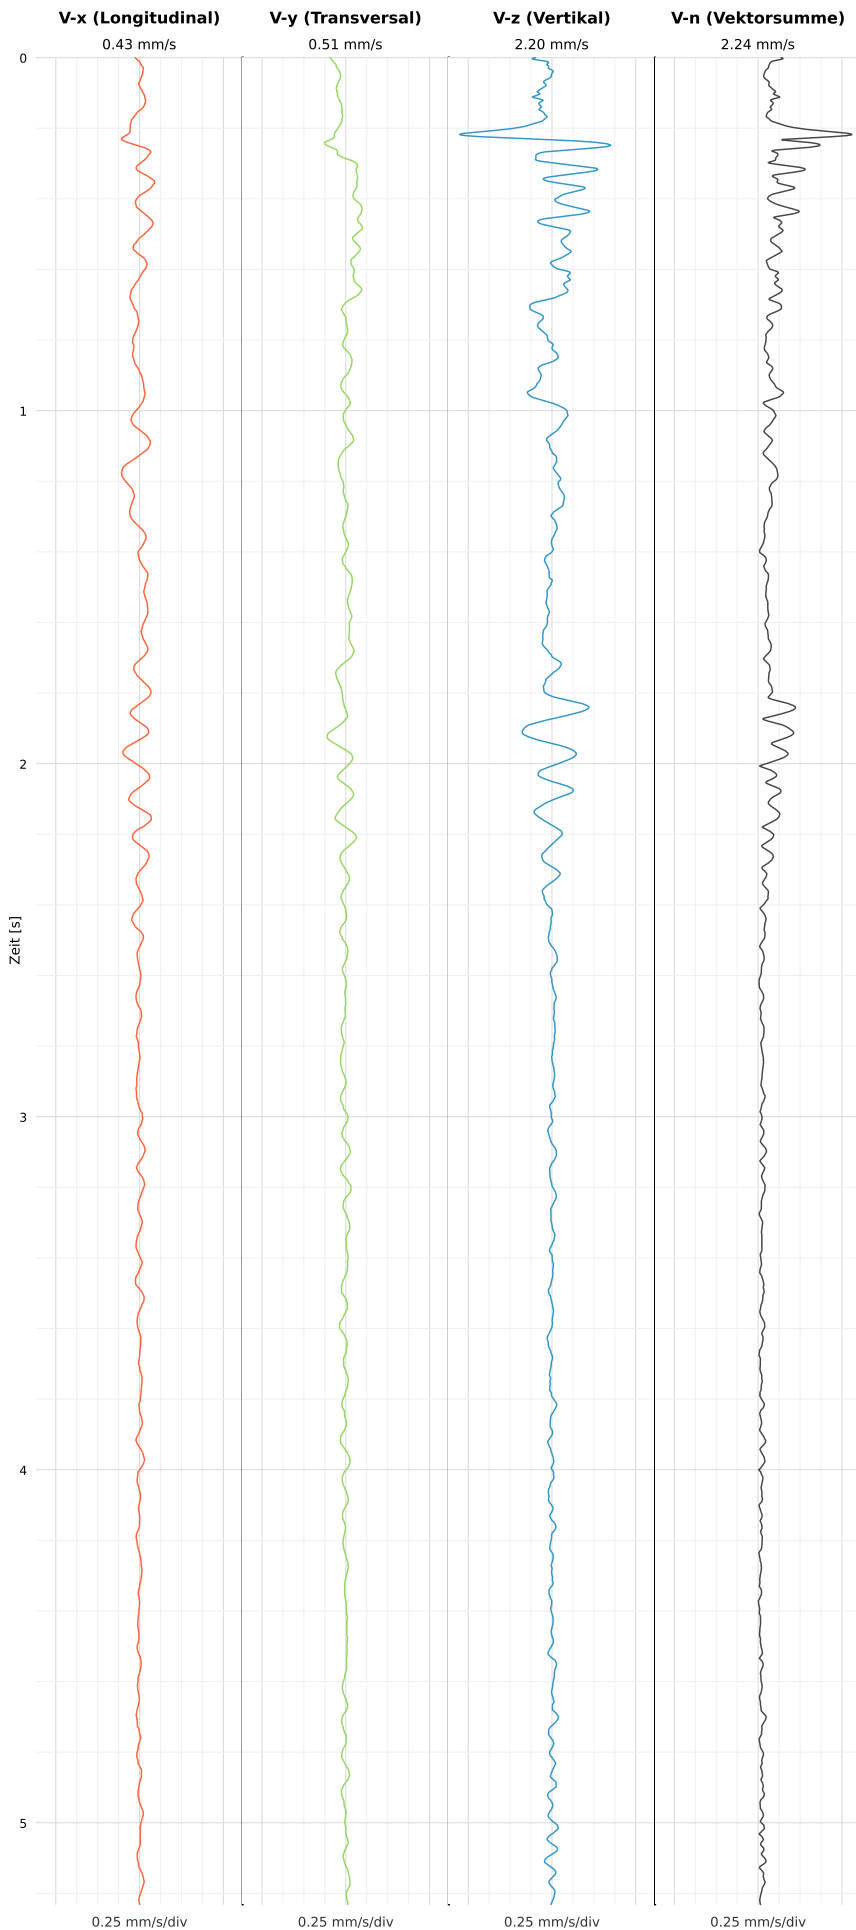


DATEI: 2493-PG-4-12052026-121746_raw.csv

Aufzeichnungsdauer: 5.23 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	14:17:46
Event-ID	2493-PG-4-12052026-121746
Status	Ereignis
X	0.43 mm/s @ 8.6 Hz
Y	0.51 mm/s @ 9.0 Hz
Z	2.20 mm/s @ 8.6 Hz
Vn	2.24 mm/s @ 8.6 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

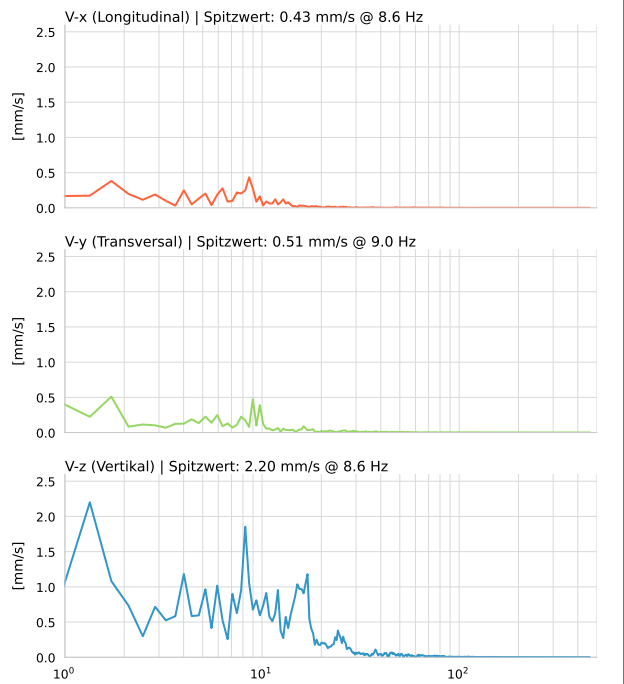

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.6 Hz	3.6 Hz	7.8 Hz	12.4 Hz
Y	9.0 Hz	3.6 Hz	9.0 Hz	26.6 Hz
Z	8.6 Hz	5.9 Hz	12.0 Hz	18.5 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

