


SCHWINGGESCHWINDIGKEIT

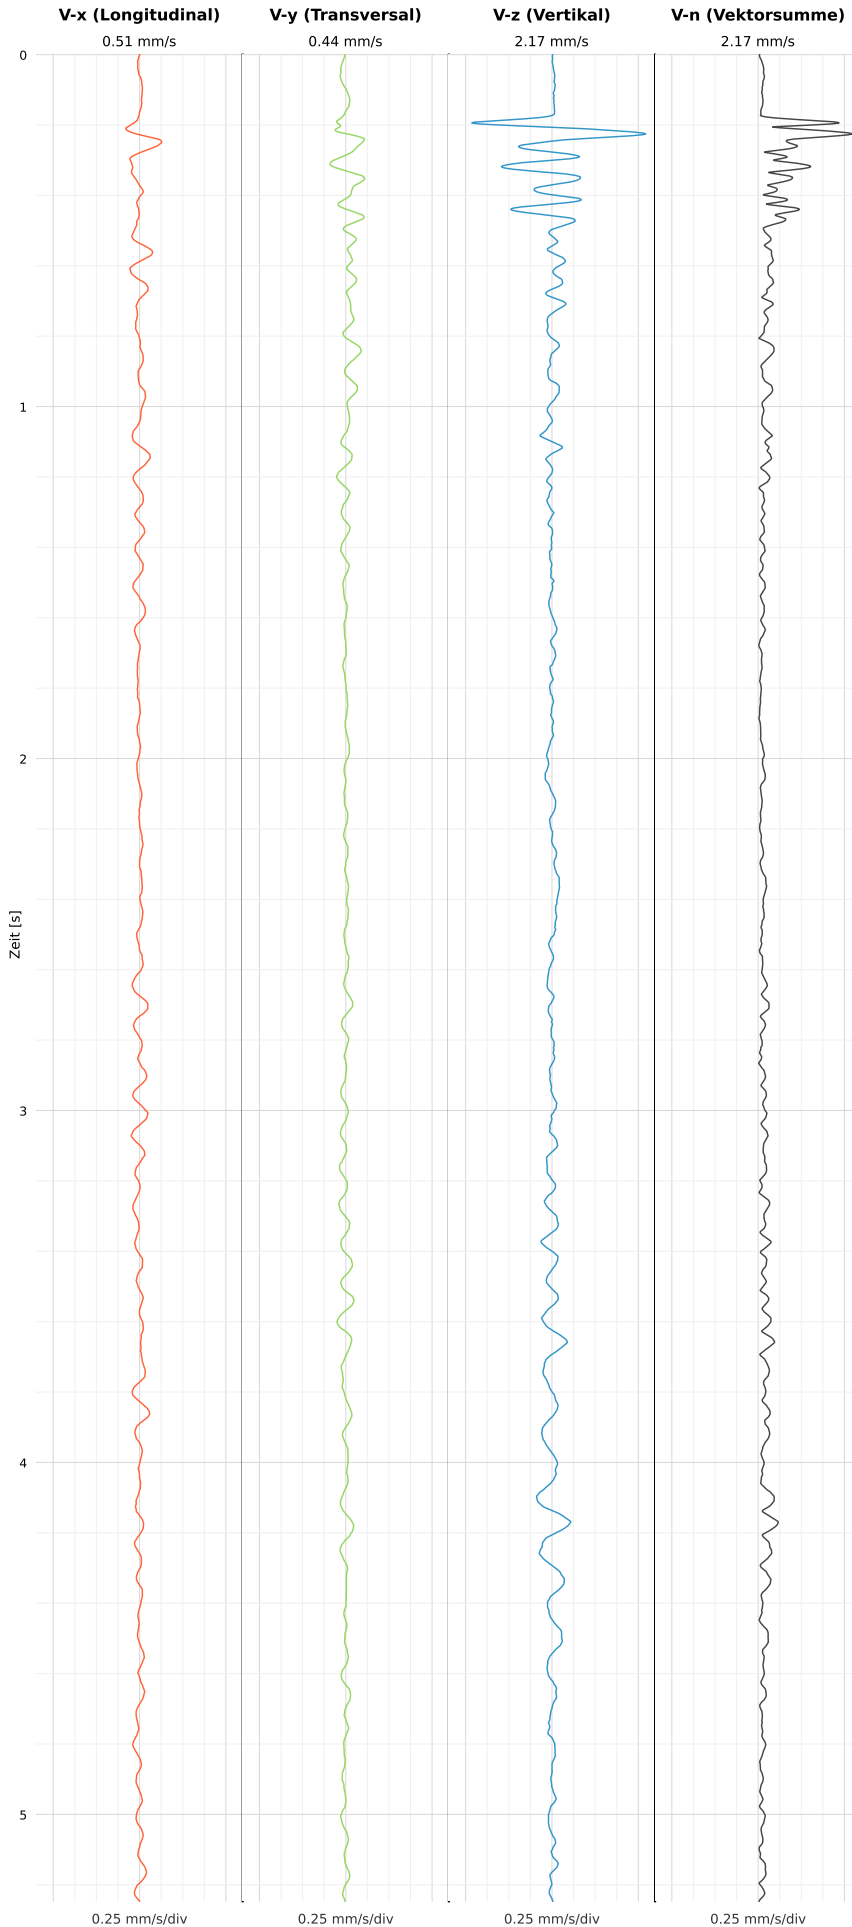


DATEI: 2493-PG-4-12052026-162714_raw.csv

Aufzeichnungsdauer: 5.25 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	18:27:14
Event-ID	2493-PG-4-12052026-162714
Status	Ereignis
X	0.51 mm/s @ 9.7 Hz
Y	0.44 mm/s @ 9.2 Hz
Z	2.17 mm/s @ 5.9 Hz
Vn	2.17 mm/s @ 5.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

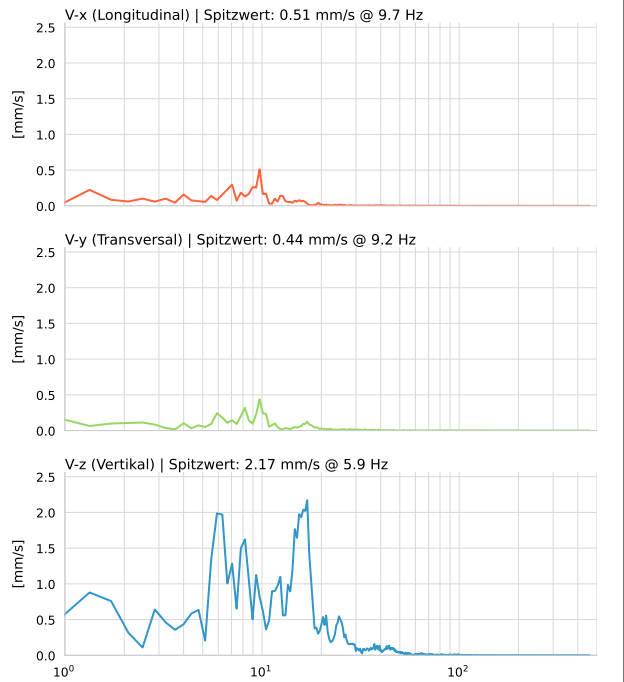

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	9.7 Hz	6.3 Hz	9.3 Hz	13.5 Hz
Y	9.2 Hz	5.5 Hz	9.3 Hz	16.2 Hz
Z	5.9 Hz	7.8 Hz	14.7 Hz	18.1 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

