


## SCHWINGGESCHWINDIGKEIT



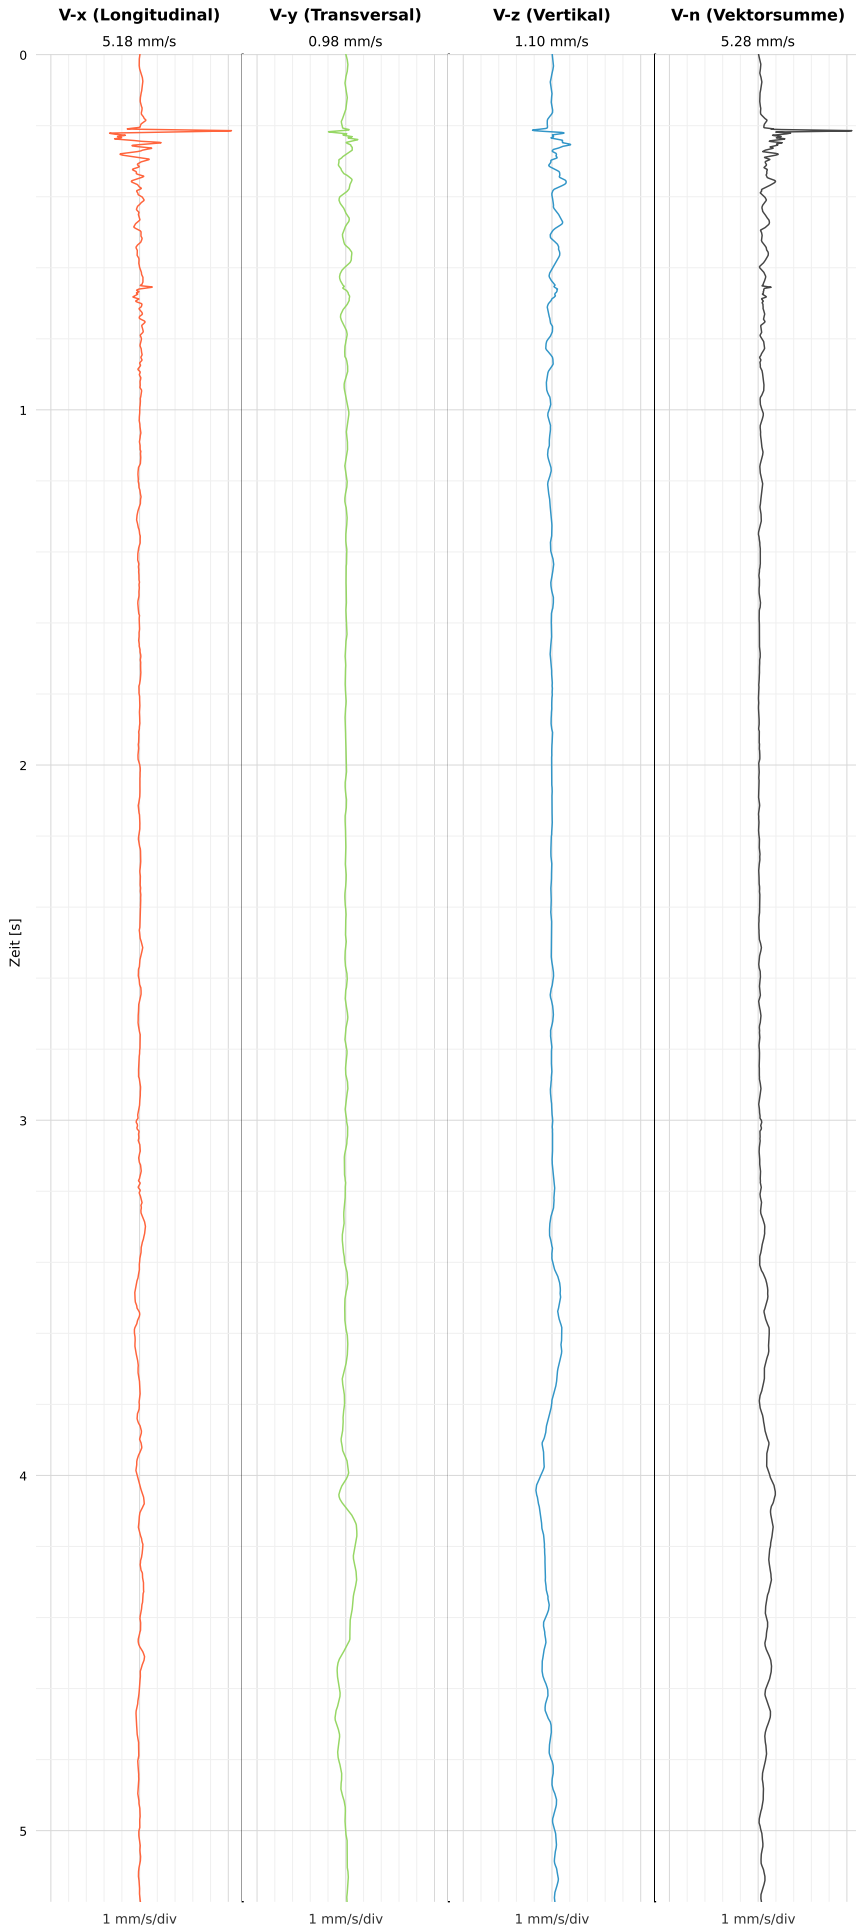


DATEI: 2493-PG-4-12052026-191755\_raw.csv

Aufzeichnungsdauer: 5.20 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	21:17:55
Event-ID	2493-PG-4-12052026-191755
Status	Kritisch
X	5.18 mm/s @ 1.1 Hz
Y	0.98 mm/s @ 1.4 Hz
Z	1.10 mm/s @ 1.4 Hz
Vn	5.28 mm/s @ 1.1 Hz

## SPEKTRALANALYSE - KOMPONENTEN FFT

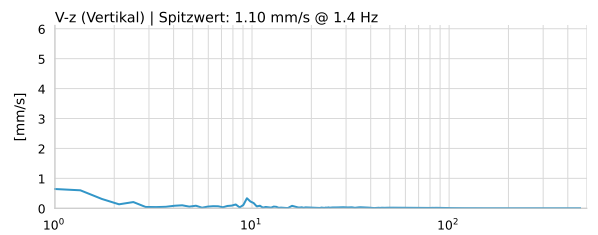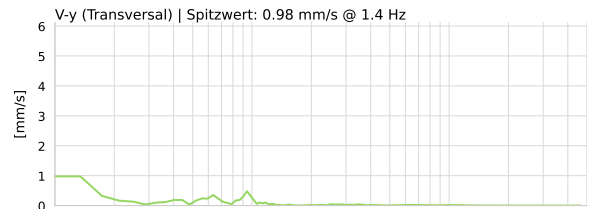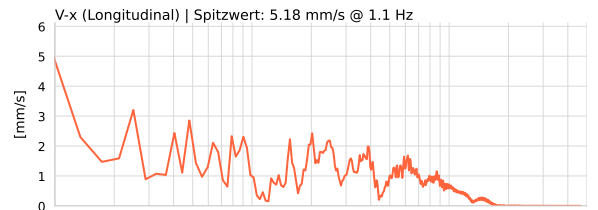

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	1.1 Hz	23.3 Hz	52.1 Hz	83.7 Hz
Y	1.4 Hz	2.1 Hz	9.4 Hz	51.3 Hz
Z	1.4 Hz	1.3 Hz	9.8 Hz	43.3 Hz

## SPEKTRALANALYSE - FFT (DIN 4150-3)

