


SCHWINGGESCHWINDIGKEIT

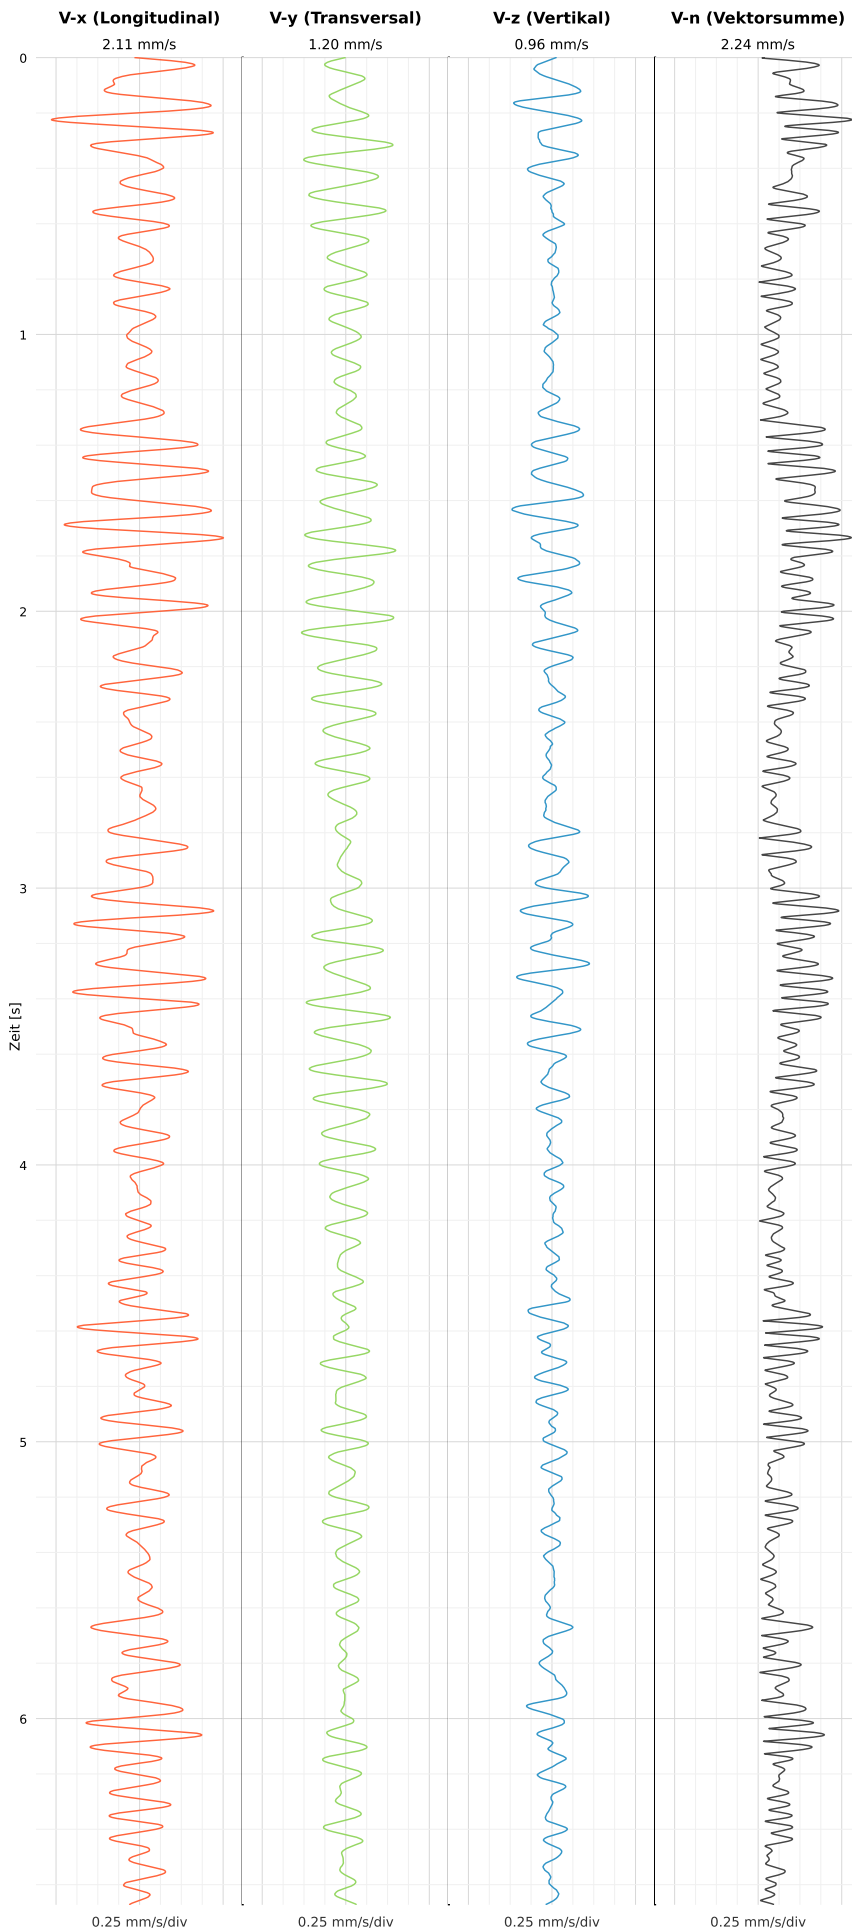


DATEI: 2493-PG-4-12052026-201612_raw.csv

Aufzeichnungsdauer: 6.67 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:16:12
Event-ID	2493-PG-4-12052026-201612
Status	Ereignis
X	2.11 mm/s @ 8.4 Hz
Y	1.20 mm/s @ 8.4 Hz
Z	0.96 mm/s @ 8.4 Hz
Vn	2.24 mm/s @ 8.4 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

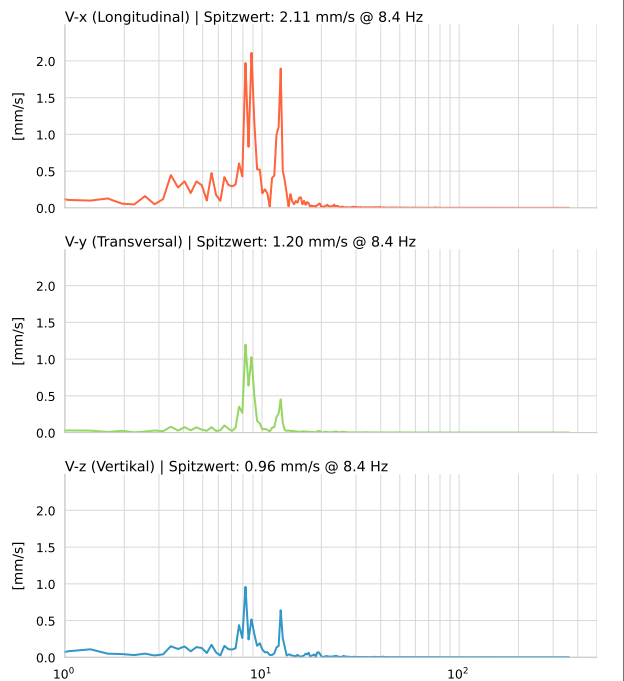

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.4 Hz	7.6 Hz	9.1 Hz	12.4 Hz
Y	8.4 Hz	8.2 Hz	8.8 Hz	12.1 Hz
Z	8.4 Hz	7.6 Hz	8.8 Hz	12.4 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

