


SCHWINGGESCHWINDIGKEIT

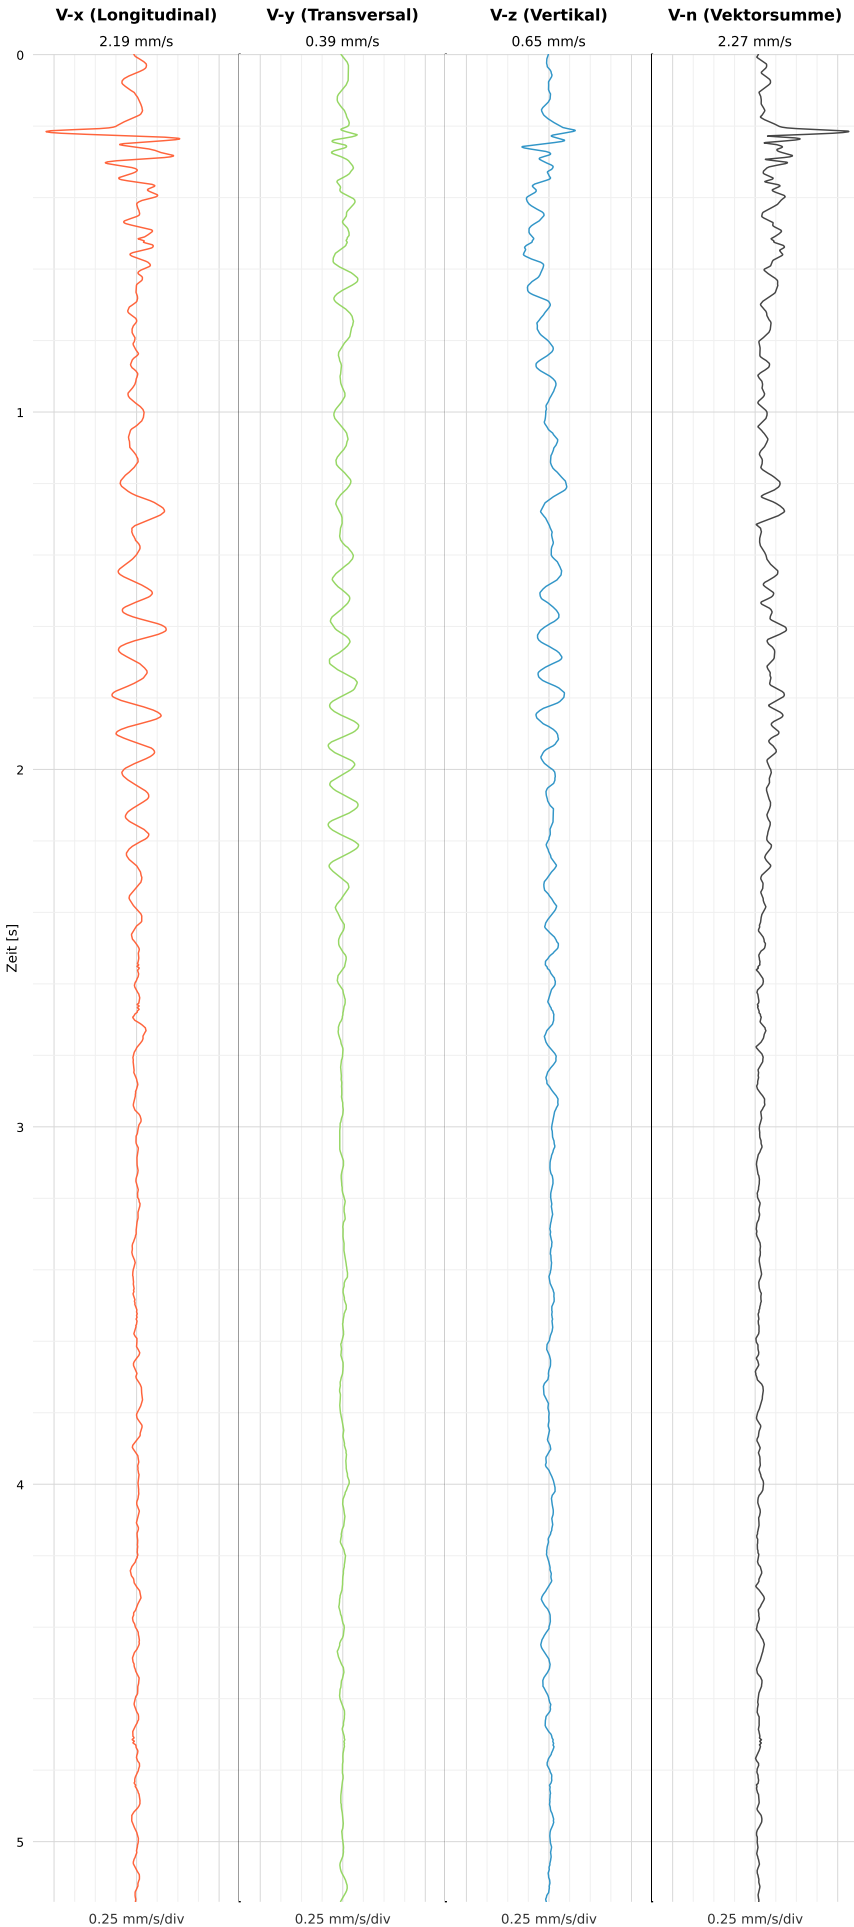


DATEI: 2493-PG-4-12052026-202429_raw.csv

Aufzeichnungsdauer: 5.17 s | Abtastrate: 1000 Hz

Datum	12.05.2026
Zeit	22:24:29
Event-ID	2493-PG-4-12052026-202429
Status	Ereignis
X	2.19 mm/s @ 8.9 Hz
Y	0.39 mm/s @ 8.9 Hz
Z	0.65 mm/s @ 8.5 Hz
Vn	2.27 mm/s @ 8.9 Hz

SPEKTRALANALYSE - KOMPONENTEN FFT

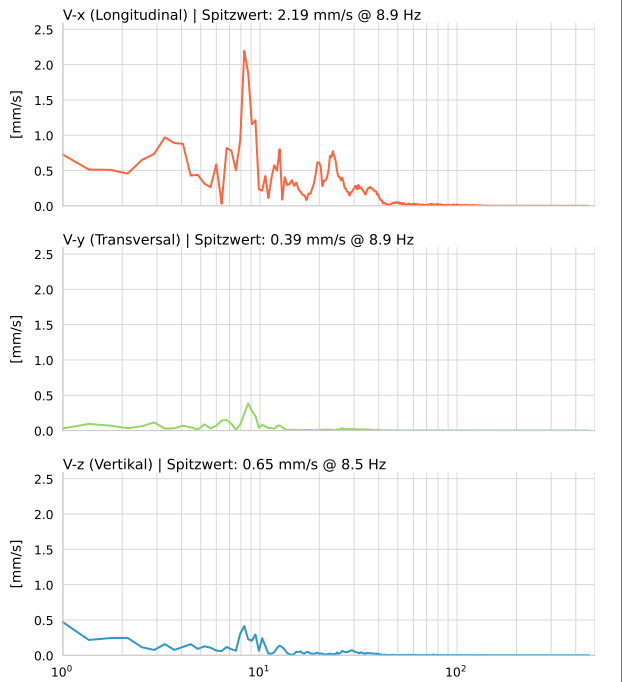

Kanal	Spitzwert	Spektrum 25%	Spektrum 50%	Spektrum 75%
X	8.9 Hz	7.9 Hz	15.3 Hz	26.9 Hz
Y	8.9 Hz	6.4 Hz	8.7 Hz	18.0 Hz
Z	8.5 Hz	2.1 Hz	8.3 Hz	21.9 Hz

SPEKTRALANALYSE - FFT (DIN 4150-3)

